

# DRAFT INTERNATIONAL STANDARD

## ISO/DIS 13784-2

ISO/TC 92/SC 1

Secretariat: BSI

Voting begins on:  
2020-01-31

Voting terminates on:  
2020-04-24

---

---

## Reaction-to-fire tests for sandwich panel building systems —

### Part 2: Test method for large rooms

*Essais de réaction au feu des systèmes de fabrication de panneaux de type sandwich —  
Partie 2: Méthode d'essai pour des chambres de grande taille*

ICS: 13.220.50

**ITeh STANDARD PREVIEW**  
(standards.iteh.ai)  
Full standard:  
<https://standards.iteh.ai/catalog/standards/sist/e150e2f6-7a76-4e41-9c45-4e991bf7f969/iso-dis-13784-2>

THIS DOCUMENT IS A DRAFT CIRCULATED FOR COMMENT AND APPROVAL. IT IS THEREFORE SUBJECT TO CHANGE AND MAY NOT BE REFERRED TO AS AN INTERNATIONAL STANDARD UNTIL PUBLISHED AS SUCH.

IN ADDITION TO THEIR EVALUATION AS BEING ACCEPTABLE FOR INDUSTRIAL, TECHNOLOGICAL, COMMERCIAL AND USER PURPOSES, DRAFT INTERNATIONAL STANDARDS MAY ON OCCASION HAVE TO BE CONSIDERED IN THE LIGHT OF THEIR POTENTIAL TO BECOME STANDARDS TO WHICH REFERENCE MAY BE MADE IN NATIONAL REGULATIONS.

RECIPIENTS OF THIS DRAFT ARE INVITED TO SUBMIT, WITH THEIR COMMENTS, NOTIFICATION OF ANY RELEVANT PATENT RIGHTS OF WHICH THEY ARE AWARE AND TO PROVIDE SUPPORTING DOCUMENTATION.

This document is circulated as received from the committee secretariat.



Reference number  
ISO/DIS 13784-2:2020(E)

© ISO 2020

**iTeh STANDARD PREVIEW**  
(standards.iteh.ai)  
Full standard:  
<https://standards.iteh.ai/catalog/standards/sist/ef50e2f6-7a76-4e41-9c45-4e991bf7f969/iso-dis-13784-2>



**COPYRIGHT PROTECTED DOCUMENT**

© ISO 2020

All rights reserved. Unless otherwise specified, or required in the context of its implementation, no part of this publication may be reproduced or utilized otherwise in any form or by any means, electronic or mechanical, including photocopying, or posting on the internet or an intranet, without prior written permission. Permission can be requested from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office  
CP 401 • Ch. de Blandonnet 8  
CH-1214 Vernier, Geneva  
Phone: +41 22 749 01 11  
Fax: +41 22 749 09 47  
Email: [copyright@iso.org](mailto:copyright@iso.org)  
Website: [www.iso.org](http://www.iso.org)

Published in Switzerland

# Contents

	Page
Foreword.....	iv
Introduction.....	v
<b>1 Scope.....</b>	<b>1</b>
<b>2 Normative references.....</b>	<b>1</b>
<b>3 Terms and definitions.....</b>	<b>2</b>
<b>4 Principle.....</b>	<b>2</b>
<b>5 Types of structure.....</b>	<b>3</b>
<b>6 Test specimen.....</b>	<b>3</b>
<b>7 Test room design and construction.....</b>	<b>3</b>
<b>8 Ignition source.....</b>	<b>7</b>
<b>9 Apparatus.....</b>	<b>9</b>
<b>10 Procedure.....</b>	<b>11</b>
10.1 Initial conditions.....	11
10.2 Test.....	12
<b>11 Precision.....</b>	<b>13</b>
<b>12 Test report.....</b>	<b>13</b>
<b>Bibliography.....</b>	<b>15</b>

**iTeh STANDARD PREVIEW**  
 (standards.iteh.ai)  
 Full standard:  
<https://standards.iteh.ai/catalog/standards/sist/e150e2f6-7a76-4e41-9c45-4e991bf7f969/iso-dis-13784-2>

## Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

International Standards are drafted in accordance with the rules given in the ISO/IEC Directives, Part 3.

Draft International Standards adopted by the technical committees are circulated to the member bodies for voting. Publication as an International Standard requires approval by at least 75 % of the member bodies casting a vote.

Attention is drawn to the possibility that some of the elements of this part of ISO 13784 may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights.

International Standard ISO 13784-2 was prepared by Technical Committee ISO/TC 92, *Fire safety*, Subcommittee SC 1, *Fire initiation and growth*.

ISO 13784 consists of the following parts, under the general title *Reaction-to-fire tests for sandwich panel building systems*:

- *Part 1: Test method for small rooms*
- *Part 2: Test method for large rooms*

**PREVIEW**  
iTeh STANDARD  
(standards.itih.ai)  
Full standard:  
<https://standards.itih.ai/catalog/standards/sist/650e2f6-7a76-4e41-9c45-4e991bf7f969/iso-dis-13784-2>

## Introduction

Fire is a complex phenomenon, its behaviour and effects dependent upon a number of interrelated factors. The behaviour of materials and products depends upon the characteristics of the fire, the method of use of the materials and the environment in which they are exposed (for the philosophy of reaction-to-fire tests, see ISO/TS 3814).

The need for improved insulation of buildings has led to the increased use of thermal insulating sandwich panel systems in different parts of the building industry. Thermal insulating sandwich panel systems are applied as external cladding on factory buildings, in internal envelopes with controlled atmospheres and in cold stores — varying from small rooms to large, cool- and ware-houses. Other applications are in modular building rooms and retail premises. These systems can also be used for roof applications in traditional constructions. Multi-layered panels with other facings (e.g. plasterboard) or sandwich panel systems can also be applied to walls as internal linings or insulation; however, this is not within the scope of ISO 13784.

There exist three primary fire-related threats to the walls and ceilings or roofs of a building insulated with freestanding or frame-supported types of thermal insulating sandwich panel systems:

- a) an interior compartment fire impinging directly onto the joints of the wall, typical ignition sources being welding torches, burning items near the wall and fire in an adjacent room;
- b) an external fire or combustibles (rubbish, vegetation, vehicles, etc.) accumulated near the wall;
- c) fire spread to outside spaces.

Moreover, such a fire can spread in several ways:

- over a combustible exterior surface;
- by travelling vertically and horizontally through the combustible cores of cavities within the external wall or ceiling/roof;
- through combustible gases which have developed due to the pyrolysis of the combustible components and which will ignite on the surface;
- as burning debris or flaming droplets.

This part of ISO 13784 deals with a simple representation of a fire scenario involving a thermal insulating sandwich panel system — such as that typified by a local fire impinging directly on the internal face of a thermal insulating sandwich panel building construction. The test method specified can be used to provide a large-room scale, end-use evaluation of all aspects of thermal insulating sandwich panel systems, including constructional techniques (supporting frameworks, jointing detail, etc.)

The test method is intended for evaluating products which, by their nature, are not normally used as internal linings and are unsuitable for assessment using ISO 9705<sup>[1]</sup>, which evaluates fire growth from a surface product. Nevertheless, this part of ISO 13784 provides a means by which a freestanding or frame-supported thermal insulating sandwich panel building construction can be built and evaluated.

Testing of this type can be used for comparative purposes or to ensure the existence of a certain quality of performance considered to have a bearing on fire performance generally.

**iTeh STANDARD PREVIEW**  
**(standards.iteh.ai)**

Full standard:  
<https://standards.iteh.ai/catalog/standards/sist/ef50e2f6-7a76-4e41-9c45-4e991bf7f969/iso-dis-13784-2>

# Reaction-to-fire tests for sandwich panel building systems —

## Part 2: Test method for large rooms

**SAFETY PRECAUTIONS** — In order that suitable precautions can be taken to safeguard health, the attention of all concerned in fire tests is drawn to the possibility that toxic or harmful gases can be evolved during combustion of test specimens.

The test procedures concerned involve high temperatures and combustion processes — from ignition to a fully developed room fire. Therefore, hazards can exist for burns, ignition of extraneous objects or clothing. Operators should use protective clothing, helmet, face-shield and equipment for avoiding exposure to toxic gases.

Laboratory safety procedures shall be set up which ensure the safe termination of tests on sandwich panel products. Specimens with combustible content burning inside metallic facings can be difficult to extinguish with standard laboratory fire fighting equipment. Adequate means of extinguishing such a fire shall be provided.

When tests are conducted using the freestanding or frame-supported constructions, specimens could emit combustion products from their external faces, especially if joints open up. Specimen collapse can also occur. Laboratory safety procedures shall be set up to ensure the safety of personnel with due consideration to such situations.

For construction of the test enclosure using a freestanding structure without structural framework, because of the size and weight of the individual panels it is strongly recommended that construction be accomplished within an additional external support framework (e.g. scaffolding). If the test enclosure is erected in an outside environment, it is further recommended that the external framework remain in place during the test. The task of this framework is only to avoid collapse of the test room caused by wind action. This additional framework shall not be used to fix and support the sandwich panels.

### 1 Scope

This part of ISO 13784 specifies a test method for evaluating the reaction-to-fire performance of thermal insulating sandwich panel building systems for large rooms and the resulting flame spread on or within the thermal insulating sandwich panel building construction when it is exposed to heat from a simulated internal fire with flames impinging directly on its internal corner. The test method is not intended for evaluating a product's fire resistance.

This part of ISO 13784 is applicable to both freestanding and self-supporting, and frame-supported, thermal insulating sandwich panel systems, but only to wall and ceiling or roof constructions.

### 2 Normative references

The following normative documents contain provisions which, through reference in this text, constitute provisions of this part of ISO 13784. For dated references, subsequent amendments to, or revisions of, any of these publications do not apply. However, parties to agreements based on this part of ISO 13784 are encouraged to investigate the possibility of applying the most recent editions of the normative documents indicated below. For undated references, the latest edition of the normative document referred to applies. Members of ISO and IEC maintain registers of currently valid International Standards.

ISO/TR 9705-2, *Reaction-to-fire tests — Full-scale room tests for surface products — Part 2: Technical background and guidance*

ISO 13784-1, *Reaction to fire test for sandwich panel building systems — Part 1: Small room test*

ISO 13943, *Fire safety — Vocabulary*

IEC 60584-2, *Thermocouples — Part 2: Tolerances*

### 3 Terms and definitions

For the purposes of this part of ISO 13784, the terms and definitions given in ISO 13943 and the following apply.

#### 3.1

##### **composite**

combination of materials generally recognized in building construction as discrete entities

EXAMPLE Coated or laminated materials.

#### 3.2

##### **exposed surface**

surface of the product subjected to the heating conditions of the test

#### 3.3

##### **product**

material, composite or assembly

#### 3.4

##### **surface product**

any part of a building constituting an exposed surface on the walls or ceiling/roof, or on both

EXAMPLE Panel or board.

#### 3.5

##### **thermal insulating sandwich panel**

building product consisting of two metal faces positioned on either side of a core that is a thermally insulating material, which is firmly bonded to both faces so that the three components act compositely when under load (from now on called "sandwich panel")

Note 1 to entry: One layer is an insulating material, such as mineral or glass wool, cellular plastics or a natural material (e.g. corkboard), protected by facings on both sides. Facings can be selected from a variety of materials and can be either flat or profiled. The most widely used facing is coated steel. The composite can vary from a simple construction to a complex composite system with specific fixing joints and supports, depending on the application and on the performance requirements.

#### 3.6

##### **specimen**

assembly representing the end-use construction

### 4 Principle

The reaction to fire performance of a sandwich panel assembly is assessed when it is exposed to flames impinging directly on the internal corner of a sandwich panel assembly. The different kinds of flame spread that can occur are flame spread within the internal core, on the surface or through joints, by ignited combustible gases and by falling debris or melting droplets of the sandwich panel assembly. The assessment allows determination of the following possible fire hazards:

— the contribution of the system to fire development up to flashover;



- the potential for transmitting an interior fire to outside spaces or other compartments or adjacent buildings;
- the possibility of the structure's collapse;
- the development of smoke and fire gases inside the test room.

## 5 Types of structure

The test method is applicable to the following two types of structure, representative of those used in practice both in respect of construction and materials.

### a) Frame-supported structures

Sandwich panel systems are mechanically fixed to the outside or the inside of a structural framework — normally steel — through the thickness of the panel. The ceiling/roof can be built traditionally or using sandwich panel systems. A widespread example is the external cladding of industrial buildings. In most cases, this kind of sandwich panel system is used on a building's exterior wall, roof or both.

Deformation of the frame can influence the fire behaviour of the sandwich panels. Where the frame is protected in practice because of fire resistance requirements, this should also be the case for the frame under test. Protection can be obtained by means of insulating boards or coatings.

### b) Freestanding structures

Sandwich panel systems are assembled together to provide a room or enclosure that does not depend for its stability on any other structural framework (e.g. cold stores, food or clean rooms, generally constructed within a weatherproof shell). Normally situated inside a building, the ceilings of these constructions may be supported from above.

## 6 Test specimen

The test specimen shall consist of the requisite number of panels required for the test to be performed. In all cases, the test specimen shall be representative of that used in practice, both in construction and materials. All constructional details of joints, fixings, etc., shall be reproduced and positioned in the test specimen as in practice. If the type of sandwich panel under test is used in practice with an inside or outside structural framework, this shall be included in the test.

The test specimen should be built by those suitably qualified in the construction of this type of structure.

If, in practice, ceiling panels are different from wall panels, a test may be performed with the correct combination of wall and ceiling panels.

If the sandwich panel building system is intended for use with decorative paint or film facings, these shall be present on the test specimen.

## 7 Test room design and construction

**7.1** The test method consists of a procedure by which sandwich panel assemblies are assessed in their end-use scale and with the constructional details incorporated in their end use. Products are evaluated with end-use joints and fixings; where a supporting steel framework is part of the construction, testing is done with this framework also in place. Where the panels are self-supporting, for safety reasons an unconnected external framework should be used.

**7.2** Perform the test on a sandwich panel specimen in accordance with [clause 6](#), erected as in end-use practice to form a large room configuration (see [Figure 1](#)). The room shall consist of four walls at right

angles and a ceiling, and shall be located on a rigid, non-combustible floor surface. The room shall have the following inner dimensions.

Length:  $(4,8 \pm 0,05)$  m

Width:  $(4,8 \pm 0,05)$  m

Height:  $(4 \pm 0,05)$  m

**7.3** Provide a doorway in the front wall of the room; no other wall shall have any openings allowing ventilation. The doorway shall have the following dimensions.

Width:  $(4,8 \pm 0,05)$  m

Height:  $(2,8 \pm 0,05)$  m


**7.4** The room may be located indoors or outdoors.

**7.5** Full and detailed drawings of the various elements of construction, including all jointing details and any framework required with attachment details, shall be provided by the panel system manufacturer prior to the test.

See [Figures 2](#) and [3](#) for an example of an inside support framework for structural fixed sandwich panels.

**NOTE** The number of panels and their thickness can of course be different from those shown in the examples, depending on the type of panels tested. In addition, the type of supporting frame will depend on the practical end-use mounting.

Dimensions in millimetres

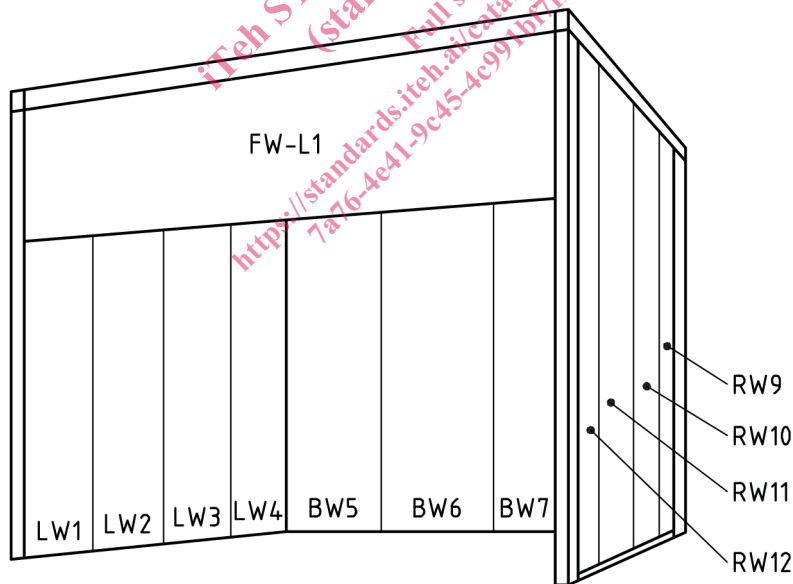

**a) Isometric elevation**