
Betonski tlakovci - Zahteve in preskusne metode

Concrete paving blocks - Requirements and test methods

Pflastersteine aus Beton - Anforderungen und Prüfverfahren

Pavés en béton - Prescriptions et méthodes d'essai

Ta slovenski standard je istoveten z: EN 1338:2003**SIST EN 1338:2003**<https://standards.iteh.ai/catalog/standards/sist/1d762336-ceb7-4dfc-af21-ba447465002d/sist-en-1338-2003>**ICS:**

91.100.30	Beton in betonski izdelki	Concrete and concrete products
93.080.20	Materiali za gradnjo cest	Road construction materials

SIST EN 1338:2003**en**

iTeh STANDARD PREVIEW
(standards.iteh.ai)

SIST EN 1338:2003

<https://standards.iteh.ai/catalog/standards/sist/1d762336-ceb7-4dfc-af21-ba447465002d/sist-en-1338-2003>

EUROPEAN STANDARD
NORME EUROPÉENNE
EUROPÄISCHE NORM

EN 1338

May 2003

ICS 93.080.20

English version

Concrete paving blocks - Requirements and test methods

Pavés en béton - Prescriptions et méthodes d'essai

Pflastersteine aus Beton - Anforderungen und
Prüfverfahren

This European Standard was approved by CEN on 16 October 2002.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the Management Centre or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Czech Republic, Denmark, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Luxembourg, Malta, Netherlands, Norway, Portugal, Slovakia, Spain, Sweden, Switzerland and United Kingdom.

STANDARD PREVIEW
(standards.iteh.ai)

SIST EN 1338:2003
<https://standards.iteh.ai/catalog/standards/sist/1d762336-ceb7-4dfc-af21-ba447465002d/sist-en-1338-2003>



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG

Management Centre: rue de Stassart, 36 B-1050 Brussels

Contents

	page
Foreword.....	5
1 Scope	6
2 Normative references	6
3 Terms and definitions.....	7
4 Requirements for materials	9
4.1 General.....	9
4.2 Asbestos.....	9
5 Requirements for products.....	9
5.1 General.....	9
5.2 Shape and dimensions.....	10
5.2.1 General.....	10
5.2.2 Work dimensions.....	10
5.2.3 Spacer nibs, draw or chased and profiled side faces	10
5.2.4 Permissible deviations	10
5.3 Physical and mechanical properties.....	11
5.3.1 General.....	11
5.3.2 Weathering resistance.....	11
5.3.3 Tensile splitting strength	12
5.3.4 Abrasion resistance.....	12
5.3.5 Slip/skid resistance.....	13
5.3.6 Fire performance.....	13
5.3.7 Thermal conductivity.....	14
5.4 Visual aspects.....	14
5.4.1 Appearance	14
5.4.2 Texture	14
5.4.3 Colour	14
6 Evaluation of conformity criteria.....	14
6.1 General.....	14
6.1.1 Demonstration of conformity	15
6.1.2 Assessment of conformity.....	15
6.2 Type testing of the product	15
6.2.1 Initial type testing	15
6.2.2 Further type testing	15
6.2.3 Sampling, testing and conformity criteria.....	16
6.3 Factory production control.....	17
6.3.1 General.....	17
6.3.2 Equipment	17
6.3.3 Raw and other incoming materials	17
6.3.4 Production process	17
6.3.5 Product testing.....	17
6.3.6 Marking, storage and delivery of products	17
6.3.7 Non-conforming products	18
6.3.8 Product conformity criteria.....	18
7 Marking	19
8 Test report	20
Annex A (informative) Inspection schemes.....	21

A.1	Equipment inspection	21
A.2	Materials inspection	22
A.3	Production process inspection	23
A.4	Product inspection	23
A.5	Switching rules	24
Annex B	(normative) Procedure for acceptance testing of a consignment at delivery	25
B.1	General	25
B.2	Sampling procedure	25
B.3	Conformity criteria	26
Annex C	(normative) Measurement of the dimensions of a single block	27
C.1	Preparation	27
C.2	Plan dimensions	27
C.3	Thickness	27
C.4	Flatness and bow	27
C.5	Chamfer	28
C.6	Thickness of facing layer	28
C.7	Examples of measuring equipment	28
C.8	Test report	30
Annex D	(normative) Determination of freeze/thaw resistance with de-icing salt	31
D.1	Principle	31
D.2	Specimen	31
D.3	Materials	31
D.4	Apparatus	31
D.5	Preparation of test specimens	32
D.6	Procedure	34
D.7	Calculation of test results	36
D.8	Test report	36
Annex E	(normative) Determination of total water absorption	37
E.1	Principle	37
E.2	Specimen	37
E.3	Materials	37
E.4	Apparatus	37
E.5	Preparation of the test specimens	37
E.6	Procedure	38
E.7	Calculation of test results	38
E.8	Test report	38
Annex F	(normative) Measurement of strength	39
F.1	Apparatus	39
F.2	Preparation	40
F.3	Procedure	40
F.4	Calculation of test results	41
F.5	Test report	42
Annex G	(normative) Measurement of abrasion resistance	43
G.1	Principle of wide wheel abrasion test	43
G.2	Abrasive material	43
G.3	Apparatus	43
G.4	Calibration	47
G.5	Preparation of the specimen	47
G.6	Procedure	48
G.7	Measuring the groove	48
	Calculation of test results	49
G.9	Test report	49
Annex H	(normative) Measuring of abrasion according to the Böhme test	50
H.1	Principle	50
H.2	Abrasive material	50

EN 1338:2003 (E)

H.3	Apparatus	50
H.4	Preparation of specimens	51
H.5	Procedure	52
H.6	Calculation of test results	52
H.7	Test report	53
Annex I	(normative) Method for the determination of unpolished slip resistance value (USRV)	54
I.1	Principle	54
I.2	Apparatus	54
I.3	Calibration	59
I.4	Sampling	59
I.5	Procedure	59
I.6	Calculation of test results	59
I.7	Test report	60
Annex J	(normative) Verification of visual aspects	61
J.1	Preparation	61
J.2	Procedure	61
Annex K	(informative) Example of the application of the method for checking conformity of tensile splitting strength by variables (6.3.8.3.B)	62
K.1	General	62
K.2	Basic formula	62
K.3	Acceptance factors	62
K.4	Standard deviations s	62
K.5	Application of switching rules	63
K.6	Results	63
Annex ZA	(informative) Clauses of this European Standard addressing the provisions of the EU Construction Products Directive (89/106/EEC)	65

SIST EN 1338:2003
<https://standards.iteh.ai/catalog/standards/sist/1d762336-ceb7-4dfc-af21-ba447465002d/sist-en-1338-2003>

Foreword

This document (EN 1338:2003) has been prepared by Technical Committee CEN/TC 178 "Paving units and kerbs", the secretariat of which is held by BSI.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by November 2003, and conflicting national standards shall be withdrawn at the latest by February 2005.

This document has been prepared under a mandate given to CEN by the European Commission and the European Free Trade Association, and supports essential requirements of EU Directive(s).

For the relationship with the Construction Products Directive see informative Annex ZA, which is an integral part of this document.

According to the CEN/CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Czech Republic, Denmark, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Luxembourg, Malta, Netherlands, Norway, Portugal, Slovakia, Spain, Sweden, Switzerland and the United Kingdom.

No existing European Standard is superseded.

The annexes B, C, D, E, F, G, H, I and J are normative, the annexes A, K and ZA are informative.

SIST EN 1338:2003
<https://standards.iteh.ai/catalog/standards/sist/1d762336-ceb7-4dfc-af21-ba447465002d/sist-en-1338-2003>

EN 1338:2003 (E)**1 Scope**

This European Standard specifies materials, properties, requirements and test methods for unreinforced cement bound concrete paving blocks and complementary fittings. It is applicable to precast concrete paving blocks and complementary fittings for pedestrian use, vehicular use and roof coverings, e.g. footpaths, precincts, cycle tracks, car parks, roads, highways, industrial areas (including docks and harbours), aircraft pavements, bus stations, petrol filling stations.

In case of regular use of studded tyres additional requirements are sometimes needed.

This standard does not deal with the tactility or visibility of blocks nor with permeable blocks.

This standard provides for the product marking and the evaluation of conformity of the product to this European Standard.

2 Normative references

This European Standard incorporates by dated and undated references, provisions from other publications. These normative references are cited at the appropriate places in the text, and the publications are listed hereafter. For dated references subsequent amendments to or revisions of any of these publications apply to this European Standard only when incorporated in it by amendment or revision. For undated references, the latest edition of the publication referred to applies (including amendments).

EN 10083-2, *Quenched and tempered steels — Part 2: Technical delivery conditions for unalloyed quality steels*.

EN 13369, *Common rules for precast concrete products*.

EN ISO 4288, *Geometric product specification (GPS) - Surface texture: Profile method - Rules and procedures for the assessment of surface texture (ISO 4288:1996)*.

EN ISO 6506-1, *Metallic materials - Brinell hardness test - Part 1: Test method (ISO 6506-1:1999)*.

EN ISO 6506-2, *Metallic materials - Brinell hardness test - Part 2: Verification and calibration of testing machines (ISO 6506-2:1999)*.

EN ISO 6506-3, *Metallic materials - Brinell hardness test - Part 3: Calibration of reference blocks (ISO 6506-3:1999)*.

ISO 48, *Rubber, vulcanized or thermoplastic — Determination of hardness (hardness between 10 IRHD and 100 IRHD)*.

ISO 4662, *Rubber — Determination of rebound resilience of vulcanizates*.

ISO 7619, *Rubber — Determination of indentation hardness by means of pocket hardness meters*.

ISO 7873, *Control charts for arithmetic average with warning limits*.

ISO 7966, *Acceptance control charts*.

ISO 8486-1, *Bond abrasives — Determination and designation of grain size distribution — Macrogrits F4 to F220*.

3 Terms and definitions

For the purposes of this European Standard, the following terms and definitions apply.

3.1

arris

part of a block where two faces meet. It can be bevelled, rounded, chamfered, radiused or splayed

3.2

concrete paving block

precast concrete unit used as a surfacing material that satisfies the following conditions:

- at a distance of 50 mm from any edge, any cross-section does not show a horizontal dimension less than 50 mm;
- its overall length divided by its thickness is less than or equal to four.

NOTE These two conditions are not applicable to complementary fittings.

3.3

complementary fitting

unit, sometimes a part of a block, which is used to infill and enable an area to be completely surfaced

3.4

permeable paving block

block intended by its structure to allow the passage of water through the block

3.5

overall length

longer side of the rectangle with the smallest area able to enclose the block excluding any spacer nibs

3.6

overall width

shorter side of the rectangle with the smallest area able to enclose the block excluding any spacer nibs

3.7

thickness

distance between the upper face and the bed face of the block

3.8

spacer nibs

small protruding profiles on a side face of a block

3.9

upper face

surface intended to be seen when in use

3.10

bed face

surface generally parallel to the upper face and in contact with the bedding after laying

3.11

facing layer

layer of concrete on the upper face of a block of different material and/or properties to the main body or backing layer

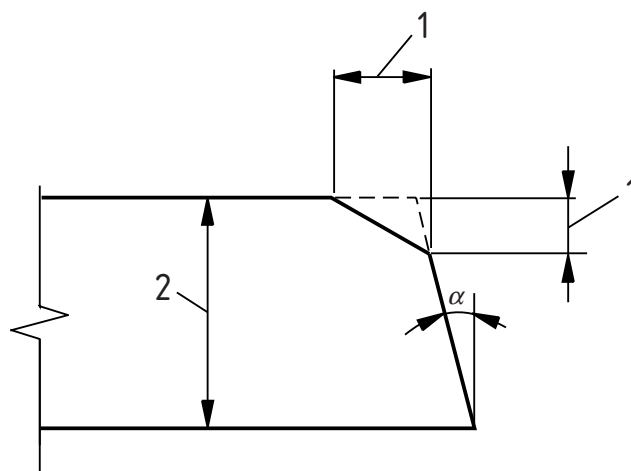
NOTE To be distinguished from wipe, being a fine cement mortar or slurry applied to the surface of the block.

EN 1338:2003 (E)

3.12

draw

intended angle of the side face from the vertical plane over the full height of a block as shown in Figure 1

**Key**

1 Chamfer

2 Thickness

 α Draw

iTeh STANDARD PREVIEW
(standards.iteh.ai)

Figure 1 — Example of chamfer and draw

[SIST EN 1338:2003](https://standards.iteh.ai/catalog/standards/sist/1d762336-ceb7-4dfc-af21-ba447465002d/sist-en-1338-2003)

<https://standards.iteh.ai/catalog/standards/sist/1d762336-ceb7-4dfc-af21-ba447465002d/sist-en-1338-2003>

3.13

chamfer

bevelled arris, as shown in Figure 1

3.14

work dimension

any dimension of a block specified for its manufacture to which the actual dimension should conform within specified permissible deviations

3.15

secondary processing

manufacturing process to texture the whole block or any surface, carried out after basic manufacture before or after hardening

3.16

actual dimension

dimension of a block as measured

3.17

chased side face

side face of a concrete paving block, having a recessed profile

3.18

skid resistance

ability to resist relative movement between a vehicle tyre and the trafficked concrete paving block surface

3.19**slip resistance**

ability to resist relative movement between a pedestrian foot and the trafficked concrete paving block surface

3.20**format**

work dimensions of a block, specified in order of overall length, overall width and thickness

3.21**wipe**

fine cement mortar or slurry applied to the surface of the units

4 Requirements for materials**4.1 General**

Only materials with suitability established in terms of their properties and performance shall be used in the manufacture of concrete paving blocks.

The suitability requirements of the materials used shall be given in the manufacturer's production control documentation.

Where, by conformity with relevant specifications, the properties and performance of materials have been demonstrated, further testing need not be performed.

A reference scheme for materials inspection is given in annex A.

4.2 Asbestos

Asbestos, or materials containing asbestos, shall not be used.

5 Requirements for products**5.1 General**

The performance requirements of concrete paving blocks are defined by classes which have associated marking designations.

Blocks may be produced with a single concrete throughout or with different facing and backing layers.

When blocks are produced with a facing layer this shall have a minimum thickness of 4 mm over the area declared by the manufacturer, when measured in accordance with annex C. Isolated particles of aggregate protruding into the facing layer shall be ignored. The facing layer shall be an integral part of the block.

An arris described as square may be bevelled or rounded, its horizontal or vertical dimensions shall not exceed 2 mm.

A bevelled arris exceeding 2 mm shall be described as chamfered. Its dimensions shall be declared by the manufacturer.

Blocks may be produced with functional and/or decorative profiles, which shall not be included in the work dimensions of a block.

The surface of blocks may be textured, secondary processed or treated chemically; these finishes or treatments shall be described and declared by the manufacturer.

EN 1338:2003 (E)**5.2 Shape and dimensions****5.2.1 General**

All references to dimensions in this subclause are to work dimensions.

The conformity criteria corresponding to each requirement taken separately are given in 6.3.8.1. The dimensions and deviations shall be measured according to annex C.

5.2.2 Work dimensions

The work dimensions shall be stated by the manufacturer.

5.2.3 Spacer nibs, draw or chased and profiled side faces

Blocks may be produced with spacer nibs, a draw or chased and profiled side faces. When these are provided, the manufacturer shall declare their work dimensions.

NOTE The size of the space allocated to the block should include an allowance for joints and deviations.

5.2.4 Permissible deviations

The permissible deviations on the manufacturer's declared work dimensions are given in Tables 1, 2 and 3.

iTeh STANDARD PREVIEW

(standards.iteh.ai)

Table 1 — Permissible deviations

Block thickness Mm	Length mm	Width mm	Thickness mm
< 100	± 2	± 2	± 3
≥ 100	± 3	± 3	± 4
The difference between any two measurements of the thickness of a single block shall be ≤ 3 mm.			

For non-rectangular blocks the deviations of the other dimensions shall be declared by the manufacturer.

When the length of the diagonals exceeds 300 mm, the maximum permissible differences between the measurement of the two diagonals of a rectangular block are given in Table 2.

Table 2 — Maximum differences

Class	Marking	Maximum difference mm
1	J	5
2	K	3

When the maximum dimension of a block exceeds 300 mm, the deviations for flatness and bow given in Table 3 shall apply to an upper face intended to be plane. When the upper face is not intended to be plane, the manufacturer shall supply the information on deviations.

Table 3 — Deviations of flatness and bow

Length of gauge Mm	Maximum convex mm	Maximum concave mm
300	1,5	1,0
400	2,0	1,5

NOTE For special fields of application such as airports, other deviations can be required.

5.3 Physical and mechanical properties

5.3.1 General

<https://standards.iteh.ai/catalog/standards/sist/1d762336-ceb7-4dfc-af21-ba447465002d/sist-en-1338-2003>

The blocks shall conform to the following requirements at the time they are declared suitable for use by the manufacturer.

When complementary fittings cannot be tested according to this standard, they are considered to conform to this standard, provided they have at least the same concrete quality as blocks complying with this standard.

5.3.2 Weathering resistance

5.3.2.1 Test method

The weathering resistance is determined by tests according to annex D for freeze-thaw resistance or annex E for water absorption and to the conformity criteria of 6.3.8.2.

5.3.2.2 Performance and classes

The blocks shall conform to the requirements in Table 4.1 or Table 4.2.

Recommendations as to the class(es) of weathering resistance required to ensure durability for that country, for the uses for which the product is put on the market, may be made at a national level.

Table 4.1 — Water absorption

Class	Marking	Water absorption % by mass
1	A	no performance measured
2	B	≤ 6 as a mean

Where specific conditions exist such as frequent contact of surfaces with de-icing salts under frost conditions, the requirements defined in Table 4.2 may have to be fulfilled.

Table 4.2 — Resistance to freeze-thaw with de-icing salts

Class	Marking	Mass loss after freeze/thaw test kg/m ²
3	D	$\leq 1,0$ as a mean with no individual value $> 1,5$

iTeh STANDARD PREVIEW
(standards.iteh.ai)

5.3.3 Tensile splitting strength

5.3.3.1 Test method

The characteristic tensile splitting strength T shall be determined by testing according to annex F and to the conformity criteria given in 6.3.8.3.

5.3.3.2 Performance

The characteristic tensile splitting strength T shall not be less than 3,6 MPa. None of the individual results shall be less than 2,9 MPa, nor have a failure load less than 250 N/mm of splitting length.

5.3.3.3 Durability of strength

Under normal exposure conditions of use precast concrete blocks will continue to provide satisfactory strength, provided they conform to 5.3.3.2 and are subject to normal maintenance.

5.3.4 Abrasion resistance

5.3.4.1 Test method

Abrasion resistance is determined by the Wide Wheel Abrasion test (see annex G), , or as an alternative by the Böhme test (see annex H). The Wide Wheel Abrasion test is the reference test.

5.3.4.2 Performance and classes

Requirements for abrasion resistance are given in Table 5.

No individual result shall be greater than the required value.

Table 5 — Abrasion resistance classes

Class	Marking	Requirement	
		Measured in accordance with the test method described in annex G	Alternatively measured in accordance with the test method described in annex H
1	F	No performance measured	No performance measured
3	H	$\leq 23 \text{ mm}$	$\leq 20\,000 \text{ mm}^3/5\,000 \text{ mm}^2$
4	I	$\leq 20 \text{ mm}$	$\leq 18\,000 \text{ mm}^3/5\,000 \text{ mm}^2$

5.3.5 Slip/skid resistance

5.3.5.1 Conditions

Concrete paving blocks have satisfactory slip/skid resistance provided that their whole upper surface has not been ground and/or polished to produce a very smooth surface.

5.3.5.2 Test method

If in an exceptional case a value for slip/skid resistance is required, the test method as described in annex I shall be used and the minimum slip/skid resistance value shall be declared.

If the surface of a block contains ridges, grooves or other surface features which prevent testing by the pendulum friction equipment, the product is deemed to satisfy the requirements of this standard without testing. Where the block is too small to provide a test area, the manufacturer shall test a larger block having the same surface finish as the block in question.

NOTE The slip/skid resistance value relates to blocks as manufactured and helps to ensure adequate slip/skid resistance on installation.

5.3.5.3 Durability of slip/skid resistance

Under normal conditions of use precast concrete blocks provide satisfactory slip/skid resistance during the working life of the product, provided they are subjected to normal maintenance and unless a major proportion of aggregates which polish excessively have been exposed on the upper face.

NOTE The development of a performance based test method for the durability of slip/skid resistance is proceeding in TC 178 WG4.

5.3.6 Fire performance

5.3.6.1 Reaction to fire

Concrete paving blocks are Class A1 reaction to fire without testing.¹⁾

¹⁾ Reference is made to the Commission Decision 96/603/EC, as amended.