



**SLOVENSKI STANDARD**  
**kSIST-TS FprCEN/TS 12201-7:2024**  
**01-julij-2024**

---

**Cevni sistemi iz polimernih materialov za oskrbo z vodo in za odvodnjavanje in kanalizacijo pod tlakom - Polietilen (PE) - 7. del: Ugotavljanje skladnosti**

Plastics piping systems for water supply, and for drains and sewers under pressure - Polyethylene (PE) - Part 7: Assessment of conformity

Kunststoff-Rohrleitungssysteme für die Wasserversorgung und für Entwässerungs- und Abwasserdruckleitungen - Polyethylen (PE) - Teil 7: Beurteilung der Konformität

Systèmes de canalisations en plastique pour l'alimentation en eau et pour les branchements et les collecteurs d'assainissement avec pression - Polyéthylène (PE) - Partie 7 : Évaluation de la conformité

**Ta slovenski standard je istoveten z: FprCEN/TS 12201-7**

<https://standards.iteh.ai/catalog/standards/sist/e058b620-d30e-4e78-8a32-ea29ff0a4519/ksist-ts-fprcen-ts-12201-7-2024>

**ICS:**

23.040.05	Cevovodi za zunanje sisteme za odpadno vodo in njihovi deli	Pipeline and its parts for external sewage systems
91.140.60	Sistemi za oskrbo z vodo	Water supply systems
93.030	Zunanji sistemi za odpadno vodo	External sewage systems

**kSIST-TS FprCEN/TS 12201-7:2024**      **en,fr,de**



TECHNICAL SPECIFICATION  
SPÉCIFICATION TECHNIQUE  
TECHNISCHE SPEZIFIKATION

**FINAL DRAFT**  
**FprCEN/TS 12201-7**

May 2024

ICS 23.040.05; 91.140.60

Will supersede CEN/TS 12201-7:2014

English Version

Plastics piping systems for water supply, and for drains  
and sewers under pressure - Polyethylene (PE) - Part 7:  
Assessment of conformity

Systèmes de canalisations en plastique pour  
l'alimentation en eau et pour les branchements et les  
collecteurs d'assainissement avec pression -  
Polyéthylène (PE) - Partie 7 : Évaluation de la  
conformité

Kunststoff-Rohrleitungssysteme für die  
Wasserversorgung und für Entwässerungs- und  
Abwasserdruckleitungen - Polyethylen (PE) - Teil 7:  
Beurteilung der Konformität

This draft Technical Specification is submitted to CEN members for Vote. It has been drawn up by the Technical Committee CEN/TC 155.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Republic of North Macedonia, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Türkiye and United Kingdom.

Recipients of this draft are invited to submit, with their comments, notification of any relevant patent rights of which they are aware and to provide supporting documentation.

**Warning** : This document is not a Technical Specification. It is distributed for review and comments. It is subject to change without notice and shall not be referred to as a Technical Specification.

[ksIST-TS FprCEN/TS 12201-7:2024](https://standards.iteh.ai/standards/sist/e058b620-d30e-4e78-8a32-ea29ff0a4519/ksist-ts-fprcen-ts-12201-7-2024)

<https://standards.iteh.ai/catalog/standards/sist/e058b620-d30e-4e78-8a32-ea29ff0a4519/ksist-ts-fprcen-ts-12201-7-2024>



EUROPEAN COMMITTEE FOR STANDARDIZATION  
COMITÉ EUROPÉEN DE NORMALISATION  
EUROPÄISCHES KOMITEE FÜR NORMUNG

**CEN-CENELEC Management Centre: Rue de la Science 23, B-1040 Brussels**

<b>Contents</b>	<b>Page</b>
European foreword.....	4
Introduction .....	5
1 Scope .....	7
2 Normative references.....	7
3 Terms and definitions .....	8
4 Abbreviated terms.....	11
5 General.....	11
6 Testing and inspection .....	12
6.1 Grouping.....	12
6.1.1 General.....	12
6.1.2 Size groups.....	12
6.1.3 Fitting groups .....	12
6.1.4 Fitting types.....	13
6.2 Type testing.....	13
6.3 Batch release testing.....	24
6.4 Process verification testing.....	29
6.5 Audit testing.....	33
6.6 Test records .....	37
6.7 One-off products and products produced in very low quantity .....	37
6.8 Mechanical fittings.....	37
6.9 Large diameter products .....	38
6.10 Documentation.....	38
6.10.1 Type test results .....	38
6.10.2 Technical file for certification purposes.....	38
Annex A (normative) Change of compound.....	39
A.1 General.....	39
A.2 Change.....	39
A.2.1 Change of base polymer.....	39
A.2.2 Change of grade.....	39
A.2.3 Change of pigment .....	39
A.2.4 Change of additives other than pigments.....	39
A.3 Type testing required for re-evaluation.....	40
A.3.1 Changes A.2.1 and A.2.3.1.....	40
A.3.2 Changes A.2.2.1, A.2.2.2, A.2.2.3, A.2.3.2, A.2.4.1, A.2.4.2 and A.2.4.3 .....	40
Annex B (normative) Testing and inspection of fabricated fittings.....	42
B.1 Grouping.....	42
B.2 Type tests.....	42

<b>B.3</b>	<b>Batch release tests.....</b>	<b>44</b>
<b>B.4</b>	<b>Process verification tests.....</b>	<b>44</b>
<b>B.5</b>	<b>Audit tests.....</b>	<b>45</b>
<b>Annex C (informative)</b>	<b>Basic test matrix for PE water compounds and piping products .....</b>	<b>46</b>
<b>Bibliography</b>	<b>.....</b>	<b>50</b>

**iTeh Standards**  
**(<https://standards.iteh.ai>)**  
**Document Preview**

[kSIST-TS FprCEN/TS 12201-7:2024](https://standards.iteh.ai/catalog/standards/sist/e058b620-d30e-4e78-8a32-ca29ff0a4519/ksist-ts-fprcen-ts-12201-7-2024)

<https://standards.iteh.ai/catalog/standards/sist/e058b620-d30e-4e78-8a32-ca29ff0a4519/ksist-ts-fprcen-ts-12201-7-2024>

**FprCEN/TS 12201-7:2024 (E)****European foreword**

This document (FprCEN/TS 12201-7:2024) has been prepared by Technical Committee CEN/TC 155 “Plastics piping systems and ducting systems”, the secretariat of which is held by NEN.

This document is currently submitted to the Vote on TS.

This document will supersede CEN/TS 12201-7:2014.

This document includes the following significant technical changes with respect to EN 12201-1, EN 12201-2, EN 12201-3, EN 12201-5 and EN 12201-4, published in 2024. Guidance for the assessment of conformity given in this document has been revised to reflect the changes made to test methods and requirements given in EN 12201-1, EN 12201-2, EN 12201-3, EN 12201-4 and EN 12201-5. PE 100-RC type materials have been added.

EN 12201 consists of the following parts, under the general title “*Plastics piping systems for water supply, and for drains and sewers under pressure — Polyethylene (PE)*”:

- EN 12201-1, *Plastics piping systems for water supply, and for drains and sewers under pressure — Polyethylene (PE) — Part 1: General*
- EN 12201-2, *Plastics piping systems for water supply, and for drains and sewers under pressure — Polyethylene (PE) — Part 2: Pipes*
- EN 12201-3, *Plastics piping systems for water supply, and for drains and sewers under pressure — Polyethylene (PE) — Part 3: Fittings*
- EN 12201-4, *Plastics piping systems for water supply, and for drains and sewers under pressure — Polyethylene (PE) — Part 4: Valves*
- EN 12201-5, *Plastics piping systems for water supply, and for drains and sewers under pressure — Polyethylene (PE) — Part 5: Fitness for purpose of the system*
- CEN/TS 12201-7, *Plastics piping systems for water supply, and for drains and sewers under pressure — Polyethylene (PE) — Part 7: Assessment of conformity*

## Introduction

This document details the applicable characteristics to be assessed for type testing (TT), batch release test (BRT), process verification test (PVT), and audit test (AT), as well as the frequency and sampling for testing.

The concept of testing and organisation of those tests used for the AoC is shown, without or with certification, in Figures 1 and 2.

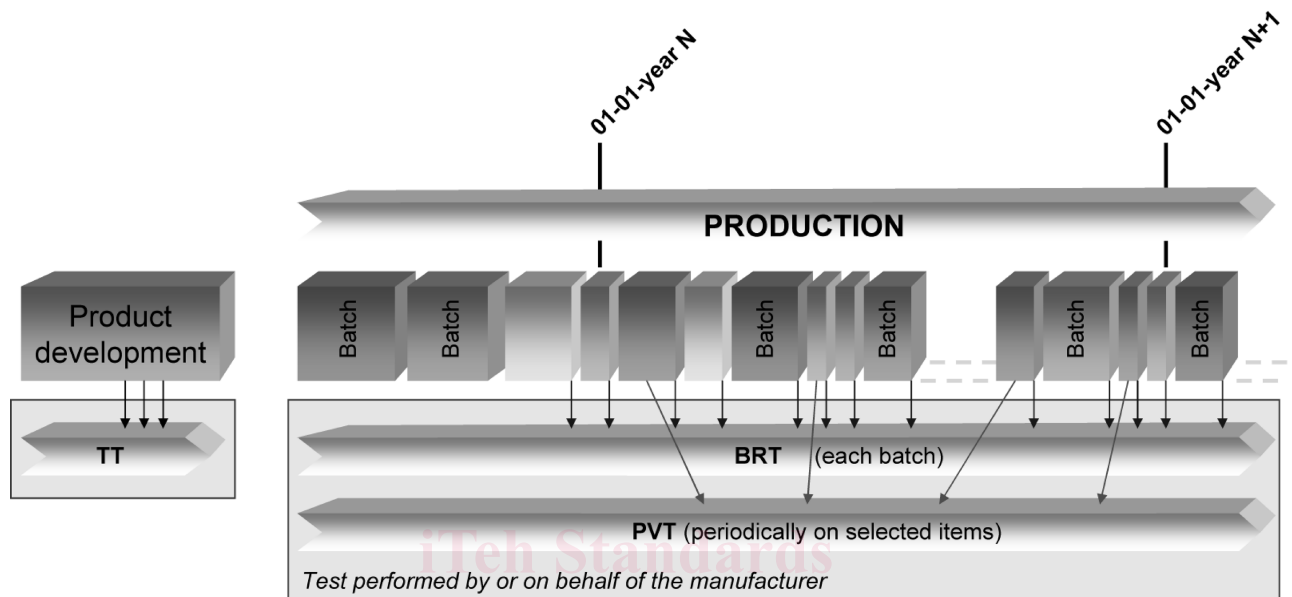


Figure 1 — Typical scheme for the AoC by a manufacturer, without certification

(<https://standards.iteh.ai>)  
Document Preview

[ksist-ts FprCEN/TS 12201-7:2024](https://standards.iteh.ai/catalog/standards/sist/e058b620-d30e-4e78-8a32-ca29ff0a4519/ksist-ts-fprcen-ts-12201-7-2024)

<https://standards.iteh.ai/catalog/standards/sist/e058b620-d30e-4e78-8a32-ca29ff0a4519/ksist-ts-fprcen-ts-12201-7-2024>

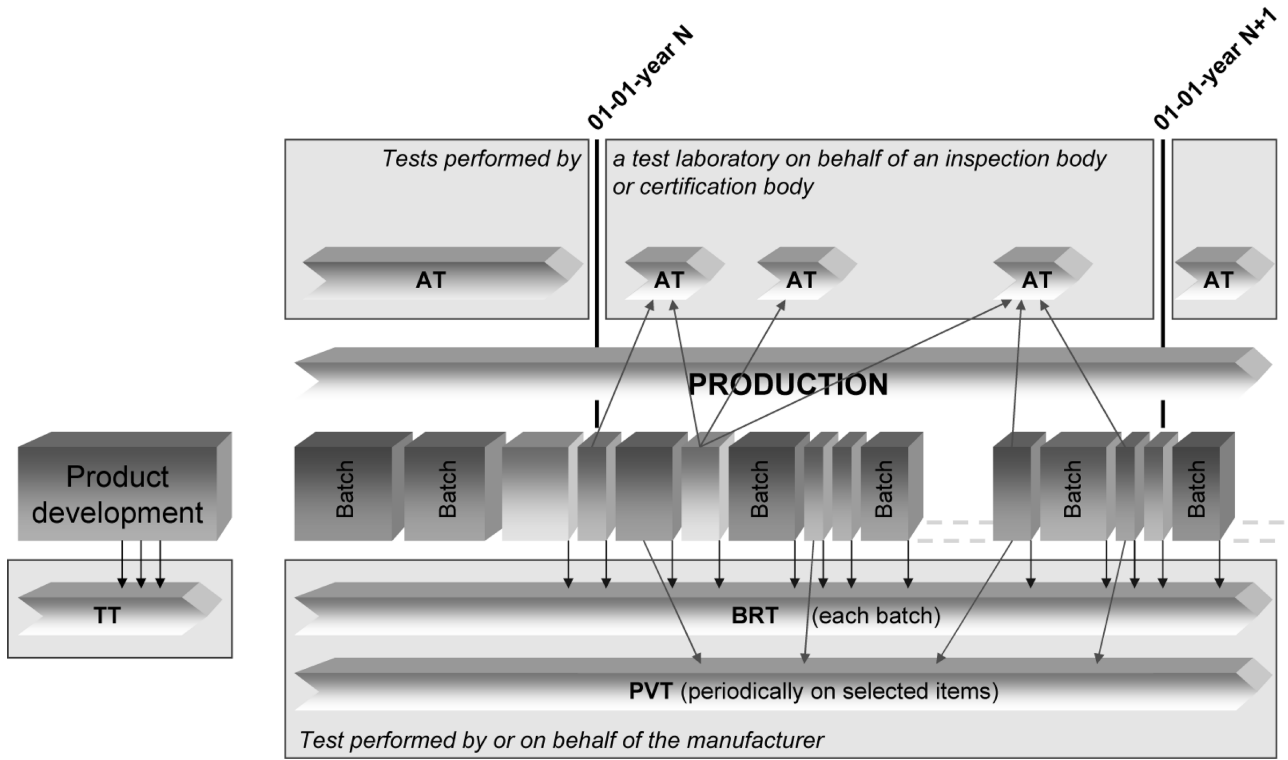


Figure 2 — Typical scheme for the AoC by a manufacturer, including certification

iTeh Standards  
 (https://standards.iteh.ai)  
 Document Preview

[ksist-ts FprCEN/TS 12201-7:2024](https://standards.iteh.ai/catalog/standards/sist/e058b620-d30e-4e78-8a32-ca29ff0a4519/ksist-ts-fprcen-ts-12201-7-2024)

<https://standards.iteh.ai/catalog/standards/sist/e058b620-d30e-4e78-8a32-ca29ff0a4519/ksist-ts-fprcen-ts-12201-7-2024>



## 1 Scope

This document gives guidance and requirements for the assessment of conformity of compounds, products, joints and assemblies in accordance with the applicable part(s) of EN 12201 intended to be included in the manufacturer's quality plan as part of the quality management system and for the establishment of certification procedures.

NOTE 1 A test matrix provides an overview of the testing scheme in Annex C, Table C.1.

NOTE 2 If certification is involved, the certification body operating in accordance with EN ISO/IEC 17065 [6] and EN ISO/IEC 17020 [4] is considered to be competent.

In conjunction with EN 12201-1, EN 12201-2, EN 12201-3, EN 12201-4 and EN 12201-5, this document is applicable to polyethylene (PE) pressure piping systems (mains and service pipes) for buried or above ground applications, intended for the conveyance of water for human consumption, raw water prior to treatment, drains and sewers under pressure, vacuum sewer systems, and water for other purposes, with the exception of industrial application. The intended use includes sea outfalls, laid in water and pipes suspended below bridges. It is applicable to PE pipes, fittings, and valves, their joints and joints with components of PE and other materials intended to be used under the following conditions:

- a) allowable operating pressure, PFA, up to 25 bar<sup>1)</sup>);
- b) an operating temperature of 20 °C as a reference temperature.

NOTE 3 Industrial application is covered by EN ISO 15494 [3].

NOTE 4 For applications operating at constant temperature greater than 20 °C and up to and including 50 °C, see EN 12201-1:2024, Annex A.

NOTE 5 It is the responsibility of the purchaser or specifier to make the appropriate selections from these aspects, taking into account their particular requirements and any relevant national guidance or regulations and installation practices or codes.

This document gives recommendations that the quality management system conforms to or is no less stringent than the relevant requirements to EN ISO 9001 [2].

## 2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 12201-1:2024, *Plastics piping systems for water supply, and for drains and sewers under pressure — Polyethylene (PE) — Part 1: General*

EN 12201-2:2024, *Plastics piping systems for water supply, and for drains and sewers under pressure — Polyethylene (PE) — Part 2: Pipes*

EN 12201-3:2024, *Plastics piping systems for water supply, and for drains and sewers under pressure — Polyethylene (PE) — Part 3: Fittings*

---

<sup>1)</sup> 1 bar = 0,1 MPa = 10<sup>5</sup> Pa; 1 MPa = 1 N/mm<sup>2</sup>

**FprCEN/TS 12201-7:2024 (E)**

EN 12201-4:2024, *Plastics piping systems for water supply, and for drains and sewers under pressure — Polyethylene (PE) — Part 4: Valves for water supply systems*

EN 12201-5:2024, *Plastics piping systems for water supply, and for drains and sewers under pressure — Polyethylene (PE) — Part 5: Fitness for purpose of the system*

ISO 17885, *Plastics piping systems — Mechanical fittings for pressure piping systems — Specifications*

ISO 21751, *Plastics pipes and fittings — Decohesion test of electrofusion assemblies — Strip-bend test*

**3 Terms and definitions**

For the purposes of this document, the terms and definitions given in EN 12201-1, EN 12201-3 and EN 12201-4 and the following apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

IEC Electropedia: available at <https://www.electropedia.org/>

ISO Online browsing platform: available at <https://www.iso.org/obp>

**3.1****certification body**

third-party conformity assessment body operating certification schemes

Note 1 to entry: A certification body can be non-governmental or governmental (with or without regulatory authority).

[SOURCE: EN ISO/IEC 17065:2012 [6], definition 3.12]

**3.2****inspection body**

organization or part of an organization that performs inspection

Note 1 to entry: An inspection body is accredited to EN ISO/IEC 17020 [4].

**3.3****laboratory**

body that performs one or more of the following activities:

- testing;
- calibration;
- sampling, associated with subsequent testing or calibration

Note 1 to entry: In the context of this document, the materials and products can be subjected to type testing, batch release testing, process verification testing, audit testing, and witness testing, as applicable.

[SOURCE: EN ISO/IEC 17025:2017 [5], definition 3.6, modified — Note 1 to entry is changed here]

**3.4****quality management system**

part of a management system with regard to quality

Note 1 to entry: Requirements for quality management systems are given in EN ISO 9001 [2].

[SOURCE: EN ISO 9000:2015 [1], definition 3.5.4, modified — Note 1 to entry is added here]

### 3.5

#### **quality plan**

document setting out the specific quality practices, responsibilities, resources and sequence of activities relevant to a particular product or range of products

### 3.6

#### **type test**

##### **TT**

test performed to prove that the material, product, joint or assembly is capable of conforming to the requirement(s) given in the relevant standard or if applicable to determine the manufacturer's declared values

Note 1 to entry: The type test results remain valid until there is a change in the material or product or assembly provided that the process verification tests are done regularly.

### 3.7

#### **batch release test**

##### **BRT**

test performed on a batch of compound or products, which has to be satisfactorily completed before the batch can be released

Note 1 to entry: A batch release test can be performed by the manufacturer or outsourced on behalf of the manufacturer.

### 3.8

#### **process verification test**

##### **PVT**

test performed by or on behalf of the manufacturer on compound or products or joints or assemblies at specific intervals to confirm that type tests originally performed continue to be valid

Note 1 to entry: Process verification tests can be performed by the manufacturer or outsourced on behalf of the manufacturer.

Note 2 to entry: Such tests are carried out as a measure of process control and are not related to release batches of compound or products.

### 3.9

#### **audit test**

##### **AT**

test performed on behalf of a certification

Note 1 to entry: Audit tests are generally required to confirm that the compound, product, joint or assembly continues to conform to the requirements given in the relevant standard and to provide information to assess the effectiveness of the quality management system.

### 3.10

#### **indirect test**

batch release test performed which differs from that specified test for that particular characteristic, having previously verified its correlation with the specified test

**FprCEN/TS 12201-7:2024 (E)**

Note 1 to entry: Indirect tests can be performed by the manufacturer or outsourced on behalf of the manufacturer.

**3.11****witness test**

type test or audit test which is performed in the presence of a representative of the certification body

**3.12****material**

generic term for compounds grouped by families, expressed by generic names

Note 1 to entry: Examples of generic names are PE, PVC-U, polypropylene and EPDM.

**3.13****material batch**

quantity of a given homogeneous compound manufactured continuously under uniform conditions defined and identified by the compound manufacturer

**3.14****product**

item as defined in the scope of the standard, e.g. pipe, fitting or valve

**3.15****product batch**

clearly identified collection of products, manufactured consecutively or continuously under the same conditions, using the same compound conforming to the same specification

Note 1 to entry: The product batch is defined and identified by the product manufacturer.

**3.16****lot**

identified sub-division of a batch for inspection purposes

**3.17****sample**

one or more components or products drawn from the same production batch or a lot, selected at random without regard to their quality

Note 1 to entry: The number of products in the sample is the sample size.

Note 2 to entry: The number of test pieces required for each test are taken from the sample. This information is given in this document, in the product standard or in the relevant test method standard.

**3.18****sampling group**

defined collection of similar products from which samples are selected for testing purposes

**3.19****component**

item manufactured or supplied as part of a product or as a spare part for that product

Note 1 to entry: Depending on the context, components can be considered as products and be individually approved (e.g. o-ring, gaskets) or they are tested as integral part of a finished product (e.g. in a valve).

**3.20****joint**

connection between two products

**3.21****assembled product**

product comprising two or more components

**3.22****assembly**

set of components that forms a product or a test piece

**3.23****product type**

generic description of a product

EXAMPLE A pipe or fitting or valve or their main parts, of the same design.

**3.24****body type**

generic description of a body

EXAMPLE A valve body of a particular design, which can have different end connections.

**3.25****cavity**

space within a mould to be filled to form the moulded product

EXAMPLE That part of an injection mould which gives the form to the injection-moulded product.

**4 Abbreviated terms**

To avoid misunderstanding, the abbreviations in this clause are defined as being the same in each language. For the same reason, the terms are given in the three languages, English, French and German.

	<b>EN</b>	<b>FR</b>	<b>DE</b>
AoC	assessment of conformity	évaluation de la conformité	Beurteilung der Konformität
AT	audit test	essai d'audit	Überwachungsprüfung
BRT	batch release test	essai de libération campagne de fabrication	de Freigabepfung einer Charge
PVT	process verification test	essai de verification procédé de fabrication	du Prozessüberprüfung
TT	type test	essai de type	Typprüfung

**5 General**

Materials, products and fitness for purpose shall conform to the requirements given in EN 12201-1, EN 12201-2, EN 12201-3, EN 12201-4, and EN 12201-5.

## FprCEN/TS 12201-7:2024 (E)

Socket fusion fittings according to EN 12201-3:2024, Annex A, and mechanical fittings according to ISO 17885 are not covered in this document. Assessment of conformity may be agreed between the manufacturer and the end user.

Materials and products shall be produced by the manufacturer under a quality management system, which includes a quality plan.

## 6 Testing and inspection

### 6.1 Grouping

#### 6.1.1 General

For the purposes of this document, the sampling groups and types specified in 6.1.2, 6.1.3 and 6.1.4 applies.

#### 6.1.2 Size groups

Five size groups are defined for pipes and fittings, as given in Table 1. For testing purposes, one individual nominal diameter,  $d_n$ , shall be selected from each group.

**Table 1 — Size groups**

Size group	Nominal diameter, $d_n$ mm
1	$d_n < 75$
2	$75 \leq d_n < 250$
3	$250 \leq d_n < 710$
4	$710 \leq d_n < 1\,800$
5	$1\,800 \leq d_n \leq 3\,000$

#### 6.1.3 Fitting groups

Four groups of fittings each having a similar design are defined, as given in Table 2. For testing purposes, one individual fitting shall be selected from each group.