



Designation: ~~F1450-10~~ Designation: F1450 - 12

Standard Test Methods for Hollow Metal Swinging Door Assemblies for Detention and Correctional Facilities¹

This standard is issued under the fixed designation F1450; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ϵ) indicates an editorial change since the last revision or reapproval.

1. Scope

1.1 These test methods cover requirements for mechanical tests, simulated service test, and testing equipment for determining the performance characteristics of swinging detention hollow metal door assemblies of various styles and types of construction for use in wall openings designed to incarcerate inmates in detention/correctional institutions.

1.2 These test methods test the capability of a swinging door assembly to prevent, delay, and frustrate escape, to limit or control access to unauthorized or secure areas, and to resist common types of vandalism.

1.3 These test methods apply primarily to detention door assemblies to and from secure areas generally found inside detention/correctional facilities, such as: day rooms, control rooms, cells, and sally ports.

1.4 The values stated in inch-pound units are to be regarded as the standard. The values given in parentheses are for information only.

1.5 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.*

2. Referenced Documents

2.1 ASTM Standards:²

F1577 Test Methods for Detention Locks for Swinging Doors

F1592 Test Methods for Detention Hollow Metal Vision Systems

F1643 Test Methods for Detention Sliding Door Locking Device Assembly

F1758 Test Methods for Detention Hinges Used on Detention-Grade Swinging Doors

F1915 Test Methods for Glazing for Detention Facilities

2.2 ANSI/NAAMM/HMMA Standard:³

ANSI/NAAMM/HMMA 863 Guide Specifications for Detention Security Hollow Metal Doors and Frames

2.3 NFPA Standard:⁴

252 Methods of Fire Tests of Door Assemblies

2.4 UL Standards:⁵

UL-10 (B) Fire Tests of Door Assemblies

UL-10 (C) Fire Tests of Door Assemblies

UL-437 Standard for Key Locks

UL-752 Bullet Resisting Equipment

UL-1034 Standard for Burglary Resistant Electric Locking Mechanisms

3. Terminology

3.1 Definitions:

3.1.1 *bolt*—metal bar which, when actuated, is projected (or thrown) either horizontally or vertically into a retaining member, such as a strike plate, to prevent a door from moving or opening.

¹ These test methods are under the jurisdiction of ASTM Committee F33 on Detention and Correctional Facilities and are the direct responsibility of Subcommittee F33.02 on Physical Barriers.

Current edition approved Nov. Jan. 1, 2010; 2012. Published April 2012. Originally approved in 1992. Last previous edition approved in 2005/2010 as F1450 - 105. DOI: 10.1520/F1450-102.

² For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

³ Available from American National Standards Institute (ANSI), 25 W. 43rd St., 4th Floor, New York, NY 10036, <http://www.ansi.org>.

⁴ Available from National Fire Protection Association (NFPA), 1 Batterymarch Park, Quincy, MA 02169-7471, <http://www.nfpa.org>.

⁵ Available from Underwriters Laboratories (UL), 333 Pfingsten Rd., Northbrook, IL 60062-2096, <http://www.ul.com>.

3.1.2 *bolt projection (or bolt throw)*—distance from the edge of the door or frame, at the bolt center line, to the farthest point on the bolt in the projected position.

3.1.3 *component*—a subassembly, as distinguished from a part, that combines with other components to make up a total door assembly.

3.1.3.1 *Discussion*—The prime components of a door assembly include the following: door, lock, hinges, wall, and door frame (includes hinge jamb, strike jamb, and header).

3.1.4 *detention security*—assurance of the restriction of mobility of inmates to designated areas within a correctional or detention facility.

3.1.5 *door assembly*—unit composed of a group of parts or components that make up an opening barrier for a passageway through a wall.

3.1.5.1 *Discussion*—For the purpose of these test methods, a door assembly consists of the following parts: door; hinges; locking device or devices; operation contacts (such as handles, knobs, or flush pulls); security glazing and glazing molding; miscellaneous hardware and closers; the frame, including the head and jambs plus anchorage devices to the surrounding wall; and a portion of the surrounding wall extending 32 in. (81.3 cm) from each side of the jambs and 16 in. (40.65 cm) above the head.

3.1.6 *forcible egress*—ability to pass a 5 × 8 × 8 in. (127 mm × 203 mm × 203 mm) rigid rectangular box through an opening in the test sample created by destructive testing procedures.

3.1.7 *frame*—assembly of members surrounding and supporting a door or doors.

~~3.1.7~~

3.1.8 *hinged door*—door equipped with hinges that permit it to swing about the vertical hinge axis, either right-hand, left-hand, right-hand reverse bevel, or left-hand reverse bevel, depending upon hardware configuration.

~~3.1.8~~

3.1.9 *hollow metal*—term used in reference to such items as doors, frames, partitions, enclosures, and other items that are fabricated from metal sheet, typically cold-rolled or hot-rolled pickled-and-oiled carbon steel.

~~3.1.9.1~~

3.1.9.1 *Discussion*—These products are internally reinforced but hollow, hence the term *hollow metal*. Typically, the voids in doors and partitions are filled with insulation. When installed in masonry walls, the voids in frame jambs, headers, and mullions may be grouted or left hollow.

~~3.1.9~~

3.1.10 *manufacturer*—party responsible for the fabrication of the test samples.

~~3.1.10~~

3.1.11 *panel*—for the purposes of these test methods, the *panel* is a steel plate at least 0.375 in. (9.5 mm), installed in order to transfer impact energy to the glazing stops and the assembly.

~~3.1.11~~

3.1.12 *performance characteristic*—response of the door assembly in any one of the tests described herein.

~~3.1.12~~

3.1.13 *test completion*—conduct of one test sequence for each of the door assemblies.

~~3.1.13~~

3.1.14 *testing laboratory*—independent materials testing laboratory not associated with the manufacturer.

4. Significance and Use

4.1 A major concern for prison administrative officials is security barriers used in detention/correctional facilities. These test methods are designed to aid in identifying levels of physical security for swinging detention hollow metal door assemblies.

4.2 The construction and size of test doors and all hardware components are representative of the application under investigation, and are the same construction and size throughout all of the tests.

4.3 These test methods are not intended to provide a measure of resistance for a door assembly subjected to attack by corrosive agents, by high-powered rifles, explosives, sawing, or other such methods. These test methods are intended to evaluate the resistance of a door assembly to violent attacks using battering devices, such as benches, bunks, or tables; by handguns up to and including .44 magnum, UL-752 Level 3; by prying devices; by devices used to deform the door and render it inoperable; and by fires started by using mattresses, books, and other flammable materials.

~~4.3~~4.4 The primary purpose or result of these test methods is to approximate the levels of abuse to which door assemblies are potentially subjected in the field. The desired result of its use is to help provide insurance of protection to the public, to facility administrative personnel, and to the inmates themselves.

~~4.4~~4.5 It is recommended that detention/correctional facility administration provide adequate training, supervision, and preventative maintenance programs to enable door assemblies to function as intended throughout the expected service life.

5. Sampling

5.1 Sample door and frame assemblies shall be constructed in accordance with 6.1.

5.2 The manufacturer shall permanently mark the test samples and retain them at the manufacturing facility for future reference for a period of at least one year from test date. Instead of test samples, the manufacturer has potential to contract with the testing

laboratory to provide a certified procedure for the construction of tested assemblies with factory follow-up service as an option (see 8.2).

5.3 Test reports shall include complete details of the test assemblies, details, photographs, or a combination thereof, of the testing apparatus, and installation instructions including templates for all items of hardware (see Section 9).

5.4 In the event of failure in one or more of the performance tests, the manufacturer shall provide another complete test sample including door, frame, and hardware assembly along with test wall where applicable. If the test is performed only on the door, as in the door rack test (7.4), only the door need be provided for retesting.

6. Specimen Preparation

6.1 Construction:

6.1.1 A total of four (4) doors, for each impact, static load, and rack test, shall be constructed as described in 6.1.2 and 6.1.3. Two of the doors shall be constructed in accordance with the door elevation described in section 6.1.2. Two of the doors shall be constructed in accordance with the door elevation described in section 6.1.3. A fifth door for rack testing only shall be constructed and tested in accordance with section 6.1.4.

6.1.2 The first door elevation (Door Elevation #1) is described as a flush door with a single narrow vision light.

6.1.2.1 The construction and size of the test door assemblies consisting of single doors, frames, and all hardware components shall be representative of the application under investigation within the following guidelines:

6.1.2.2 The same construction and size of test doors and assemblies shall apply to all tests.

6.1.2.3 Each test door shall be equipped with a 100 in.² (64 516 mm²) vision light with impact panel installed, 4 by 25 in. (102 by 635 mm) clear opening positioned generally as shown in Fig. 1.

6.1.2.4 The first door shall swing on three full mortised butt hinges and shall be locked using a door-mounted, pocket-type detention security lock with bolt size not to exceed 2 in. (51 mm) high by ¾ in. (19 mm) wide and latch bolt engagement not to exceed ⅞ in. (22.3 mm).

6.1.2.5 The second door shall swing on three full mortised butt hinges and shall be locked using a jamb-mounted security lock with bolt size not to exceed 2 in. (51 mm) high by ¾ in. (19 mm) wide and latch bolt engagement not to exceed ⅞ in. (22.3 mm).

6.1.2.6 Required results indicated in Table 1 are based upon a nominal door size of 3 by 7 ft (914 by 2133 mm).

6.1.3 The second door elevation (Door Elevation #2) is described as a vision light door with two large vision lights as shown in Fig. 2.

6.1.3.1 The construction and size of the test door assemblies consisting of single doors, frames, and all hardware components shall be representative of the application under investigation within the following guidelines:

6.1.3.2 The same construction and size of test doors and assemblies shall apply to all tests.

6.1.3.3 Each test door shall be equipped with two vision lights centered horizontally and located generally as shown in Fig. 2. The top vision light shall be a 532 in.² (343 225 mm²) vision light with impact panel installed, 19 by 28 in. (483 by 711 mm) clear opening positioned generally as shown in Fig. 2. The bottom vision light shall be a 342 in.² (220 645 mm²) vision light with impact panel installed, 19 by 18 in. (483 by 457 mm) clear opening positioned generally as shown in Fig. 2. The impact plate in the top vision panel shall be installed using face mount “Z” type or “P” type removable surface applied glazing stops as shown in Fig. 2 Section B-B or Section C-C. The impact plate in the bottom vision light shall be installed using pressed angle type removable glazing stops as shown in Fig. 2 Section A-A.

6.1.3.4 The first door shall swing on three full mortised butt hinges and shall be locked using a door-mounted, pocket-type detention security lock with bolt size not to exceed 2 in. (51 mm) high by ¾ in. (19 mm) wide and latch bolt engagement not to exceed ⅞ in. (22.3 mm).

6.1.3.5 The second door shall swing on three full mortised butt hinges and shall be locked using a jamb-mounted security lock with bolt size not to exceed 2 in. (51 mm) high by ¾ in. (19 mm) wide and latch bolt engagement not to exceed ⅞ in. (22.3 mm).

6.1.3.6 Required results indicated in Table 2 are based upon a nominal door size of 3 by 7 ft (914 by 2133 mm).

6.1.4 The third door elevation, Elevation #3 (Fig. 13), (Fig. 3), is described as a 12 ga., 0.093 in. (2.3 mm) vision light door with two large vision lights as shown in Fig. 2, with the addition of an “Edge Cut” food pass / cuff port, opening size 5 in. (127 mm) high × 14.25 in. (362 mm) long, located 36.5 in. (927 mm) from the bottom of the door to the centerline of the opening.

~~6.1.4.1 The construction and size of this test door and all hardware components shall be representative of the application under investigation, and shall be the same construction and size of test door shall be the same as that used in all other tests.~~

6.2 Impact Test Fixture:

6.2.1 The door assembly support fixture and wall shall simulate the rigidity normally provided to a door assembly in a building by the ceiling, floor, and walls. Fig. 3 Fig. 4 illustrates an acceptance fixture.

6.2.2 The fixture is designed to accommodate two test samples; however, it is permissible to construct a test fixture that accommodates one sample only, if the manufacturer so chooses.

6.2.3 *Description of the Test Wall*—The door assembly shall be mounted in a vertical wall section constructed suitably to retain the sample(s) throughout the testing procedure. Typical wall details shown in Figs. 3–Figs. 4–6–7 describe an acceptance wall. The wall specification shall be included as part of the test report.

6.3 Mounting for Impact Testing:

6.3.1 Mount the swinging doors so as to open away from the working area. Position the impact test ram opposite the door side

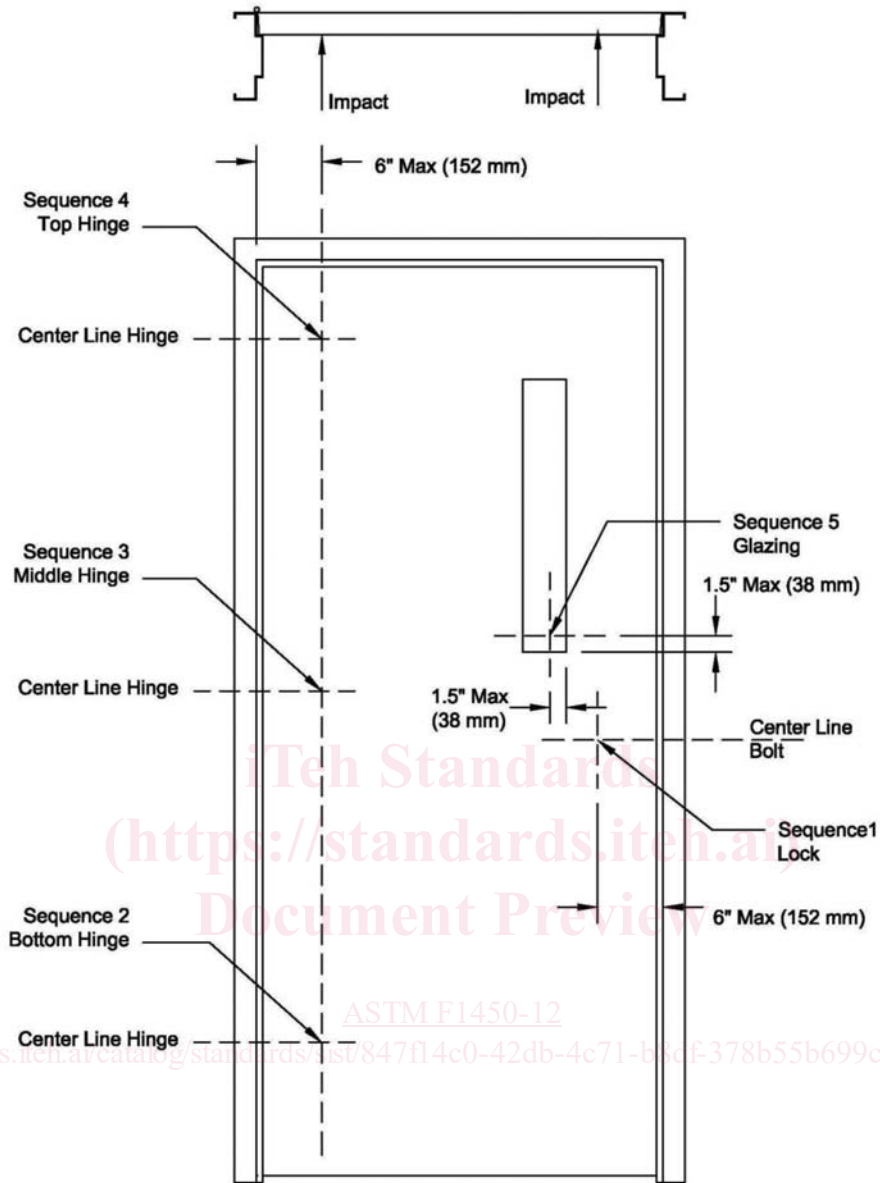


FIG. 1 Test Assembly Door Elevation #1 Location of Strike Points Described in Table 1

TABLE 1 Security Grades and Test Load Requirements Door Elevation #1^A

Grade Number (Impacts)	Recommended Door Face Sheet and Frame Thickness, in. (mm) gauge, min	Static Load Test, lbf (N)	Rack Load Test, lbf (N)	Impact Test A Impact Energy = 200 ft-lbf (271.2 J)			ASTM Reference Standards
				Lock Impacts	Hinge Impacts	Glazing/ Panel Impacts	
1 (1600 impacts 2 h 40 min)	0.093 (2.3) 12	14 000 (62 275)	7500 (33 360)	600	200	400	F1592, F1577, F1643
2 (1050 impacts 1 h 45 min)	0.093 (2.3) 12	14 000 (62 275)	7500 (33 360)	400	150	200	F1592, F1577, F1643
3 (525 impacts 53 min)	0.067 (1.7) 14	11 000 (48 930)	5500 (24 465)	200	75	100	F1592, F1577, F1643
4 (305 impacts 30 min)	0.067 (1.7) 14	11 000 (48 930)	5500 (24 465)	100	35	100	F1592, F1577, F1643

^A The cyclic sequence of impacts on the hinge side shall be 25 hits per hinge location and then moving to the next hinge location.

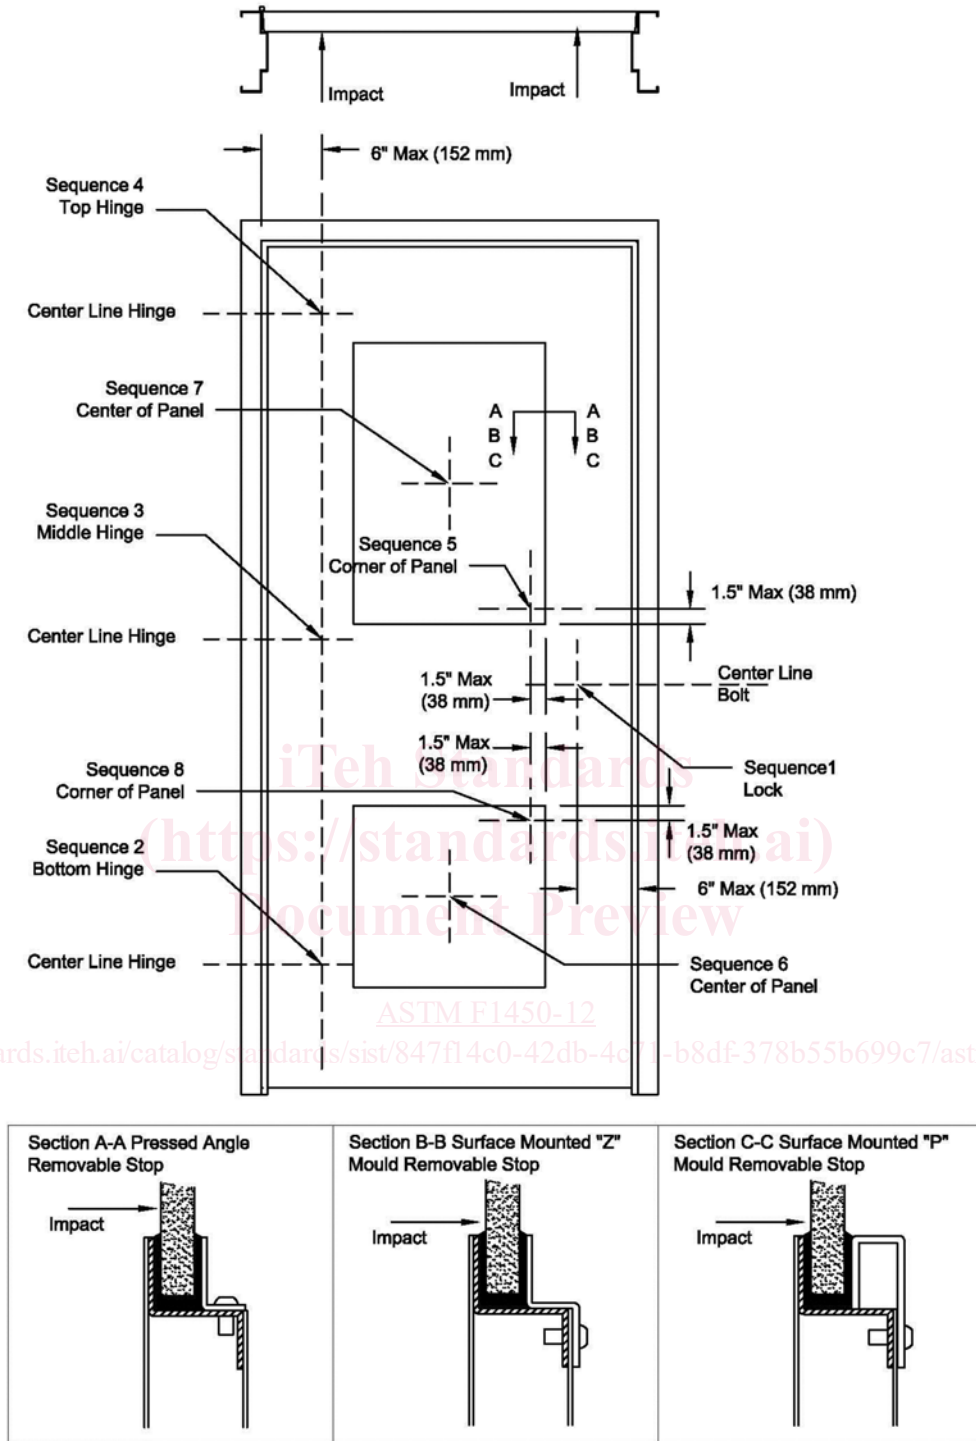


FIG. 2 Test Assembly Door Elevation #2 Location of Strike Points Described in Table 2

of the assembly so that the door opens away from the ram.

6.3.2 Prepare doors and door jambs for the installation of locksets and hinges in conformance with the hardware manufacturer's instructions and templates. Follow the hollow metal door assembly manufacturer's instructions for fastening the jamb to the support fixture described in 7.2.

6.3.3 Install components such as test doors, door frames, hinges, and hardware in the component test fixture described in 7.2. Provide clearances on the lock side, hinge side, and top of the door $\frac{1}{8}$ in. \pm $\frac{1}{16}$ in. (3.2 ± 1.5 mm) maximum. Clearance at the threshold is not considered critical in these tests.

7. Procedures

7.1 *Bullet Penetration:*

TABLE 2 Security Grades and Test Load Requirements Door Elevation #2 (Two Large Vision Lights)^A

Grade Number	Recommended Door Face Sheet and Frame Thickness, in. (mm) gauge, min	Static Load Test, lbf (N)	Rack Load Test, lbf (N)	ASTM Reference Standards
1	0.093 (2.3) 12	14 000 (62 275)	7500 (33 360)	F1592, F1577, F1643
2	0.093 (2.3) 12	14 000 (62 275)	7500 (33 360)	F1592, F1577, F1643
3	0.067 (1.7) 14	11 000 (48 930)	5500 (24 465)	F1592, F1577, F1643
4	0.067 (1.7) 14	11 000 (48 930)	5500 (24 465)	F1592, F1577, F1643

Impact Series for Door Assembly Impact Test, Door Elevation #2 (Two Large Vision Lights) ^A						
Sequence ^A	Number of Blows Grade 1	Number of Blows Grade 2	Number of Blows Grade 3	Number of Blows Grade 4	Impact Energy of Each Blow ft-lbf (J)	Location of Blows
1	600	400	200	100	200 (271.2)	Centerline of the lock bolt, 6 in. max from door edge
2	200	150	75	35	200 (271.2)	Centerline of bottom Hinge 6 in. max from door edge ^A
3	200	150	75	35	200 (271.2)	Centerline of middle Hinge 6 in. max from door edge ^A
4	200	150	75	35	200 (271.2)	Centerline of top Hinge 6 in. max from door edge ^A
5	400	200	100	100	200 (271.2)	Lower corner, nearest the lock edge, of upper glazing/ panel within 1.5 in. of the glazing stop
6	400	200	100	100	200 (271.2)	Center of lower glazing/ panel
7	400	200	100	100	200 (271.2)	Center of upper glazing/ panel
8	400	200	100	100	200 (271.2)	Upper corner, nearest lock edge, of lower glazing/ panel within 1.5 in. of the glazing stop

Total Impacts	2800	1650	825	605
Total approximate Time	4 h 40 min	2 h 45 min	1 h 25 min	1 h

^A The cyclic sequence of impacts on the hinge side shall be 25 hits per hinge location and then moving to the next hinge location.

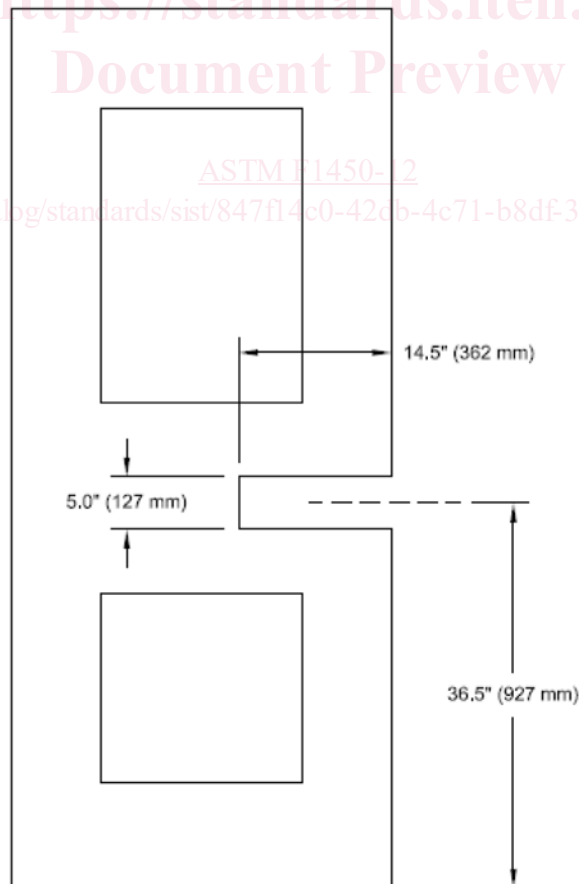


FIG. 3 Door Elevation #3