



SLOVENSKI STANDARD
SIST EN 88-3:2022+A1:2025

01-marec-2025

Nadomešča:
SIST EN 88-3:2022

**Varnostne in nadzorne naprave za plinske gorilnike in plinske aparate - 3. del:
Regulatorji tlaka in/ali regulatorji pretoka za vstopne tlake do vključno 500 kPa,
elektronski tip (vključno z dopnilom A1)**

Safety and control devices for gas burners and gas burning appliances - Part 3: Pressure and/or flow rate regulators for inlet pressures up to and including 500 kPa, electronic types

Sicherheits- und Regeleinrichtungen für Gasbrenner und Gasgeräte - Teil 3: Druck- und/oder Durchflussregler für Eingangsdrücke bis einschließlich 500 kPa, elektronische Ausführung

Dispositifs de sécurité et de contrôle pour les brûleurs à gaz et appareils utilisant des combustibles gazeux - Partie 3 : Régulateurs de pression et/ou de débit de type électronique pour pression amont inférieure ou égale à 500 kPa

Ta slovenski standard je istoveten z: EN 88-3:2022+A1:2024

ICS:

23.060.40	Tlačni regulatorji	Pressure regulators
27.060.20	Plinski gorilniki	Gas fuel burners

SIST EN 88-3:2022+A1:2025 **en,fr,de**

EUROPEAN STANDARD

EN 88-3:2022+A1

NORME EUROPÉENNE

EUROPÄISCHE NORM

November 2024

ICS 23.060.40

English Version

Safety and control devices for gas burners and gas burning appliances - Part 3: Pressure and/or flow rate regulators for inlet pressures up to and including 500 kPa, electronic types

Dispositifs de sécurité et de contrôle pour les brûleurs à gaz et appareils utilisant des combustibles gazeux - Partie 3 : Régulateurs de pression et/ou de débit de type électronique pour pression amont inférieure ou égale à 500 kPa

Sicherheits- und Regeleinrichtungen für Gasbrenner und Gasgeräte - Teil 3: Druck- und/oder Durchflussregler für Eingangsdrücke bis einschließlich 500 kPa, elektronische Ausführung

This European Standard was approved by CEN on 8 August 2022 and includes Amendment 1 approved by CEN on 3 July 2024.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN-CENELEC Management Centre or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Republic of North Macedonia, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Türkiye and United Kingdom.



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG

CEN-CENELEC Management Centre: Rue de la Science 23, B-1040 Brussels

Contents	Page
European foreword.....	5
Introduction	6
1 Scope.....	8
2 Normative references.....	8
3 Terms and definitions	9
4 Classification.....	14
4.1 Classes of control.....	14
4.2 Groups of control.....	14
4.3 Classes of control functions.....	14
4.4 Types of <i>DC</i> supplied controls	14
5 Test conditions and uncertainty of measurements.....	15
6 Design and construction.....	15
6.1 General.....	15
6.2 Mechanical parts of the control	15
6.2.1 Appearance.....	15
6.2.2 Holes	15
6.2.3 Breather holes.....	15
6.2.4 Screwed fastenings.....	16
6.2.5 Jointing.....	16
6.2.6 Moving parts	16
6.2.7 Sealing caps	16
6.2.8 Dismantling and reassembly	16
6.2.9 Auxiliary canals and orifices	16
6.2.10 Presetting device.....	16
6.2.101 Resistance to pressure.....	16
6.2.102 Signal tube connections.....	16
6.3 Materials.....	17
6.3.1 General material requirements	17
6.3.2 Housing.....	17
6.3.3 Zinc alloys	17
6.3.4 Springs	17
6.3.5 Resistance to corrosion and surface protection	17
6.3.6 Impregnation.....	17
6.3.7 Seals for glands for moving parts	17
6.4 Gas connections	17
6.4.1 Making connections.....	17
6.4.2 Connection sizes	17
6.4.3 Threads.....	17
6.4.4 Union joints	17
6.4.5 Flanges	17
6.4.6 Compression fittings.....	18
6.4.7 Nipples for pressure test	18
6.4.8 Strainers	18
6.5 Electrical parts of the control	18

6.5.1	General	18
6.5.2	Switching elements	18
6.5.3	Electrical components.....	18
6.6	Protection against internal faults for the purpose of functional safety.....	18
6.6.1	Design and construction requirements.....	18
6.6.2	Class A.....	18
6.6.3	Class B.....	18
6.6.4	Class C	18
6.6.5	Circuit and construction evaluation	18
7	Performance	19
7.1	General	19
7.2	Leak-tightness.....	19
7.2.1	Requirements.....	19
7.2.2	Tests	19
7.3	Torsion and bending	20
7.3.1	General	20
7.3.2	Torsion and bending moments.....	20
7.4	Rated flow rate	20
7.4.1	Requirement.....	20
7.4.2	Test	20
7.4.3	Conversion of air flow rate.....	21
7.5	Durability.....	21
7.6	Performance tests for electronic controls.....	21
7.7	Long-term performance for electronic controls	21
7.7.1	General	21
7.7.2	Stress test	21
7.7.3	Long-term performance test.....	21
7.8	Data exchange.....	21
7.101	Regulator performance	21
7.101.1	General	21
7.101.2	General test procedure.....	21
7.101.3	Pressure regulator performance and stability.....	23
7.101.4	Flow rate regulator performance and stability.....	24
7.101.5	Settling time	26
7.101.6	Endurance	27
7.102	Regulator performance with respect to application safety.....	28
8	Electrical requirements.....	28
8.1	General	28
8.2	Protection by enclosure	28
8.101	Plug connections.....	28
9	Electromagnetic compatibility (EMC)	29
9.1	Protection against environmental influences.....	29
9.2	Supply voltage variations below 85 % of rated voltage.....	29
9.3	Voltage dips and interruptions.....	29
9.4	Supply frequency variations.....	29
9.5	Surge immunity tests.....	29
9.6	Electrical fast transient/burst	29
9.7	Immunity to conducted disturbances induced by radio frequency fields	29
9.8	Immunity to radiated disturbances induced by radio frequency fields.....	29
9.9	Electrostatic discharge tests.....	29
9.10	Power frequency magnetic field immunity tests	29

EN 88-3:2022+A1:2024 (E)

9.11	Harmonics and interharmonics including mains signalling at a. c. power port, low frequency immunity tests	29
10	Marking, instructions	29
10.1	Marking.....	29
10.2	Instructions.....	30
10.3	Warning notice.....	31
	Annex A (informative) Abbreviations and Symbols	32
A.1	Abbreviations	32
A.2	Symbols.....	32
	Annex B (informative) Leak-tightness test for gas controls – volumetric method.....	33
	Annex C (informative) Leak-tightness test for gas controls – pressure loss method	34
	Annex D (normative) Calculation of pressure loss into leakage rate.....	35
	Annex E (normative) Electrical/electronic component fault modes.....	36
	Annex F (normative) Additional requirements for safety accessories and pressure accessories as defined in EU Directive 2014/68/EU	37
	Annex G (normative) Materials for pressurized parts.....	38
	Annex H (normative) Additional materials for pressurized parts.....	39
	Annex I (normative) Requirements for controls used in DC supplied burners and appliances burning gaseous or liquid fuels	40
	Annex J (normative) Method for the determination of a Safety integrity level (SIL)	41
	Annex K (normative) Method for the determination of a Performance Level (PL).....	42
	Annex L (informative) Relationship between Safety Integrity Level (SIL) and Performance Level (PL)	43
	Annex M (normative) Reset functions	44
	Annex N (informative) Guidance document on Environmental Aspects.....	45
	Annex O (normative) Seals of elastomer, cork and synthetic fibre mixtures.....	46
	Annex ZA (informative) Relationship between this European Standard and the essential requirements of Regulation (EU) 2016/426 aimed to be covered.....	47
	Bibliography.....	50

European foreword

This document (EN 88-3:2022+A1:2024) has been prepared by Technical Committee CEN/TC 58 “Safety and control devices for burners and appliances burning gaseous or liquid fuels”, the secretariat of which is held by BSI.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by May 2025, and conflicting national standards shall be withdrawn at the latest by November 2027.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CEN shall not be held responsible for identifying any or all such patent rights.

This document includes Amendment 1 approved by CEN on 3 July 2024.

The start and finish of text introduced or altered by amendment is indicated in the text by tags A1 A1.

This document supersedes A1 EN 88-3:2022.

This standard differs from EN 88:2022 as follows:

a) Annex ZA has been brought in line with Mandate M/595 and the normative references are updated. A1

This document has been prepared under a Standardization Request given to CEN by the European Commission and the European Free Trade Association, and supports essential requirements of EU Directive(s) / Regulation(s).

For relationship with EU Directive(s) / Regulation(s), see informative Annex ZA, which is an integral part of this document.

The EN 88 series consists of the following parts:

- EN 88-1, *Safety and control devices for gas burners and gas burning appliances — Part 1: Pressure regulators for inlet pressures up to and including 50 kPa*;
- EN 88-2, *Safety and control devices for gas burners and gas burning appliances — Part 2: Pressure regulators for inlet pressures above 50 kPa up to and including 500 kPa*;
- EN 88-3, *Safety and control devices for gas burners and gas burning appliances — Part 3: Pressure and/or flow rate regulators for inlet pressures up to and including 500 kPa, electronic types*.

Any feedback and questions on this document should be directed to the users' national standards body. A complete listing of these bodies can be found on the CEN website.

According to the CEN-CENELEC Internal Regulations, the national standards organisations of the following countries are bound to implement this European Standard: Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Republic of North Macedonia, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Türkiye and the United Kingdom.

EN 88-3:2022+A1:2024 (E)

Introduction

This document is intended to be used in conjunction with EN 13611:2019.

EN 13611:2019 recognizes the safety level specified by CEN/TC 58 and is regarded as a horizontal standard dealing with the safety, construction, performance and testing of controls for burners and appliances burning gaseous and/or liquid fuels.

The general requirements for controls are given in EN 13611:2019, and methods for classification and assessment for new controls and control functions are given in EN 14459:2021 (see Figure 1). EN 126:2012 (see Figure 1) specifies multifunctional controls combining two or more controls and Application Control Functions, one of which is a mechanical control function. The requirements for controls and Application Control Functions are given in the specific control standard (see Figure 1, control functions).

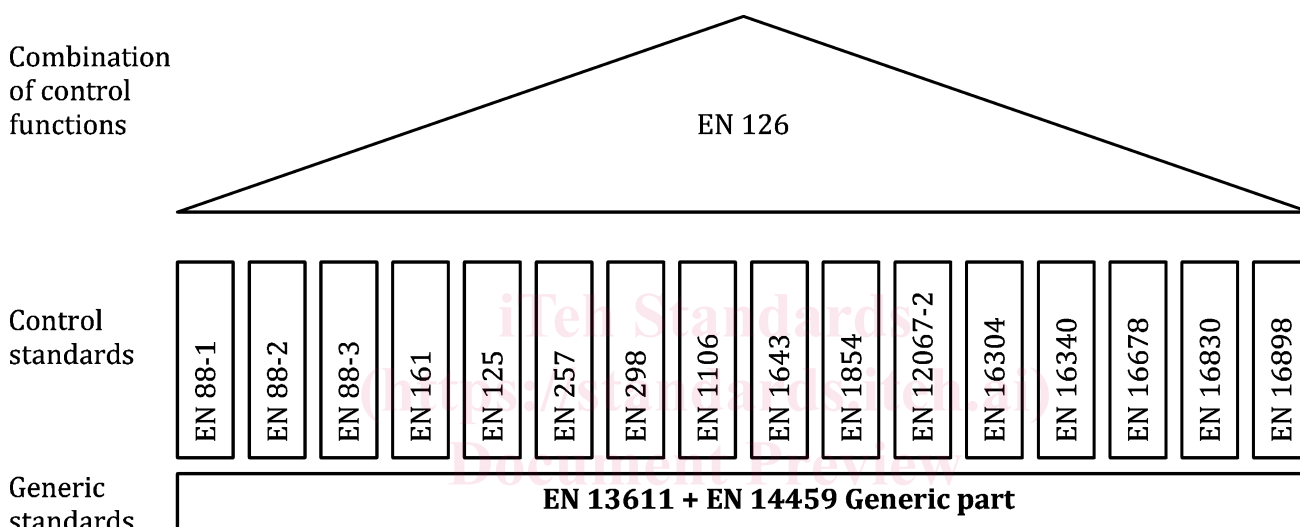


Figure 1 — Interrelation of control standards

EN 13611:2019 should be used in conjunction with the specific standard for a specific type of control (e.g. A_1 EN 88-1:2022+A1:2023 A_1 , A_1 EN 88-2:2022+A1:2024 A_1 , A_1 EN 88-3:2022+A1:2024 A_1 , A_1 EN 125:2022+A1:2024 A_1 , EN 126:2012, EN 161:2022, A_1 EN 257:2022+A1:2023 A_1 , EN 298:2022, A_1 EN 1106:2022+A1:2023 A_1 , EN 1643:2022, A_1 EN 1854:2022+A1:2023 A_1 , EN 12067-2:2022, A_1 EN 16304:2022+A1:2024 A_1 , EN 16340:2014, EN 16678:2022 and A_1 EN 16898:2022+A1:2023 A_1), or for controls for specific applications.

EN 13611:2019 can also be applied, so far as reasonable, to controls not mentioned in a specific standard and to controls designed on new principles, in which case additional requirements can be necessary. EN 14459:2021 provides methods for classification and assessment of new control principles.

Primarily in industrial applications it is common practice to rate the safety of a plant based on values describing the likelihood of a dangerous failure. These values are being used to determine Safety Integrity Levels or Performance Levels when the system is being assessed in its entirety.

CEN/TC 58 standards for safety relevant controls do go beyond this approach, because for a certain life time for which the product is specified, designed and tested a dangerous failure is not allowed at all. Failure modes are described and assessed in greater detail.

Measures to prevent from dangerous situations are defined. Field experience over many decades is reflected in the CEN/TC 58 standards. Requirements of EN 13611:2019 can be considered as proven in practice.

This document refers to clauses of EN 13611:2019 or adapts clauses by stating “with the following modification”, “with the following addition”, “is replaced by the following” or “is not applicable” in the corresponding clause.

This document adds clauses or subclauses to the structure of EN 13611:2019 which are particular to this document. Subclauses which are additional to those in EN 13611:2019 are numbered starting from 101. It should be noted that these clauses, subclauses and Annexes are not indicated as an addition.

If by reference to EN 13611:2019 the term “control” is given, this term should be read as “regulator”.

iTeh Standards
(<https://standards.iteh.ai>)
Document Preview

[SIST EN 88-3:2022+A1:2025](https://standards.iteh.ai/catalog/standards/sist/8d4edb81-30e4-44cf-8fae-c680eb3290bb/sist-en-88-3-2022a1-2025)

<https://standards.iteh.ai/catalog/standards/sist/8d4edb81-30e4-44cf-8fae-c680eb3290bb/sist-en-88-3-2022a1-2025>

EN 88-3:2022+A1:2024 (E)

1 Scope

EN 13611:2019, Clause 1 applies with the following modification and addition:

Modification:

The 1st paragraph of EN 13611:2019, Clause 1 is replaced by:

This document specifies the safety, design, construction, and performance requirements and testing for electronic pressure and/or flow rate regulators for burners and appliances burning one or more gaseous fuels, hereafter referred to as “regulators”.

This document is applicable to regulators with declared maximum inlet pressures up to and including 500 kPa and of nominal connection sizes up to and including DN 250.

Addition:

This document is applicable to:

- regulators which use auxiliary energy;
- regulators, which function by controlling a gas outlet pressure or a gas flow rate;
- regulators with a modular structure specified as a unit;
- regulators intended for gas appliances to be installed indoor or in the open air and exposed to the environment.

This document is not applicable to:

- regulators connected directly to a gas distribution network or to a container that maintains a standard distribution pressure.

The 4th paragraph of EN 13611:2019, Clause 1 is removed.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 161:2022, *Automatic shut-off valves for gas burners and gas appliances*

EN 13611:2019,¹ *Safety and control devices for burners and appliances burning gaseous and/or liquid fuels — General requirements*

EN 14459:2021, *Safety and control devices for burners and appliances burning gaseous or liquid fuels — Control functions in electronic systems — Methods for classification and assessment*

EN 175301-803:2006, *Detail Specification: Rectangular connectors — Flat contacts, 0,8 mm thickness, locking screw not detachable*

¹ As impacted by EN 13611:2019/AC:2021.

3 Terms and definitions

For the purposes of this document, the terms and definitions given in EN 13611:2019 and the following apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- ISO Online browsing platform: available at <https://www.iso.org/obp>
- IEC Electropedia: available at <https://www.electropedia.org/>

3.101

pressure regulator

device which maintains the outlet pressure constant, independent of the variations in inlet pressure and/or flow rate within defined limits

Note 1 to entry: Examples are shown in Figure 2 and Figure 3.


[SOURCE: A_1 EN 88-1:2022+A1:2023 A_1 , 3.101]

3.102

flow rate regulator

device which maintains the flow rate constant, independent of the variations in inlet pressure and/or outlet pressure within defined limits

Note 1 to entry: Examples are shown in Figure 2 and Figure 3.

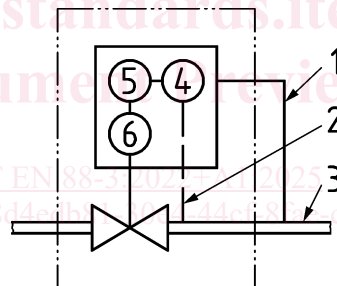


Key

- 1 rigid pipe
- 2 internal impulse line
- 3 gas line
- 4 sensing element
- 5 regulating controller including signal conditioner
- 6 actuator

Figure 2 — Illustration of the components of a pressure and/or flow rate regulator

EN 88-3:2022+A1:2024 (E)

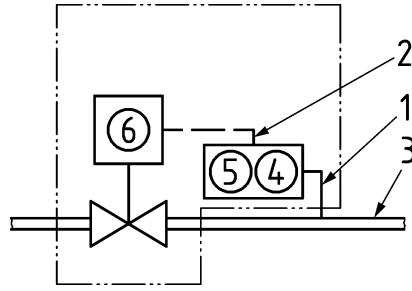**Key**

- 1 rigid pipe
- 2 wire
- 3 gas line
- 4 sensing element
- 5 regulating controller including signal conditioner
- 6 actuator

Figure 3 — Illustration of the components of a pressure and/or flow rate regulator

3.103**adjustable regulator**

regulator provided with means for changing the outlet pressure or flow rate set-point

3.104**control member**

moveable part of the regulator which varies flow rate and/or outlet pressure directly

[SOURCE: [A1](#) EN 88-1:2022+A1:2023 [A1](#), 3.107, modified – “pressure” removed]

3.105**maximum inlet pressure**

p_{1max}

highest inlet pressure, as stated in the instructions, at which the regulator can be operated

[SOURCE: [A1](#) EN 88-1:2022+A1:2023 [A1](#), 3.109, modified – “pressure” removed]

3.106**minimum inlet pressure**

p_{1min}

lowest inlet pressure, as stated in the instructions, at which the regulator can be operated

[SOURCE: [A1](#) EN 88-1:2022+A1:2023 [A1](#), 3.110, modified – “pressure” removed]

3.107**inlet pressure range**

difference between the maximum and minimum values of the inlet pressure, as stated in the instructions

[SOURCE: [A1](#) EN 88-1:2022+A1:2023 [A1](#), 3.108]

3.108**maximum outlet pressure** $p_{2\max}$

upper limit of the outlet pressure, as stated in the instructions, at which the regulator can be operated

[SOURCE: [A1](#) EN 88-1:2022+A1:2023 [A1](#), 3.111, modified – “pressure” removed]**3.109****minimum outlet pressure** $p_{2\min}$

lower limit of the outlet pressure, as stated in the instructions, at which the regulator can be operated

[SOURCE: [A1](#) EN 88-1:2022+A1:2023 [A1](#), 3.112, modified – “pressure” removed]**3.110****outlet pressure range**

difference between the maximum and minimum values of the outlet pressure, as stated in the instructions

[SOURCE: [A1](#) EN 88-1:2022+A1:2023 [A1](#), 3.113]**3.111****outlet pressure set-point** p_{2s}

outlet pressure to which the regulator is set

Note 1 to entry: p_{2s} can be an electrical signal which is equivalent to a desired pressure set-point.**3.112****maximum rated flow rate** q_{\max}

upper limit of the rated air flow rate, corrected to standard conditions, as stated in the instructions

[SOURCE: [A1](#) EN 88-1:2022+A1:2023 [A1](#), 3.116]**3.113****minimum rated flow rate** q_{\min}

lower limit of the rated air flow rate, corrected to standard conditions, as stated in the instructions

[SOURCE: [A1](#) EN 88-1:2022+A1:2023 [A1](#), 3.117]**3.114****rated flow rate range**

difference between the maximum and minimum values of the rated air flow rate, corrected to standard conditions, as stated in the instructions

3.115**rated flow rate set-point** q_s

rated flow rate to which the regulator is set

Note 1 to entry: q_s can be an electrical signal which is equivalent to a desired set flow rate set-point.

EN 88-3:2022+A1:2024 (E)**3.116****furnace pressure**

pressure of combustion gases from the combustion chamber connected to the regulator

[SOURCE: [A1](#) EN 88-1:2022+A1:2023 [A1](#), 3.126, modified – “pressure” removed]


3.117**signal connection**

connection that is used to convey pressure or flow from part of an installation to the electronic pressure or flow rate sensor (EPS)

3.118**step response**

outlet pressure or flow rate change of the regulator having a step change of the outlet pressure or flow rate set-point signal (e.g. voltage)

Note 1 to entry: For further information refer to Figure 4.

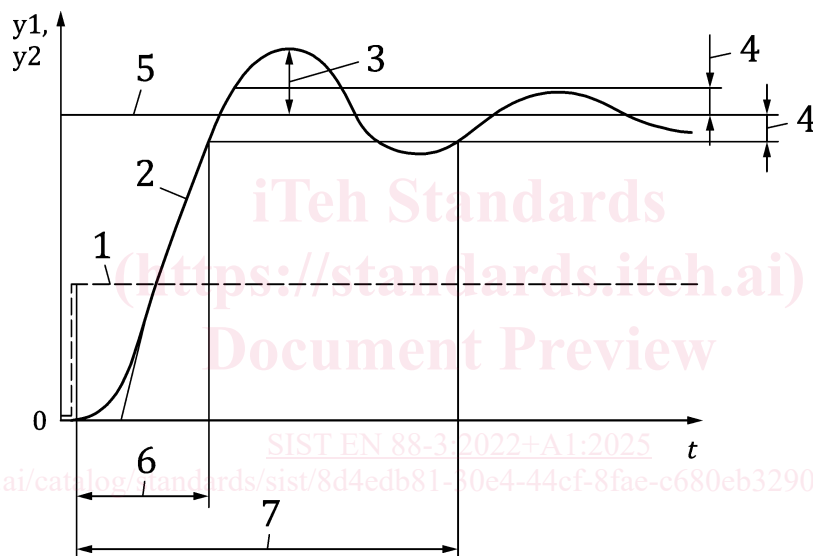**Key**

- 1 step function (y_1)
- 2 step response (y_2)
- 3 overshoot value
- 4 settling tolerance
- 5 steady-state value
- 6 response time
- 7 settling time
- t time

Figure 4 — Step response of a transfer element