
**Thermal insulating products for
building equipment and industrial
installations — Determination of
maximum service temperature**

*Produits isolants thermiques pour l'équipement du bâtiment et
les installations industrielles — Détermination de la température
maximale de service*

iTeh STANDARD PREVIEW
(standards.iteh.ai)

ISO 18097:2022

<https://standards.iteh.ai/catalog/standards/sist/c188331f-c51e-4172-bc87-24c3ad4639a5/iso-18097-2022>



iTeh STANDARD PREVIEW (standards.iteh.ai)

ISO 18097:2022

<https://standards.iteh.ai/catalog/standards/sist/c188331f-c51e-4172-bc87-24c3ad4639a5/iso-18097-2022>



COPYRIGHT PROTECTED DOCUMENT

© ISO 2022

All rights reserved. Unless otherwise specified, or required in the context of its implementation, no part of this publication may be reproduced or utilized otherwise in any form or by any means, electronic or mechanical, including photocopying, or posting on the internet or an intranet, without prior written permission. Permission can be requested from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office
CP 401 • Ch. de Blandonnet 8
CH-1214 Vernier, Geneva
Phone: +41 22 749 01 11
Email: copyright@iso.org
Website: www.iso.org

Published in Switzerland

Contents

Page

Foreword.....	iv
1 Scope.....	1
2 Normative references.....	1
3 Terms and definitions.....	1
4 Principle.....	2
5 Apparatus.....	2
6 Test specimens.....	3
6.1 Dimensions of test specimens.....	3
6.1.1 Length and width.....	3
6.1.2 Thickness.....	3
6.2 Number of test specimens.....	4
6.3 Conditioning of test specimens.....	4
7 Procedure.....	4
7.1 Test conditions.....	4
7.2 Test procedure.....	4
8 Calculation and expression of results.....	5
8.1 Thickness deformation versus time.....	5
8.2 Dimensional changes.....	5
8.3 Additional tests and/or observations.....	6
8.4 Internal self-heating.....	6
9 Accuracy of measurement.....	7
10 Test report.....	8
Annex A (normative) Modifications of and additions to the general test method for mineral wool products.....	9
Annex B (normative) Modifications of and additions to the general test method for cellular glass products.....	12
Annex C (normative) Modifications of and additions to the general test method for phenolic foam products.....	13
Annex D (normative) Modifications of and additions to the general test method for polyethylene foam (PEF) and flexible elastomeric foam (FEF) products.....	15
Bibliography.....	17

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

The procedures used to develop this document and those intended for its further maintenance are described in the ISO/IEC Directives, Part 1. In particular, the different approval criteria needed for the different types of ISO documents should be noted. This document was drafted in accordance with the editorial rules of the ISO/IEC Directives, Part 2 (see www.iso.org/directives).

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights. Details of any patent rights identified during the development of the document will be in the Introduction and/or on the ISO list of patent declarations received (see www.iso.org/patents).

Any trade name used in this document is information given for the convenience of users and does not constitute an endorsement.

For an explanation of the voluntary nature of standards, the meaning of ISO specific terms and expressions related to conformity assessment, as well as information about ISO's adherence to the World Trade Organization (WTO) principles in the Technical Barriers to Trade (TBT), see www.iso.org/iso/foreword.html.

This document was prepared by Technical Committee ISO/TC 163, *Thermal performance and energy use in the built environment*, Subcommittee SC 1, *Test and measurement methods*, in collaboration with the European Committee for Standardization (CEN) Technical Committee CEN/TC 88, *Thermal insulating materials and products*, in accordance with the Agreement on technical cooperation between ISO and CEN (Vienna Agreement).

This second edition cancels and replaces the first edition (ISO 18097:2013), which has been technically revised.

The main changes are as follows:

- EN 14706:2012 and ISO 18097:2013 have been merged into one document;
- editorial revisions.

Any feedback or questions on this document should be directed to the user's national standards body. A complete listing of these bodies can be found at www.iso.org/members.html.

Thermal insulating products for building equipment and industrial installations — Determination of maximum service temperature

1 Scope

This document specifies the equipment and procedures for determining the maximum service temperature of flat insulation products. It is applicable to thermal insulating products.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 5725-2:2019, *Accuracy (trueness and precision) of measurement methods and results — Part 2: Basic method for the determination of repeatability and reproducibility of a standard measurement method*

ISO 7884-1, *Glass — Viscosity and viscometric fixed points — Part 1: Principles for determining viscosity and viscometric fixed points*

ISO 7884-7, *Glass — Viscosity and viscometric fixed points — Part 7: Determination of annealing point and strain point by beam bending*

ISO 16544, *Thermal insulating products for building applications — Conditioning to moisture equilibrium under specified temperature and humidity conditions*

ISO 29466, *Thermal insulating products for building applications — Determination of thickness*

ISO 29768, *Thermal insulating products for building applications — Determination of linear dimensions of test specimens*

3 Terms and definitions

For the purposes of this document, the following terms and definitions apply.

ISO and IEC maintain terminology databases for use in standardization at the following addresses:

- ISO Online browsing platform: available at <https://www.iso.org/obp>
- IEC Electropedia: available at <https://www.electropedia.org/>

3.1

maximum service temperature

highest temperature at which the thermal insulation product, when installed at the recommended thickness in a given application, continues to function within specified limits of performance

Note 1 to entry: The required performance may be in the areas of dimensional stability, thermal properties and mechanical properties as well as changes in appearance and resistance against creation of hazards such as internal self-heating (see [Annexes A](#) and [C](#) and possible requirements in the relevant product standard).

Note 2 to entry: In the present test procedure, which is used as a reference, the test specimen is exposed to a temperature difference going from ambient to the maximum service temperature. This may not reflect the actual application conditions when products are exposed to different temperatures on the two main faces, e.g. in multilayer systems or for faced products where the facing may limit the maximum service temperature.

[SOURCE: ISO 9229:2020, 3.6.9.1, modified — Notes 1 and 2 to entry have been added.]

4 Principle

The thickness, length and width shall be measured after one-sided heat treatment for a specified time period, at the maximum service temperature, achieved using a specified rate of temperature increase. The thickness of the test specimen is measured during heat treatment, and the length and width only after cooling to ambient temperature.

NOTE The procedure can be an iterative process.

Additional requirements for assessing the maximum service temperature of specific materials are described in [Annexes A to D](#) or the relevant product standard or any other international technical specification.

5 Apparatus

A general arrangement of the apparatus is indicated in [Figure 1](#) and comprises:

5.1 Flat square or circular hot plate, with a uniform temperature distribution in the measuring zone on the hot face and a heat flux perpendicular to the face of the hot plate. The deviation from flatness of the hot plate shall not exceed 1 mm in the measuring zone at ambient temperature.

The hot plate shall be capable of being controlled to within ± 2 % of a predetermined temperature or ± 10 °C, whichever is smaller.

The hot plate shall be capable of being heated at 50 °C/h and/or 300 °C/h.

If a small size equipment (e.g. Ø 100 mm) is used, the free movement of the test specimen during the test is critical and shall be controlled strictly.

5.2 Edge insulation, with a gap as small as possible (e.g. ≤ 1 mm/100 mm test specimen size) which permits free movement during the test of the test specimen and of the pressure plate.


5.3 Square or circular pressure plate, with the same dimensions as the test specimen exerting the required load on the test specimen.

5.4 Device, e.g. electromechanical for measuring the thickness of the test specimen during the test to the nearest 0,1 mm.

When determining the thickness of the test specimen, the thermal movement of the apparatus (e.g. quartz rod) shall be taken into account up to the maximum service temperature.

5.5 Temperature sensors (e.g. thermocouples), capable of recording the hot plate temperature to the nearest ± 1 % in centigrade but not less than ± 1 °C, which are placed within grooves on the hot plate.

Dimensions in millimetres

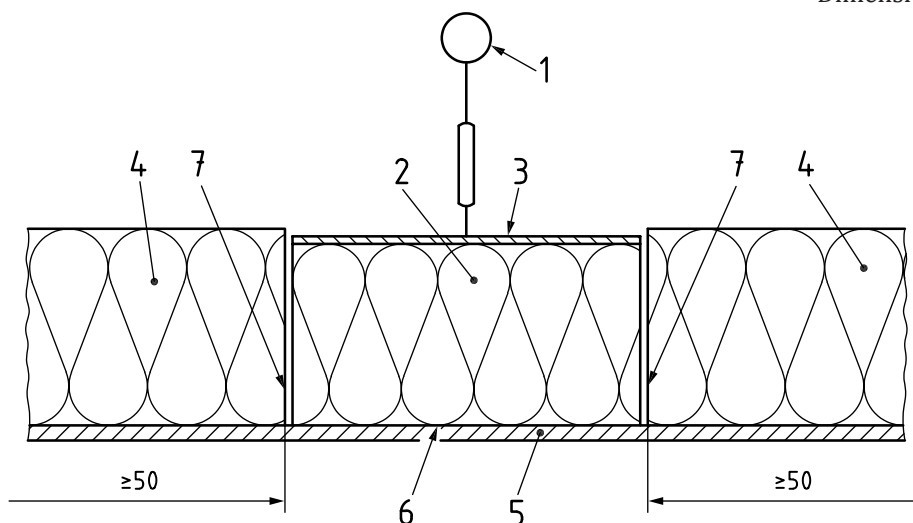

Key

- | | | | |
|---|--|---|--------------|
| 1 | device for measuring thickness,
e.g. electromechanical device | 5 | hot plate |
| 2 | test specimen | 6 | thermocouple |
| 3 | pressure plate | 7 | small gap |
| 4 | edge insulation | | |

Figure 1 — Example of an apparatus for determining maximum service temperature

6 Test specimens

6.1 Dimensions of test specimens

6.1.1 Length and width

Test specimens shall be cut as squares or cylinders (as appropriate) and the cross-section dimensions shall be as follows:

100 mm × 100 mm (or diameter 100 mm); or

150 mm × 150 mm (or diameter 150 mm); or

200 mm × 200 mm (or diameter 200 mm); or

300 mm × 300 mm (or diameter 300 mm).

The length and width or diameter shall be as specified in the relevant product standard or in [Annexes A to D](#).

6.1.2 Thickness

The thickness shall be (100 ± 5) mm prepared by slicing if needed.

NOTE 1 In the absence of a product standard or any other international technical specification, the dimensions can be agreed between parties.

NOTE 2 Testing can be performed on multilayer systems to simulate the conditions existing in the application.

6.2 Number of test specimens

The number of test specimens shall be as specified in the relevant product standard. If the number is not specified, then at least three test specimens shall be used.

NOTE In the absence of a product standard or any other international technical specification the number of test specimens can be agreed between parties.

6.3 Conditioning of test specimens

The test specimens shall be stored for at least 6 h at $(23 \pm 5) ^\circ\text{C}$. In case of dispute, they shall be stored at $(23 \pm 2) ^\circ\text{C}$ and $(50 \pm 5) \%$ relative humidity for the time specified in the relevant product standard or at least 24 h.

In tropical climates, different conditioning and testing conditions can be relevant. In this case, the conditions shall be $(27 \pm 5) ^\circ\text{C}$ and $(65 \pm 5) \%$ relative humidity.

7 Procedure

7.1 Test conditions

The initial temperature of the test specimen and the hot plate shall be $(23 \pm 5) ^\circ\text{C}$.

In tropical climates, different conditioning and testing conditions can be relevant. In this case the initial temperature of the test specimen and the hot plate shall be $(27 \pm 5) ^\circ\text{C}$.

7.2 Test procedure

Measure the length and width of the test specimen, l_1 , b_1 , (or diameter) in accordance with ISO 29768, read to the nearest 0,5 mm.

Measure the thickness of the test specimen, d_0 , in accordance with ISO 29466 using the load specified in the relevant product standard.

Install the test specimen in the apparatus ensuring contact between the test specimen and the hot plate.

Load the test specimen with a pressure of 500 Pa and record the thickness, d_1 , to the nearest 0,1 mm.

NOTE For polyethylene foam and flexible elastomeric foam products, see [Annex D](#).

Heat the test specimen using a temperature rate of increase of $50 ^\circ\text{C/h}$ or $300 ^\circ\text{C/h}$, as specified in the relevant product standard or [Annexes A](#) to [D](#).

Maintain the temperature of the hot side, at the expected maximum service temperature, for 72 h within $\pm 2 \%$ of this temperature or $\pm 10 ^\circ\text{C}$, whichever is smaller.

Record the thickness continuously during the test and at the end of the 72 h period, d_2 , to the nearest 0,1 mm.

Cool the test specimen in the equipment to a temperature of $< 35 ^\circ\text{C}$ and remeasure the thickness, d_3 , to the nearest 0,1 mm, unless otherwise specified in the relevant product standard or [Annexes A](#) to [D](#).

Take the test specimen from the apparatus and remeasure the length, l_2 , and the width, b_2 , (or diameter) of the test specimen as before, to the nearest 0,5 mm.

In the case of non-rectangular edges, this shall be taken into account when measuring l_2 and b_2 (or diameter).

Examine the test specimen visually and note any changes caused by the test.

If the relevant product standard or [Annexes A to D](#) specifies additional requirements, the observations and/or tests shall be performed accordingly.

Repeat the test procedure for the other test specimens.

8 Calculation and expression of results

8.1 Thickness deformation versus time

The curves thickness deformation versus time and temperature versus time recorded during testing shall be given. An example is shown in [Figure 2](#).

8.2 Dimensional changes

Calculate the dimensional changes of thickness, $\Delta\epsilon_d$, length, $\Delta\epsilon_l$, and width, $\Delta\epsilon_b$, in percentage, using the following equations:

$$\Delta\epsilon_d = 100 \times \frac{d_{2(or3)} - d_1}{d_1} \quad (1)$$

$$\Delta\epsilon_l = 100 \times \frac{l_2 - l_1}{l_1} \quad (2)$$

$$\Delta\epsilon_b = 100 \times \frac{b_2 - b_1}{b_1} \quad (3)$$

where

d_1 is the measured thickness installed before heating, in millimetres;

d_2 is the measured thickness installed after the 72 h at constant temperature, in millimetres;

d_3 is the measured thickness after cooling down to a temperature of < 35 °C, in millimetres;

l_1, b_1 are the measured length and width before heating, in millimetres;

l_2, b_2 are the measured length and width after the 72 h at constant temperature and after cooling down, in millimetres.

In case of circular test specimens, the diameter/diameter change is calculated instead of length and width. [Formula \(2\)](#) can be used by inserting diameter instead of length.

If the dimensional change in thickness is larger by using d_3 instead of d_2 in [Formula \(1\)](#), this thickness shall be used in the calculation of the test result.

Calculate the test result as the mean values of dimensional changes, $\overline{\Delta\epsilon_d}$, $\overline{\Delta\epsilon_l}$, $\overline{\Delta\epsilon_b}$, as a percentage rounded to the nearest 0,5 % from the test results of the individual test specimens.

If the change in the mean value (test result) for any of the dimensions exceeds the value specified in the relevant product standard, the test shall be repeated at a lower temperature until the dimensional changes are smaller than or equal to the specified value. This temperature is then considered as the maximum service temperature (see [Figure 3](#)), providing that the requirements given in [8.3](#) and [8.4](#) are also fulfilled.

The steps in centigrade for the indication of the maximum service temperature shall be as specified in the relevant product standard or in [Annexes A to D](#). If the steps are not specified, the maximum service

temperature shall be declared in steps of not less than 5 °C for temperatures up to 100 °C and in steps of not less than 10 °C for temperatures above 100 °C.

NOTE It is possible that results will not be comparable for a product tested at different thicknesses and/or different loads.

8.3 Additional tests and/or observations


The result of the visual examination shall be noted.

If a relevant annex (see Annexes A to D) and/or the relevant product standard specifies additional requirements, the calculations and/or observations shall be noted accordingly.

8.4 Internal self-heating


Evidence of internal self-heating is found when the test specimen temperature at any time during the test exceeds the temperature of the hot plate.

The test procedure is described in the relevant Annexes A to D.

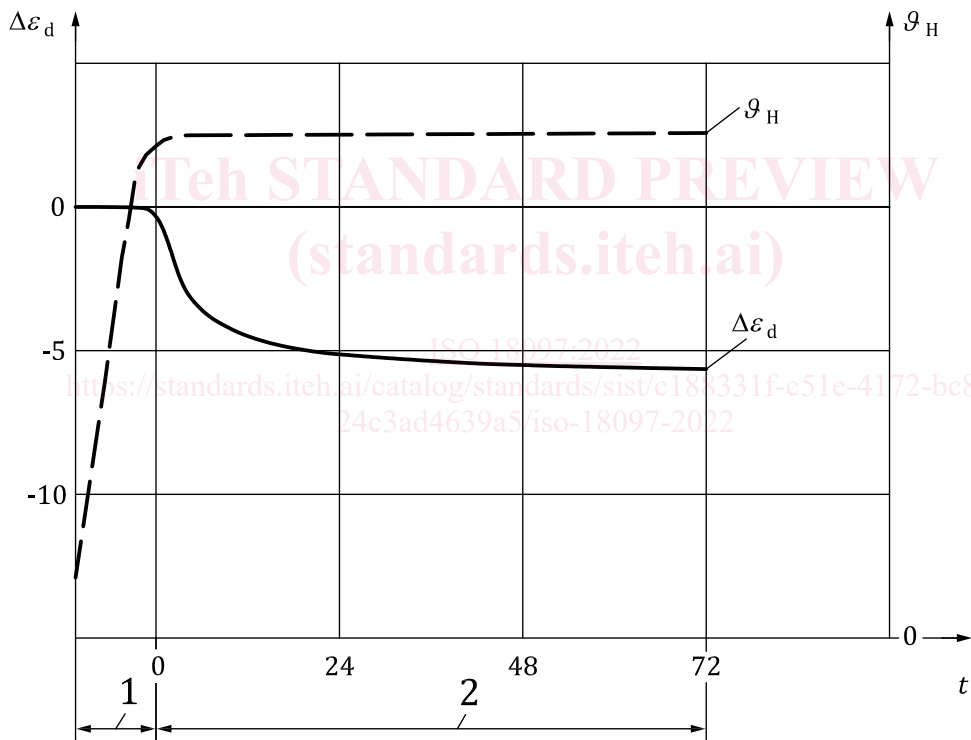

- Key**
- 1 period of heating
 - 2 period of testing
 - $\Delta \epsilon_d$ change in thickness in percentage
 - θ_H temperature of the hot plate in °C
 - t time in hours

Figure 2 — Example of hot plate temperature and thickness change versus time curves

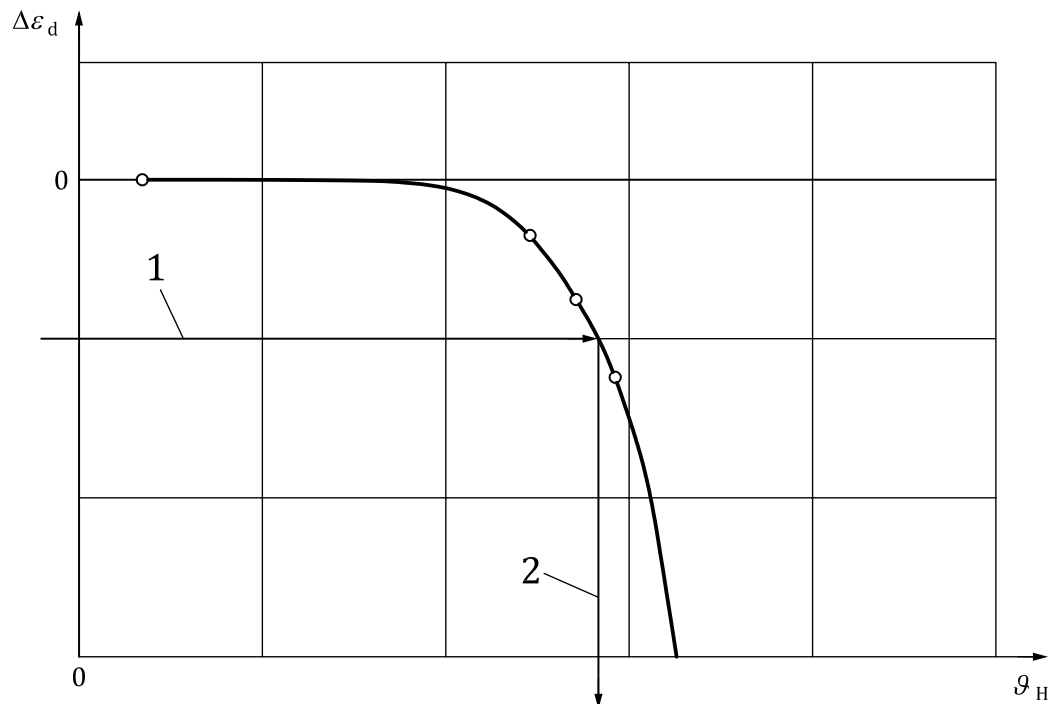

Key

- 1 maximum change of thickness according to the relevant product standard in percentage
- 2 maximum service temperature in °C
- $\Delta\epsilon_d$ change in thickness in percentage
- θ_H temperature of the hot plate in °C

Figure 3 — Example of determination of the maximum service temperature (after 72 h)

9 Accuracy of measurement

An interlaboratory test was performed with ten pieces of equipment from seven laboratories. Two products were tested.

The results, analysed according to ISO 5725-2:2019, are given in [Table 1](#).

**Table 1 — Relative change of thickness at a chosen temperature
(equipment verification in comparative testing)**

Temperature levels used °C	340 and 690 °C
Estimate of repeatability standard deviation s_r	0,1 %
95 % repeatability limit	0,4 %
Estimate of reproducibility standard deviation s_R	0,3 %
95 % reproducibility limit	0,9 %

All values given in [Table 1](#) are expressed in percentage of the test specimen thickness.

The above-mentioned terms shall be applied as described in ISO 5725-2:2019.

Bias cannot be determined in this test method as there is not any accepted reference material for it.

NOTE The choice of products was made to get a wide range of temperatures and also test a worst-case situation (for the most complicated test specimen preparation, see [Figure A.1](#)).