

FINAL
DRAFT

INTERNATIONAL
STANDARD

ISO/IEC
FDIS
22237-2

ISO/IEC JTC 1/SC 39

Secretariat: ANSI

Voting begins on:
2023-11-09

Voting terminates on:
2024-01-04

Information technology — Data centre facilities and infrastructures —

Part 2: Building construction

Technologie de l'information — Installation et infrastructures de centres de traitement de données —

Partie 2: Construction des bâtiments

iteh Standards
(<https://standards.iteh.ai>)
Document Preview

<https://standards.iteh.ai>
ISO/IEC FDIS 22237-2

<https://standards.iteh.ai/catalog/standards/sist/1c2909b6-f852-4e97-bd50-7df9b1b7da8a/iso-iec-fdis-22237-2>

RECIPIENTS OF THIS DRAFT ARE INVITED TO SUBMIT, WITH THEIR COMMENTS, NOTIFICATION OF ANY RELEVANT PATENT RIGHTS OF WHICH THEY ARE AWARE AND TO PROVIDE SUPPORTING DOCUMENTATION.

IN ADDITION TO THEIR EVALUATION AS BEING ACCEPTABLE FOR INDUSTRIAL, TECHNOLOGICAL, COMMERCIAL AND USER PURPOSES, DRAFT INTERNATIONAL STANDARDS MAY ON OCCASION HAVE TO BE CONSIDERED IN THE LIGHT OF THEIR POTENTIAL TO BECOME STANDARDS TO WHICH REFERENCE MAY BE MADE IN NATIONAL REGULATIONS.



Reference number
ISO/IEC FDIS 22237-2:2023(E)

© ISO/IEC 2023

iTeh Standards
(<https://standards.iteh.ai>)
Document Preview

[ISO/IEC FDIS 22237-2](https://standards.iteh.ai/catalog/standards/sist/1c2909b6-f852-4e97-bd50-7df9b1b7da8a/iso-iec-fdis-22237-2)

<https://standards.iteh.ai/catalog/standards/sist/1c2909b6-f852-4e97-bd50-7df9b1b7da8a/iso-iec-fdis-22237-2>



COPYRIGHT PROTECTED DOCUMENT

© ISO/IEC 2023

All rights reserved. Unless otherwise specified, or required in the context of its implementation, no part of this publication may be reproduced or utilized otherwise in any form or by any means, electronic or mechanical, including photocopying, or posting on the internet or an intranet, without prior written permission. Permission can be requested from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office
CP 401 • Ch. de Blandonnet 8
CH-1214 Vernier, Geneva
Phone: +41 22 749 01 11
Email: copyright@iso.org
Website: www.iso.org

Published in Switzerland

Contents

	Page
Foreword.....	vi
Introduction.....	viii
1 Scope.....	1
2 Normative references.....	1
3 Terms, definitions and abbreviated terms.....	2
3.1 Terms and definitions.....	2
3.2 Abbreviated terms.....	3
4 Conformance.....	3
5 Location.....	3
5.1 Assessment of location.....	3
5.1.1 Requirements.....	3
5.1.2 Recommendations.....	4
5.2 Geographical location.....	4
5.2.1 Requirements.....	4
5.2.2 Recommendations.....	4
5.3 Environmental risk analysis.....	4
5.3.1 General.....	4
5.3.2 Natural environment.....	4
5.3.3 Adjacencies (e.g. human-made environment).....	5
5.4 Utility provision.....	6
5.4.1 Requirements.....	6
5.4.2 Recommendations.....	6
6 Site configuration.....	6
6.1 General.....	6
6.2 Site selection.....	6
6.2.1 Requirements.....	6
6.2.2 Recommendations.....	7
6.3 Assessment of existing premises.....	7
6.3.1 Requirements.....	7
6.3.2 Recommendations.....	7
6.4 Utilities.....	7
6.4.1 General.....	7
6.4.2 Requirements.....	8
6.4.3 Recommendations.....	8
7 Outside spaces.....	8
7.1 Access routes.....	8
7.1.1 Requirements.....	8
7.1.2 Recommendations.....	8
7.2 Parking.....	9
7.2.1 Requirements.....	9
7.2.2 Recommendations.....	9
7.3 Temporary facilities.....	9
7.3.1 Requirements.....	9
7.3.2 Recommendations.....	9
7.4 Fuel storage facilities and infrastructure.....	10
7.4.1 Requirements.....	10
7.4.2 Recommendations.....	10
7.5 Underground facilities.....	10
7.5.1 Requirements.....	10
7.5.2 Recommendations.....	10
7.6 Perimeter design and Protection Class boundaries.....	10
7.6.1 General.....	10

7.6.2	Free-standing barriers	11
7.6.3	Protection Class 1	12
7.6.4	Protection Class 2	13
7.6.5	Protection Class 3	13
7.6.6	Protection Class 4	13
8	Building construction	13
8.1	Load-bearing structure	13
8.1.1	Requirements	13
8.1.2	Recommendations	14
8.2	Building materials and finishes	14
8.2.1	Requirements	14
8.2.2	Recommendations	14
8.3	Electromagnetic interference	14
8.4	Protection Class boundaries	15
8.4.1	General	15
8.4.2	Protection Class 1	15
8.4.3	Protection Class 2	15
8.4.4	Protection Class 3	15
8.4.5	Protection Class 4	16
8.5	Foundations	16
8.5.1	Requirements	16
8.5.2	Recommendations	17
8.6	Exterior walls	17
8.6.1	Requirements	17
8.6.2	Recommendations	17
8.7	Interior walls and barriers	17
8.7.1	Requirements	17
8.7.2	Recommendations	18
8.8	Roofs	18
8.8.1	Requirements	18
8.8.2	Recommendations	19
8.9	Water drainage	19
8.9.1	Requirements	19
8.9.2	Recommendations	19
8.10	Floors	19
8.10.1	Requirements	19
8.10.2	Recommendations	20
8.11	Raised access floors	20
8.11.1	Requirements	20
8.11.2	Recommendations	21
8.12	Ceilings	21
8.12.1	Requirements	21
8.12.2	Recommendations	21
8.13	Corridors and doors	21
8.13.1	Requirements	21
8.13.2	Recommendations	22
8.14	Transportation lifts	22
8.14.1	Requirements	22
8.14.2	Recommendations	22
9	Design of data centre spaces	22
9.1	Accommodation	22
9.1.1	General	22
9.1.2	Requirements	23
9.1.3	Recommendations	23
9.2	Control room space	23
9.3	Computer room space	23
9.3.1	Requirements	23

9.3.2	Recommendations.....	24
9.4	Electrical space.....	24
9.4.1	Requirements.....	24
9.4.2	Recommendations.....	24
9.5	Mechanical space.....	24
9.5.1	Requirements.....	24
9.5.2	Recommendations.....	24
9.6	Telecommunications space.....	24
9.7	Spaces for firefighting systems.....	24
9.7.1	General.....	24
9.7.2	Requirements.....	25
9.7.3	Recommendations.....	25
9.8	Storage space.....	25
9.8.1	Requirements.....	25
9.8.2	Recommendations.....	25
9.9	Testing and holding spaces.....	25
9.10	Docking bay.....	25
9.10.1	Requirements.....	25
9.10.2	Recommendations.....	26
9.11	General office space.....	26
10	Construction of data centre spaces.....	26
10.1	Protection against flooding.....	26
10.1.1	Requirements.....	26
10.1.2	Recommendations.....	26
10.2	Access to data centre spaces.....	26
10.2.1	Requirements.....	26
10.2.2	Recommendations.....	26
10.3	Vapour density.....	26
10.3.1	Requirements.....	26
10.3.2	Recommendations.....	27
11	Fire compartments and fire barriers.....	27
11.1	Fire compartments.....	27
11.1.1	Requirements.....	27
11.1.2	Recommendations.....	27
11.2	Fire barriers.....	28
11.2.1	Requirements.....	28
11.2.2	Recommendations.....	29
11.3	Protection Class boundaries.....	29
11.3.1	General.....	29
11.3.2	Protection Class 1.....	29
11.3.3	Protection Class 2.....	29
11.3.4	Protection Class 3.....	29
11.3.5	Protection Class 4.....	29
	Annex A (informative) Building materials.....	30
	Annex B (informative) Summary of data centre location requirements and recommendations of Clause 5.....	32
	Bibliography.....	35

Foreword

ISO (the International Organization for Standardization) and IEC (the International Electrotechnical Commission) form the specialized system for worldwide standardization. National bodies that are members of ISO or IEC participate in the development of International Standards through technical committees established by the respective organization to deal with particular fields of technical activity. ISO and IEC technical committees collaborate in fields of mutual interest. Other international organizations, governmental and non-governmental, in liaison with ISO and IEC, also take part in the work.

The procedures used to develop this document and those intended for its further maintenance are described in the ISO/IEC Directives, Part 1. In particular, the different approval criteria needed for the different types of document should be noted. This document was drafted in accordance with the editorial rules of the ISO/IEC Directives, Part 2 (see www.iso.org/directives or www.iec.ch/members_experts/refdocs).

ISO and IEC draw attention to the possibility that the implementation of this document may involve the use of (a) patent(s). ISO and IEC take no position concerning the evidence, validity or applicability of any claimed patent rights in respect thereof. As of the date of publication of this document, ISO and IEC had not received notice of (a) patent(s) which may be required to implement this document. However, implementers are cautioned that this may not represent the latest information, which may be obtained from the patent database available at www.iso.org/patents and <https://patents.iec.ch>. ISO and IEC shall not be held responsible for identifying any or all such patent rights.

Any trade name used in this document is information given for the convenience of users and does not constitute an endorsement.

For an explanation of the voluntary nature of standards, the meaning of ISO specific terms and expressions related to conformity assessment, as well as information about ISO's adherence to the World Trade Organization (WTO) principles in the Technical Barriers to Trade (TBT) see www.iso.org/iso/foreword.html. In the IEC, see www.iec.ch/understanding-standards.

This document was prepared by Joint Technical Committee ISO/IEC JTC 1, *Information technology*, Subcommittee SC 39, *Sustainability, IT and data centres*.

This first edition cancels and replaces ISO/IEC TS 22237-2:2018, which has been technically revised.

The main changes are as follows:

- the document has been restructured;
- the interrelationship between this document and ISO/IEC 22237-6 concerning constructional prerequisites for the implementation of security concepts and desired security systems has been more clearly presented;
- [Clause 6](#), “Site configuration”, has been split and relevant subclauses have been moved into a new [Clause 7](#), “Outside spaces”;
- [Clause 7](#), “Building construction”, has been completely reworked to present all requirements and recommendations in a single [Clause 8](#);
- [Clause 8](#), “Data centre spaces and access routes”, has been revised to focus on the design of data centre spaces (now [Clause 9](#));
- a new [Clause 10](#), “Construction of data centre spaces”, has been added;
- the content of [Clause 9](#), “Fire compartments, fire barriers and fire suppression systems”, has been revised (now [Clause 11](#));
- [Annex A](#) on additional requirements and recommendations has been removed;

- [Annex B](#) on physical protection against external hazards has been revised as [Annex A](#) “Building materials”;
- a new [Annex B](#) summarizing the requirements and recommendations of [Clause 5](#) has been added.

A list of all parts in the ISO/IEC 22237 series can be found on the ISO and IEC websites.

Any feedback or questions on this document should be directed to the user’s national standards body. A complete listing of these bodies can be found at www.iso.org/members.html and www.iec.ch/national-committees.

iTeh Standards
(<https://standards.itih.ai>)
Document Preview

[ISO/IEC FDIS 22237-2](#)

<https://standards.itih.ai/catalog/standards/sist/1c2909b6-f852-4e97-bd50-7df9b1b7da8a/iso-iec-fdis-22237-2>

Introduction

The unrestricted access to internet-based information demanded by the information society has led to an exponential growth of both internet traffic and the volume of stored/retrieved data. Data centres house and support the information technology and network telecommunications equipment for data processing, data storage and data transport. They are required both by network operators (delivering those services to customer premises) and by enterprises within those customer premises.

Data centres need to provide modular, scalable and flexible facilities and infrastructures to easily accommodate the rapidly changing requirements of the market. In addition, the energy consumption of data centres has become critical, both from an environmental point of view (reduction of carbon footprint), and with respect to economic considerations (cost of energy) for the data centre operator.

The implementation of data centres varies in terms of:

- a) purpose (enterprise, co-location, co-hosting or network operator facilities);
- b) security level;
- c) physical size; and
- d) accommodation (mobile, temporary and permanent constructions).

NOTE Cloud services can be provided by all data centre types mentioned.

The needs of data centres also vary in terms of availability of service, the provision of security, and the objectives for energy efficiency. These needs and objectives influence the design of data centres in terms of building construction, power distribution, environmental control, telecommunications cabling and physical security. Effective management and operational information are required to monitor achievement of the defined needs and objectives.

The ISO/IEC 22237 series specifies requirements and recommendations to support the various parties involved in the design, planning, procurement, integration, installation, operation and maintenance of facilities and infrastructures within data centres. These parties include:

- 1) owners, operators, facility managers, ICT managers, project managers and main contractors;
- 2) consultants, architects, building designers and builders, system/installation designers, auditors, test and commissioning agents;
- 3) suppliers of equipment; and
- 4) installers and maintainers.

The inter-relationship of the various documents within the ISO/IEC 22237 series at the time of publication is shown in [Figure 1](#).

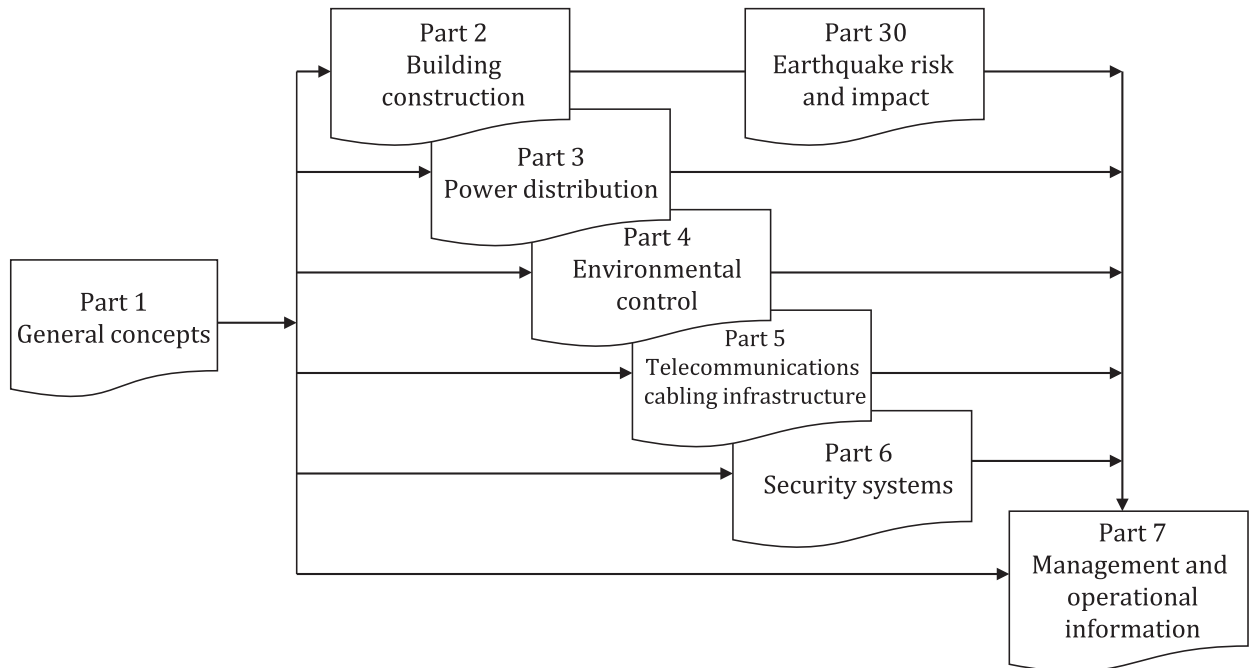


Figure 1 — Schematic relationship between the documents of the ISO/IEC 22237 series

ISO/IEC 22237-2 to ISO/IEC 22237-6 specify requirements and recommendations for particular facilities and infrastructures to support the relevant classification for “availability”, “physical security” and “energy efficiency enablement”, according to ISO/IEC 22237-1.

This document, ISO/IEC 22237-2, addresses the building design of data centres. It addresses physical security issues from a construction point of view, as opposed to ISO/IEC 22237-6, which specifies the pertinent security system requirements of those facilities and infrastructures (in accordance with the requirements of ISO/IEC 22237-1).

ISO/IEC TS 22237-7 addresses the operational and management information (in accordance with the requirements of ISO/IEC 22237-1).

This document is intended for use by and collaboration between architects, building designers and builders, system and installation designers.

The ISO/IEC 22237 series does not address the selection of information technology and network telecommunications equipment, software and associated configuration issues.

Information technology — Data centre facilities and infrastructures —

Part 2: Building construction

1 Scope

This document specifies requirements and recommendations for the construction of buildings and other structures which provide accommodation for data centres based on the criteria and classification for “physical security” within ISO/IEC 22237-1 in support of availability.

This document specifies requirements and recommendations for the following:

- a) location and site selection (taking in to account natural environment and adjacencies);
- b) protection from environmental risks;
- c) site configuration;
- d) building construction;
- e) building configuration;
- f) provision of access;
- g) physical intrusion protection;
- h) physical fire protection;
- i) protection against damage from water;
- j) quality construction measures.

Safety and electromagnetic compatibility (EMC) requirements are outside the scope of this document and are covered by other standards and regulations. However, information given in this document can be of assistance in meeting these standards and regulations.

Conformance of data centres to the present document is covered in [Clause 4](#).

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO/IEC 22237-1, *Information technology — Data centre facilities and infrastructures — Part 1: General concepts*

ISO/IEC 22237-3, *Information technology — Data centre facilities and infrastructures — Part 3: Power distribution*

ISO/IEC 22237-4, *Information technology — Data centre facilities and infrastructures — Part 4: Environmental control*

ISO/IEC 22237-6, *Information technology — Data centre facilities and infrastructures — Part 6: Security systems*

ISO/IEC 30129, *Information technology — Telecommunications bonding networks for buildings and other structures*

IEC 62305-3, *Protection against lightning – Part 3: Physical damage to structures and life hazard*

ISO/IEC TS 22237-5, *Information technology — Data centre facilities and infrastructures — Part 5: Telecommunications cabling infrastructure*

ISO/IEC TS 22237-7, *Information technology — Data centre facilities and infrastructures — Part 7: Management and operational information*

ISO/IEC TS 22237-30, *Information technology — Data centre facilities and infrastructures — Part 30: Earthquake risk and impact analysis*

3 Terms, definitions and abbreviated terms

3.1 Terms and definitions

For the purposes of this document, the terms and definitions given in ISO/IEC 22237-1 and the following apply.

ISO and IEC maintain terminology databases for use in standardization at the following addresses:

- ISO Online browsing platform: available at <https://www.iso.org/obp>
- IEC Electropedia: available at <https://www.electropedia.org/>

3.1.1

effective height of free-standing barrier

h_e

shortest distance between any point on the top of the permanent part of the free-standing barrier (excluding any toppings) and the surface of the supporting ground when measured in the plane of the barrier

3.1.2

free-standing barrier

wall, fence, gate, turnstile or other similar self-supporting barrier, and their associated foundations, designed to prevent entry to a space of a given Protection Class

3.1.3

topping

construction, added to the top of a free-standing barrier, and designed to be an effective intruder-deterrent or for a decorative display of security

3.1.4

pathway

defined route of different media between identified points

Note 1 to entry: Examples of media are bus bars, cables, conduits, ducts, pipes.

3.1.5

raised access floor

system consisting of completely removable and interchangeable floor panels that are supported on an adjustable substructure to allow the area beneath the raised access floor panels to be used by building services