



**Designation: C140 – 13**

# Standard Test Methods for Sampling and Testing Concrete Masonry Units and Related Units<sup>1</sup>

This standard is issued under the fixed designation C140; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reappraisal. A superscript epsilon ( $\epsilon$ ) indicates an editorial change since the last revision or reappraisal.

## 1. Scope\*

1.1 These test methods provide various testing procedures commonly used for evaluating characteristics of concrete masonry units and related concrete units. Methods are provided for sampling, measurement of dimensions, compressive strength, absorption, unit weight (density), moisture content, flexural load, and ballast weight. Not all methods are applicable to all unit types, however.

1.2 Specific testing and reporting procedures are included in annexes to these test methods for the following specific unit types:

- Annex A1**—Concrete masonry units (Specifications **C90**, **C129**)
- Annex A2**—Concrete and calcium silicate brick (Specifications **C55**, **C73**, **C1634**)
- Annex A3**—Segmental retaining wall units (Specification **C1372**)
- Annex A4**—Concrete interlocking paving units (Specification **C936/C936M**)
- Annex A5**—Concrete grid paving units (Specification **C1319**)
- Annex A6**—Concrete roof pavers (Specification **C1491**)
- Annex A7**—Dry-cast articulating concrete block (Specification **D6684**)

1.3 The test procedures included in these test methods are also applicable to other types of units not referenced in these test methods, but specific testing and reporting requirements for those units are not included.

1.4 These test methods include the following sections:

	Section
Scope	1
Referenced Documents	2
Terminology	3
Significance and Use	4
Sampling	5
Measurement of Dimensions	6
Compressive Strength	7
Absorption	8
Calculations	9
Report	10
Keywords	11

<sup>1</sup> These test methods are under the jurisdiction of ASTM Committee **C15** on Manufactured Masonry Units and are the direct responsibility of Subcommittee **C15.03** on Concrete Masonry Units and Related Units.

Current edition approved March 15, 2013. Published April 2013. Originally approved in 1938. Last previous edition approved in 2012 as C140 – 12a. DOI: 10.1520/C0140-13.

	Section
Annexes—Test Procedures	
Concrete Masonry Units	<b>Annex A1</b>
Concrete and Calcium Silicate Brick	<b>Annex A2</b>
Segmental Retaining Wall Units	<b>Annex A3</b>
Concrete Interlocking Paving Units	<b>Annex A4</b>
Concrete Grid Paving Units	<b>Annex A5</b>
Concrete Roof Pavers	<b>Annex A6</b>
Dry-Cast Articulating Concrete Block	<b>Annex A7</b>
Determining Plate Thickness Requirements for Compression Testing	<b>Annex A8</b>
Worksheet and Test Report for Concrete Masonry Units	<b>Appendix X1</b>

**NOTE 1**—The testing laboratory performing these test methods should be evaluated in accordance with Practice **C1093**.

1.5 The values stated in inch-pound units are to be regarded as the standard, except in **Annex A4**, where either SI units or inch-pound units are to be regarded separately as standard. The values given in parentheses throughout are mathematical conversions to SI units that are provided for information only and are not considered standard.

1.6 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.*

## 2. Referenced Documents

### 2.1 ASTM Standards:<sup>2</sup>

- C55 Specification for Concrete Building Brick**
- C73 Specification for Calcium Silicate Brick (Sand-Lime Brick)**
- C90 Specification for Loadbearing Concrete Masonry Units**
- C129 Specification for Nonloadbearing Concrete Masonry Units**
- C143/C143M Test Method for Slump of Hydraulic-Cement Concrete**

<sup>2</sup> For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

**\*A Summary of Changes section appears at the end of this standard**

[C936/C936M Specification for Solid Concrete Interlocking Paving Units](#)  
[C1093 Practice for Accreditation of Testing Agencies for Masonry](#)  
[C1232 Terminology of Masonry](#)  
[C1319 Specification for Concrete Grid Paving Units](#)  
[C1372 Specification for Dry-Cast Segmental Retaining Wall Units](#)  
[C1491 Specification for Concrete Roof Pavers](#)  
[C1552 Practice for Capping Concrete Masonry Units, Related Units and Masonry Prisms for Compression Testing](#)  
[C1634 Specification for Concrete Facing Brick](#)  
[D6684 Specification for Materials and Manufacture of Articulating Concrete Block \(ACB\) Revetment Systems](#)  
[E4 Practices for Force Verification of Testing Machines](#)  
[E6 Terminology Relating to Methods of Mechanical Testing](#)

### 3. Terminology

3.1 Terminology defined in Terminologies [C1232](#) and [E6](#) shall apply for these test methods.

### 4. Significance and Use

4.1 These test methods provide general testing requirements for application to a broad range of concrete products. Those general testing requirements are included in the body of this standard.

NOTE 2—Consult manufacturer, supplier, product specifications, or other resources for more specific measurement or testing guidelines for those products not addressed with the annex of this standard.

4.2 These test methods provide specific testing requirements in two distinct sections, the requirements applicable to all units covered by these test methods and those applicable to the specific unit types. The requirements applicable to all units are included in the body of these test methods and those applicable to the specific unit types are included within the annexes.

### 5. Sampling

#### 5.1 Selection of Test Specimens:

5.1.1 For purposes of testing, full-sized units shall be selected by the purchaser or authorized representative. The selected specimens shall be of similar configuration and dimensions. Specimens shall be representative of the whole lot of units from which they are selected.

5.1.2 The term “lot” refers to any number of concrete masonry units of any configuration or dimension manufactured by the producer using the same materials, concrete mix design, manufacturing process, and curing method.

#### 5.2 Number of Specimens:

5.2.1 Unless specified otherwise in the applicable annex, a set of units shall consist of six full-size units.

5.2.2 Unless specified otherwise in the applicable annex, for the compressive strength, absorption, unit weight (density), and moisture content determinations, one set of units shall be selected from each lot of 10 000 units or fraction thereof and two sets of units from each lot of more than 10 000 and less than 100 000 units. For lots of more than 100 000 units, one set of units shall be selected from each 50 000 units or fraction thereof contained in the lot. Additional specimens shall be taken if directed by the purchaser.

5.3 Remove loose material from the specimens (including the cores) prior to determining the received weight.

NOTE 3—An abrasive stone or wire brush is typically used to remove loose material.

5.4 *Identification*—Mark each specimen so that it may be identified at any time. Markings shall cover not more than 5 % of the surface area of the specimen.

5.5 *Received Weight*—Weigh each specimen immediately after sampling and marking, and record as  $W_r$  (received weight). Record time and place  $W_r$  was measured.

NOTE 4—Received weights often have direct relationships with other unit properties and are therefore a useful method of evaluating results or for sorting purposes. The weight of a concrete masonry unit and related unit changes with time and exposure conditions, primarily as a result of the moisture within the unit. Therefore, to understand the context of a received weight value, it is also important to understand the point in time and the frame of reference when that weight was determined. “Time and place” should not refer to when and where the unit was sampled but when and where the received weights were determined. In addition to date and time references, it is also important to know if those weights were determined after units reached equilibrium with lab environment, or before units were shipped, or after delivery to the job site, and so forth.

### 6. Measurement of Dimensions

#### 6.1 Apparatus:

6.1.1 *Measurement Devices*—Devices used to measure specimen dimensions shall have divisions not greater than 0.1 in. (2.5 mm) when the dimension is to be reported to the nearest 0.1 in. (2.5 mm) and not greater than 0.01 in. (0.25 mm) when the dimension is to be reported to the nearest 0.01 in. (0.25 mm).

6.1.2 Measuring devices shall be readable and accurate to the division required to be reported. Accuracy shall be verified at least once annually. Verification record shall include date of verification, person or agency performing verification, identification of reference standard used, test points used during verification, and readings at test points.

6.2 *Specimens*—Three full-size units shall be selected for measurement of dimensions.

6.3 *Measurements*—Measure specimens in accordance with the applicable annex of this standard. For those products not covered by the annexes of this standard, measure overall dimensions (width, height, length) in at least two locations on opposite sides of the specimen to the nearest division required to be reported. Document location of each measurement on a sketch or photograph of the specimen.

NOTE 5—Specimens used for measurement of dimensions may be used in other tests.

NOTE 6—Calipers, micrometers, and steel scales and dividers of the appropriate accuracy and readability have been shown to be adequate for these measurements.

### 7. Compressive Strength

#### 7.1 Test Apparatus:

7.1.1 The testing machine shall have an accuracy of  $\pm 1.0$  % over the anticipated load range. The upper platen shall be a spherically seated, hardened metal block firmly attached at the center of the upper head of the machine. The center of the sphere shall lie at the center of the surface held in its spherical

seat but shall be free to turn in any direction, and its perimeter shall have at least ¼ in. (6.3 mm) clearance from the head to accommodate specimens whose bearing surfaces are not parallel. The diameter of the upper platen (determined in accordance with [Annex A8](#)) shall be at least 6 in. (150 mm). A hardened metal bearing plate may be used beneath the specimen to minimize wear of the lower platen of the machine.

7.1.2 When the bearing area of the upper platen or lower platen is not sufficient to cover the area of the specimen, a single steel plate with a thickness equal to at least the distance from the edge of the platen to the most distant corner of the specimen shall be placed between the platen and the capped specimen. The length and width of the steel plate shall be at least ¼ in. (6 mm) greater than the length and width of the units.

7.1.3 The surfaces of the platen or plate intended for contact with the specimen shall have a hardness not less than HRC 60 (BHN 620). The surfaces of the platen and plate shall not depart from plane surfaces by more than 0.001 in. (0.03 mm) in any 6 in. (150 mm) dimension.

**NOTE 7**—Research has shown that thickness of bearing plates has a significant effect on the tested compressive strength of masonry units when the bearing area of the platen is not sufficient to cover the area of the specimen. Plate bending results in nonuniform stress distributions that can influence the failure mechanisms of the tested specimens. The magnitude of this effect is controlled by the stiffness of the plate, the size of the specimen tested, and the strength of the specimen. Tested compressive strengths will typically increase with increased plate thickness and with reduced distance to the furthest corner of the specimen. Some testing laboratories have limitations that limit the practicality of eliminating plate bending entirely. Therefore the plate thickness requirements in [7.1](#) are intended to provide an adequate level of accuracy in the compression test results so as to conform to the limits of practicality of the testing laboratory.

**NOTE 8**—[Annex A8](#) includes guidance on determining the required plate thickness based on the configuration of the test specimen and the test machine.

7.1.4 The testing machine shall be verified in accordance with [Practices E4](#) at a frequency defined by [Practice C1093](#).

## 7.2 Test Specimens:

7.2.1 Unless specified otherwise in the applicable annex, test three specimens in compression.

7.2.2 When possible and unless specified otherwise in the applicable annex, specimens shall be full-sized units. When the units cannot be tested full-size due to specimen configuration or testing machine requirements, reduce the specimen size in accordance with [Annex A1](#).

7.2.3 After delivery to the laboratory, store compression specimens (unstacked and separated by not less than 0.5 in. (13 mm) on all sides) continuously in air at a temperature of 75 ± 15°F (24 ± 8°C) and a relative humidity of less than 80 % for not less than 48 h. Alternatively, if compression results are required sooner, store units unstacked in the same environment described above with a current of air from an electric fan passing over them for a period of not less than 4 h. Continue passing air over the specimens until two successive weighings at intervals of 2 h show an increment of loss not greater than 0.2 % of the previously determined weight of the specimen and until no moisture or dampness is visible on any surface of the unit. Specimens shall not be subjected to oven-drying.

**NOTE 9**—In this test method, net area (other than certain solid units, see [9.4](#)) is determined from specimens other than those subjected to compression testing. The compressive strength method is based on the assumption that units used for determining net volume (absorption specimens) have the same net volume as units used for compression testing. Sampled split face units, which have irregular surfaces, should be divided at the time they are sampled from the lot, such that the absorption test specimens have a net volume that is visually representative and a weight that is representative of the compression test specimens.

7.2.4 Where saw-cutting of test specimens is allowed or required by the standard or applicable annex, sawing shall be performed in an accurate, competent manner, subjecting the specimen to as little saw vibration as possible. Use a diamond saw blade of proper hardness. If the specimen is wetted during sawing, allow the specimen to dry to equilibrium with laboratory air conditions before testing, using the procedures outlined in [7.2.3](#).

7.2.5 If compression test specimens have been saw-cut from full-sized units and the net area of the compression test specimens can not be determined by [9.4.1](#), saw-cut an additional three units to the dimensions and configuration of the three compression test specimens. The average net area for the saw-cut compression specimens shall be taken as the average net area of the additional three saw-cut units calculated as required in [9.4](#). Calculated net volumes of saw-cut specimens shall not be used in calculating equivalent thickness.

7.3 *Capping*—Cap test specimens in accordance with [Practice C1552](#).

## 7.4 Compression Testing Procedure:

7.4.1 *Position of Specimens*—Test specimens with the centroid of their bearing surfaces aligned vertically with the center of thrust of the spherically seated steel bearing block of the testing machine ([Note 10](#)). Except for special units intended for use with their cores in a horizontal direction, test all hollow concrete masonry units with their cores in a vertical direction. Test masonry units that are 100 % solid and special hollow units intended for use with their hollow cores in a horizontal direction in the same direction as in service. Prior to testing each unit, ensure that the upper platen moves freely within its spherical seat to attain uniform seating during testing.

**NOTE 10**—For those masonry units that are symmetrical about an axis, the location of that axis can be determined geometrically by dividing the dimension perpendicular to that axis (but in the same plane) by two. For those masonry units that are nonsymmetrical about an axis, the location of that axis can be determined by balancing the masonry unit on a knife edge or a metal rod placed parallel to that axis. If a metal rod is used, the rod shall be straight, cylindrical (able to roll freely on a flat surface), have a diameter of not less than ¼ in. (6.4 mm) and not more than ¾ in. (19.1 mm), and its length shall be sufficient to extend past each end of the specimen when placed upon it. The metal rod shall be placed on a smooth, flat, level surface. Once determined, the centroidal axis shall be marked on the end of the unit using a pencil or marker having a marking width of not greater than 0.05 in. (1.3 mm). A tamping rod used for consolidation of concrete and grout for slump tests performed in accordance with [Test Method C143/C143M](#) is often used as a balancing rod.

7.4.2 *Moisture Condition of Specimens*—At the time the specimens are tested, they shall be free of visible moisture or dampness.

7.4.3 *Speed of Testing*—Apply the load (up to one half of the expected maximum load) at any convenient rate, after which adjust the controls of the machine as required to give a uniform



rate of travel of the moving head such that the remaining load is applied in not less than 1 nor more than 2 min. The results of the first specimen shall not be discarded so long as the actual loading time for the second half of the actual load is greater than 30 s.

NOTE 11—The allowance for a loading rate outside of 1 to 2 min for the first specimen acknowledges that the expected load may be different than the actual maximum load. The load rate for the remaining two specimens should be adjusted based on the first specimen results.

7.4.4 *Maximum Load*—Record the maximum compressive load in pounds (newtons) as  $P_{max}$ .

## 8. Absorption

8.1 *Apparatus*—Unless specified otherwise in the appropriate annex, the balance used shall be readable and accurate to 0.1 % of the smallest specimen tested.

### 8.2 Test Specimens:

8.2.1 Unless specified otherwise in the applicable annex, test three specimens in absorption.

8.2.2 Unless specified otherwise in the applicable annex, tests shall be performed on full-sized units or specimens saw-cut from full-sized units. Calculated values for absorption and density of reduced-size absorption specimens shall be considered as representative of the whole unit.

8.2.2.1 When test specimens are saw-cut from full-sized units, the test specimen shall have an initial weight after cutting of no less than 20 % of the initial received weight of the full-sized unit.

NOTE 12—When performing absorption tests on reduced-sized specimens, it is preferable to have a test specimen that is as large as practically possible and can be accommodated by laboratory equipment. This helps to reduce any location-specific variability from the absorption results.

### 8.3 Procedure:

8.3.1 *Saturation*—Immerse the test specimens in water at a temperature of 60 to 80°F (15.6 to 26.7°C) for 24 to 28 h such that the top surfaces of the specimens are no less than 6 in. (152 mm) below the surface of the water. Specimens shall be separated from each other and from the bottom of the immersion tank by at least 1/8 in. (3.1 mm), using wire mesh, grating, or other spacers so that not more than 10 % of the surface area of the specimen is in contact with the spacer. Weigh the specimens while suspended by a metal wire and completely submerged in water and record  $W_i$  (immersed weight). Remove from the water and allow to drain for  $60 \pm 5$  s by placing them on a 3/8-in. (9.5-mm) or coarser wire mesh, removing visible surface water with a damp cloth; weigh and record as  $W_s$  (saturated weight).

8.3.2 *Drying*—Subsequent to saturation, dry all specimens in a ventilated oven at  $230 \pm 9^\circ\text{F}$  ( $110 \pm 5^\circ\text{C}$ ) for not less than 24 h and until two successive weighings at intervals of 2 h show an increment of loss not greater than 0.2 % of the last previously determined weight of the specimen. Record weight of dried specimens as  $W_d$  (oven-dry weight).

## 9. Calculations

9.1 *Absorption*—Calculate absorption as follows:

$$\text{Absorption, lb/ft}^3 = [(W_s - W_d)/(W_s - W_i)] \times 62.4 \quad (1)$$

$$\text{Absorption, kg/m}^3 = [(W_s - W_d)/(W_s - W_i)] \times 1000$$

$$\text{Absorption, \%} = [(W_s - W_d)/W_d] \times 100$$

where:

$W_s$  = saturated weight of specimen, lb (kg),  
 $W_i$  = immersed weight of specimen, lb (kg), and  
 $W_d$  = oven-dry weight of specimen, lb (kg).

9.2 *Moisture Content*—Calculate the moisture content of the unit at the time it is sampled (when  $W_r$  is measured) as follows:

$$\text{Moisture Content, \% of total absorption} = [(W_r - W_d)/(W_s - W_d)] \times 100 \quad (2)$$

where:

$W_r$  = received weight of unit, lb (kg),  
 $W_d$  = oven-dry weight of unit, lb (kg), and  
 $W_s$  = saturated weight of unit, lb (kg).

NOTE 13—When determining the moisture content of a unit or set of units, the value determined is a measure of the water content of a unit based upon the received weight of the unit  $W_r$ . Thus, the moisture content calculation above is only applicable to the unit moisture content at the time the received weight,  $W_r$ , is obtained.

9.3 *Density*—Calculate oven-dry density as follows:

$$\text{Density (D), lb/ft}^3 = [W_d/(W_s - W_i)] \times 62.4 \quad (3)$$

$$\text{Density (D), kg/m}^3 = [W_d/(W_s - W_i)] \times 1000$$

where:

$W_d$  = oven-dry weight of specimen, lb (kg),  
 $W_s$  = saturated weight of specimen, lb (kg), and  
 $W_i$  = immersed weight of specimen, lb (kg).

9.4 *Average Net Area*—Calculate average net area as follows:

$$\text{Net Volume (} V_n \text{), ft}^3 = W_d/D = (W_s - W_i)/62.4 \quad (4)$$

$$\text{Net Volume (} V_n \text{), mm}^3 = W_d/D = (W_s - W_i) \times 10^6$$

$$\text{Average Net Area (} A_n \text{), in.}^2 = (V_n \times 1728)/H$$

$$\text{Average Net Area (} A_n \text{), mm}^2 = V_n/H$$

where:

$V_n$  = net volume of specimen, ft<sup>3</sup> (mm<sup>3</sup>),  
 $W_d$  = oven-dry weight of specimen, lb (kg),  
 $D$  = oven-dry density of specimen, lb/ft<sup>3</sup> (kg/m<sup>3</sup>),  
 $W_s$  = saturated weight of specimen, lb (kg),  
 $W_i$  = immersed weight of specimen, lb (kg),  
 $A_n$  = average net area of specimen, in.<sup>2</sup> (mm<sup>2</sup>), and  
 $H$  = average height of specimen, in. (mm).

9.4.1 Except for irregularly shaped specimens, such as those with split surfaces, calculate the net area of coupons and those specimens whose net cross-sectional area in every plane parallel to the bearing surface is the gross cross-sectional area measured in the same plane, as follows:

$$\text{Net Area (} A_n \text{), in.}^2 \text{ (mm}^2 \text{)} = L \times W \quad (5)$$

where:

$A_n$  = net area of the coupon or specimen, in.<sup>2</sup> (mm<sup>2</sup>),

$L$  = average length of the coupon or specimen, in. (mm), and

$W$  = average width of the coupon or specimen, in. (mm).

9.5 *Gross Area*—Calculate gross area as follows:

$$\text{Gross Area } (A_g), \text{ in.}^2 \text{ (mm}^2\text{)} = L \times W \quad (6)$$

where:

$A_g$  = gross area of the specimen, in.<sup>2</sup> (mm<sup>2</sup>),

$L$  = average length of the specimen, in. (mm), and

$W$  = average width of the specimen, in. (mm).

9.5.1 The gross cross-sectional area of a specimen is the total area of a section perpendicular to the direction of the load, including areas within cells and reentrant spaces, unless these spaces are to be occupied in the masonry by portions of adjacent masonry.

9.6 *Compressive Strength*:

9.6.1 *Net Area Compressive Strength*—Calculate the net area compressive strength of the specimen as follows:

$$\text{Net Area Compressive Strength, psi (MPa)} = P_{max}/A_n \quad (7)$$

where:

$P_{max}$  = maximum compressive load, lb (N), and

$A_n$  = average net area of specimen, in.<sup>2</sup> (mm<sup>2</sup>).

9.6.2 *Gross Area Compressive Strength*—Calculate the gross area compressive strength of the specimen as follows:

$$\text{Gross Area Compressive Strength, psi (MPa)} = P_{max}/A_g \quad (8)$$

where:

$P_{max}$  = maximum compressive load, lb (N), and

$A_g$  = gross area of specimen, in.<sup>2</sup> (mm<sup>2</sup>).

## 10. Report

10.1 For the purpose of reporting test results, all observed or calculated values shall be rounded using the following procedure:

10.1.1 When the digit immediately after the last place to be retained is less than 5, retain unchanged the digit in the last place retained.

10.1.2 When the digit immediately after the last place to be retained is greater than or equal to 5, increase by 1 the digit in the last place retained.

NOTE 14—As an example, density results are required to be reported to the nearest 0.1 lb/ft<sup>3</sup> in 10.3.7. A calculated value of 130.85 lb/ft<sup>3</sup> should be reported as 130.9 lb/ft<sup>3</sup>.

10.2 A complete report shall include the following general information:

10.2.1 Name and address of the testing laboratory,

10.2.2 Identification of the report and the date of issue,

10.2.3 Name and address of the client or the identification of the project,

10.2.4 Description and identification of the test sample,

10.2.5 Date of receipt of the test sample,

10.2.6 Date(s) of test performance,

10.2.7 Identification of the standard test method used and a notation of any known deviation from the test method,

10.2.8 Name of the person(s) accepting technical responsibility for the test report,

10.2.9 Age of test specimens, if known,

10.2.10 Identification of subcontractor test results, and

10.2.11 A photograph, sketch, or description of the configuration of the unit.

10.3 Unless specified otherwise in the applicable annex, a complete report shall include the following test results for the tests performed:

10.3.1 The average width, height and length to the nearest 0.1 in. (2.5 mm) separately for each specimen and as the average for the three specimens tested.

10.3.2 The net area to the nearest 0.1 in.<sup>2</sup> (65 mm<sup>2</sup>) separately for each specimen and as the average for the three specimens tested.

10.3.3 The maximum load separately for each specimen and as the average for the three specimens tested. Record the load as indicated to the nearest 10 lb (5 N) or the minimum resolution of the test machine as used during testing, whichever is greater.

10.3.4 The net area compressive strength to the nearest 10 psi (0.1 MPa) separately for each specimen and as the average for the three specimens tested.

10.3.5 The immersed, saturated, and oven dry weights ( $W_i$ ,  $W_s$ , and  $W_d$ ) to the nearest 0.1 lb (0.05 kg) separately for each specimen and as the average for the three specimens tested.

10.3.6 The absorption to the nearest 0.1 lb/ft<sup>3</sup> (1 kg/m<sup>3</sup>) separately for each specimen and as the average for the three specimens tested.

10.3.7 The density to the nearest 0.1 lb/ft<sup>3</sup> (1 kg/m<sup>3</sup>) separately for each specimen and as the average for the three specimens tested.

10.3.8 When required, the received weight ( $W_r$ ) to the nearest 0.1 lb (0.05 kg) and the moisture content to the nearest 0.1 % separately for each specimen and as the average for the three specimens tested. The time when the moisture content is determined (when  $W_r$  is measured) shall also be reported.

10.3.9 The size and configuration of the specimens tested for compressive strength and absorption.

10.4 Provide a summary report that includes the information necessary to determine compliance with the applicable product specification for the properties evaluated.

10.5 A complete report shall also include the other reporting requirements from the applicable annex.

NOTE 15—This summary report can be included as part of the test report or provided separately as a cover letter. See Appendix X1 for an example of a test report with summary section for concrete masonry units.

## 11. Keywords

11.1 absorption; compressive strength; concrete masonry units; density; equivalent thickness; face shell; moisture content; roof paver; web area; webs; web thickness

A1. TEST PROCEDURES FOR CONCRETE MASONRY UNITS

A1.1 Scope

A1.1.1 This annex includes testing requirements that are particular for concrete masonry units that are manufactured for compliance with the following unit specifications: C90, C129.

A1.2 Measurement

A1.2.1 For each unit, measure and record the width ( $W$ ) across the top and bottom bearing surfaces at mid-length, height ( $H$ ) at mid-length of each face, and length ( $L$ ) at mid-height of each face to the nearest division required to be reported.

A1.2.2 For each unit, measure the face shell thicknesses ( $t_{fs}$ ) at the thinnest point  $\frac{1}{2}$  in. (12.7 mm) down from the top surface of the unit as manufactured (typically the bottom surface of the unit as laid) and record to the nearest division required to be reported. Disregard grooves, scores, and similar details in the face shell thickness measurements.

A1.2.3 For each unit, when the thinnest point of opposite face shells differ in thickness by less than  $\frac{1}{8}$  in. (3.2 mm), calculate the minimum face shell thickness by averaging the recorded measurements. When the thinnest points differ by more than  $\frac{1}{8}$  in. (3.2 mm), the minimum face shell thickness shall be taken as the smaller of the two recorded measurements.

A1.2.4 For each unit, measure the web thickness ( $t_w$ ) at the minimum thickness of each web to the nearest 0.01 in. (0.25 mm).

A1.2.5 For each unit, determine the minimum web area using one of the following methods:

A1.2.5.1 For units with rectangular webs, measure the web height ( $t_h$ ) at the minimum height of each web to the nearest 0.1 in. (2.5 mm). For each unit, calculate the minimum web area for each web ( $A_w$ ) by multiplying the minimum web thickness

( $t_w$ ) and minimum web height ( $t_h$ ) for measured web dimensions of 0.75 in. (19.1 mm) or greater. For each unit, calculate the total minimum web area ( $A_{wt}$ ) by summing the web area ( $A_w$ ) of each web.

A1.2.5.2 For units with webs that are not rectangular, disregard portions of the web that have a thickness of less than 0.75 in. (19.1 mm). Make necessary measurements to determine the web area of each web at the minimum area based on the configuration of the web (see Note A1.2). For each unit, calculate the total minimum web area ( $A_{wt}$ ) by summing the web area ( $A_w$ ) of each web.


NOTE A1.1—Webs with minimum heights over their entire length or thickness over their entire height of less than 0.75 in. (19.1 mm) do not typically contribute to the unit’s structural stability. Such webs should not be included in the minimum web area calculation. When a web has a portion that is less than 0.75 in. (19.1 mm) in thickness, the web area should be determined based only on the portions of the web that are larger than 0.75 in. (19.1 mm) in thickness. See Fig. A1.1 and Fig. A1.2.

NOTE A1.2—It can be difficult on some units to access the minimum web area. If necessary, the unit can be saw-cut along the length at the minimum web area to facilitate measurements. Fig. A1.2 shows an example of a non-rectangular web, where the upper portion would be discarded from the measurement because it is less than 0.75 in. (19.1 mm) in thickness, and the lower portion would be used to determine web area because it is greater than 0.75 in. (19.1 mm) in thickness.

A1.3 Compressive Strength Testing


A1.3.1 Test Specimens—Specimens shall be full-sized units except as modified in A1.3.1.1 through A1.3.1.3.

A1.3.1.1 Unsupported projections having a length greater than the thickness of the projection shall be removed by saw-cutting. For units with recessed webs, the face shell projecting above the web shall be removed by saw-cutting to provide a full bearing surface over the net cross section of the unit. Where the resulting unit height would be reduced by more

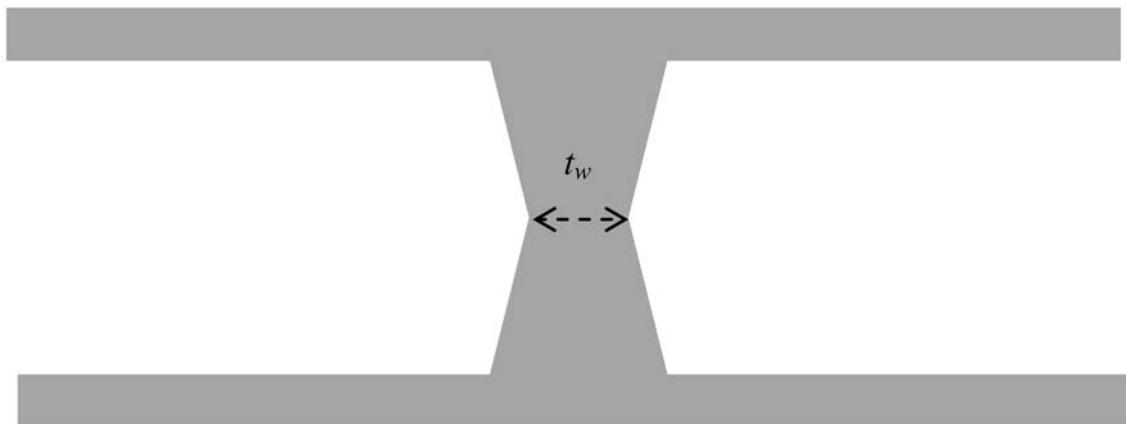

NOTE 1—If  $t_w$  is less than 0.75 in. (19.1 mm) over the entire height of the web, disregard entire area of that web when determining minimum web area.

FIG. A1.1 Example of Web with Irregular Cross-section—Plan View

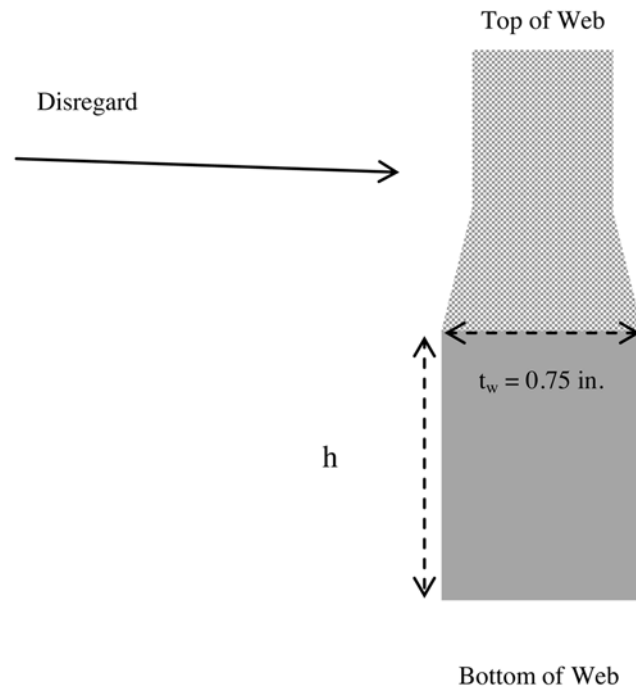

NOTE 1—Web Area =  $t_w * h$

FIG. A1.2 Example of Irregular Web Area Calculation—Section View

than one-third of the original unit height, the unit shall be coupon tested in accordance with A1.3.1.3.

A1.3.1.2 When compression testing full-sized units that are too large for the test machine’s bearing block and platens or are beyond the load capacity of the test machine, saw-cut the units to properly size them to conform to the capabilities of the testing machine. The resulting specimen shall have no face shell projections or irregular webs and shall be fully enclosed in a four-sided cell or cells. The compressive strength of the segment shall be considered to be the compressive strength of the whole unit.

A1.3.1.3 When compression testing units of unusual size and shape (see Note A1.3), the specimens shall be saw-cut to remove any face shell projections. The resulting specimen shall be a cell or cells containing four sides that will ensure a 100 % bearing surface. Where saw-cutting will not result in an enclosed four-sided unit, the specimen shall be a coupon cut from a face shell of each unit. The coupon size shall have a height to thickness ratio of 2 to 1 before capping and a length to thickness ratio of 4 to 1. The thickness of the coupon shall be as large as possible based on the configuration of the unit and the capacities of the testing machine and shall not be less than 1.25 in. (30 mm). The coupon shall be cut from the unit such that the coupon height dimension is in the same direction as the unit’s height dimension. The compressive strength of the coupon shall be the net area compressive strength of the whole unit.

NOTE A1.3—Examples of units having unusual size or shape include, but are not limited to, bond beam units, open end units, and pilaster units.

A1.3.2 *Testing*—Cap and test specimens in accordance with 7.3 and 7.4.

#### A1.4 Absorption Testing

A1.4.1 *Test Specimens*—Specimens shall be in accordance with 8.2 except as modified in A1.4.1.1.

A1.4.1.1 Tests shall be performed on full-size units when test results are to be used to determine moisture content in accordance with 9.2 or equivalent thickness in accordance with A1.5.3.

A1.4.2 *Testing*—Perform absorption tests in accordance with 8.3.

#### A1.5 Calculations

A1.5.1 Calculate absorption, moisture content, density, average net area, and net area compressive strength in accordance with Section 9.

A1.5.2 *Normalized Web Area*—Calculate the normalized web area ( $A_{wn}$ ) of each unit by dividing the total minimum web area ( $A_{wr}$ ) by the nominal length and height of the unit as follows:

$$A_{wn} = \frac{A_{wr}}{(L_n)(H_n)} \times 144$$

$$\left( A_{wn} = \frac{A_{wr}}{(L_n)(H_n)} \times 10^6 \right) \quad (A1.1)$$

where:



$A_{wn}$  = normalized web area, in.<sup>2</sup>/ft<sup>2</sup> (mm<sup>2</sup>/m<sup>2</sup>),  
 $A_{wt}$  = total minimum web area, in.<sup>2</sup> (mm<sup>2</sup>) (see A1.2.5),  
 $L_n$  = nominal length of unit, in. (mm), and  
 $H_n$  = nominal height of unit, in. (mm).

NOTE A1.4—Minimum web area does not apply to the portion of the unit to be filled with grout. The portion of the unit to be filled with grout should be deducted from the calculation of the normalized web area.

**A1.5.3 Equivalent Thickness**—Equivalent thickness for concrete masonry is defined as the average thickness of solid material in the unit and is calculated as follows:

$$T_e, \text{ in.} = [V_n / (L \times H)] \times 1728 \quad (\text{A1.2})$$

$$T_e, \text{ mm} = [V_n / (L \times H)]$$

where:

$T_e$  = equivalent thickness, in. (mm),  
 $V_n$  = average net volume of full-size units, ft<sup>3</sup> (mm<sup>3</sup>) (see 9.4),  
 $L$  = average length of full-size units, in. (mm) (see A1.2.1), and  
 $H$  = average height of full-size units, in. (mm) (see A1.2.1).

A1.5.3.1 Equivalent thickness shall only be calculated and reported for full-size concrete masonry units.

**A1.5.4 Percent Solid**—Calculate the percent solid as follows:

$$\text{Percent solid, ft}^3 (\%) = \left( \frac{V_n \cdot 1728}{L \cdot W \cdot H} \right) \cdot 100 \quad (\text{A1.3})$$

$$\text{Percent solid, mm}^3 (\%) = \left( \frac{V_n}{L \cdot W \cdot H} \right) \cdot 100$$

where:

$V_n$  = net volume of specimen, ft<sup>3</sup> (mm<sup>3</sup>) (see 9.4),  
 $L$  = average length of specimen, in. (mm) (see A1.2.1),  
 $W$  = average width of specimen, in. (mm) (see A1.2.1), and  
 $H$  = average height of specimen, in. (mm) (see A1.2.1).

NOTE A1.5—This calculation determines the percentage of concrete in the gross volume of the unit. It is a useful reference value, but it is not a requirement of unit specifications. This value is not comparable to the definition of a solid unit in C90 and C129, which refers to the net

cross-sectional area of every plane parallel to the bearing surface relative to the gross cross-sectional area of the same plane.

**A1.5.5 Maximum Variation from Specified Dimensions:**

A1.5.5.1 Determine the variation from each specified dimension by calculating the average width, height, and length of each specimen and comparing each average to the respective specified dimension, resulting in three variation results for each unit and nine results for a set of units. Determine the maximum variation for the set by identifying the maximum of the nine values.

A1.5.5.2 Specified dimensions shall be obtained from the unit manufacturer.

## A1.6 Report

A1.6.1 Test reports shall include all of the information in Sections 10.2, 10.3, and the following:

A1.6.1.1 The minimum face shell thickness to the nearest 0.01 in. (0.25 mm) separately for each specimen and as the average for the three specimens tested.

A1.6.1.2 The minimum web thickness to the nearest 0.01 in. (0.25 mm) separately for each specimen and as the average for the three specimens tested.

A1.6.1.3 The normalized web area to the nearest 0.1 in.<sup>2</sup>/ft<sup>2</sup> (500 mm<sup>2</sup>/m<sup>2</sup>) as the average for the three specimens tested.

A1.6.1.4 The equivalent thickness to the nearest 0.1 in. (2.5 mm) as the average for the three specimens tested.

A1.6.1.5 The percent solid results to the nearest 0.1 % separately for each specimen and as the average for the three specimens tested.

A1.6.1.6 Maximum variation from specified dimensions to the nearest 0.1 in. (2.5 mm) for the set of specimens tested.

A1.6.1.7 The gross area to the nearest 0.1 in.<sup>2</sup> (65 mm<sup>2</sup>) separately for each specimen and as the average for the three specimens tested.

A1.6.1.8 The gross area compressive strength to the nearest 10 psi (0.1 MPa) separately for each specimen and as the average for the three specimens tested.

A1.6.1.9 The net volume to the nearest 0.01 ft<sup>3</sup> (0.0002 m<sup>3</sup>) separately for each specimen and as the average for the three specimens tested.

## A2. TEST PROCEDURES FOR CONCRETE AND CALCIUM SILICATE BRICK

### A2.1 Scope

A2.1.1 This annex includes testing requirements that are particular for concrete brick that are manufactured for compliance with the following unit specifications: C55, C73, and C1634.

### A2.2 Measurement of Dimension

A2.2.1 For each unit, measure and record the width ( $W$ ) across the top and bottom bearing surfaces at mid-length, height ( $H$ ) at mid-length of each face, and length ( $L$ ) at mid-height of each face to the nearest division required to be reported.

A2.2.2 For brick containing cores, measure 1/2 in. down from the top surface of the unit and record the minimum distance from the any edge of each brick to the nearest edge of the nearest core to the nearest division required to be reported.

### A2.3 Compressive Strength Testing

A2.3.1 *Test Specimens*—Specimens shall be full-sized units except as modified in A2.3.1.1 and A2.3.1.2.

A2.3.1.1 When compression testing full-sized units that are too large for the test machine's bearing block and platens or are beyond the load capacity of the test machine, saw-cut the units to properly size them to conform to the capabilities of the



testing machine. The resulting specimen shall have no projections or irregular features and cores shall be fully enclosed. The compressive strength of the segment shall be considered to be the compressive strength of the whole unit.

A2.3.1.2 Tested specimens shall have an aspect ratio (height divided by its least lateral dimension,  $h/t$ ) of  $0.6 \pm 0.1$ . If full-size units are not within that dimensional ratio requirement, the units shall be saw-cut to produce a compression test specimen with that dimensional ratio prior to capping. The height of the compression specimen shall be greater than or equal to 2 in. (50.8 mm).

A2.3.2 *Testing*—Cap and test specimens in accordance with 7.3 and 7.4.

## A2.4 Absorption Testing

A2.4.1 *Test Specimens*—Specimens shall be in accordance with 8.2 except as modified in A2.4.1.1.

A2.4.1.1 Tests shall be performed on full-size units when test results are to be used to determine equivalent thickness.

A2.4.2 *Testing*—Perform absorption tests in accordance with 8.3.

## A2.5 Calculations

A2.5.1 Calculate absorption, moisture content, and density per Section 9.

A2.5.2 For units tested to determine compliance with Specifications C55 or C1634, calculate net area as per 9.4 and net area compressive strength as per 9.6.1.

A2.5.3 For units tested to determine compliance with Specification C73, calculate gross area per 9.5 and gross area compressive strength per 9.6.2.

A2.5.4 *Equivalent Thickness*—Equivalent thickness is defined as the average thickness of solid material in the unit and is calculated as follows:

$$T_e, \text{ in.} = [V_n / (L \times H)] \times 1728 \quad (\text{A2.1})$$

$$T_e, \text{ mm} = [V_n / (L \times H)]$$

where:

$T_e$  = equivalent thickness, in. (mm),

$V_n$  = average net volume of full-size units,  $\text{ft}^3$  ( $\text{mm}^3$ ) (see 9.4),

$L$  = average length of full-size units, in. (mm) (see A2.2.1), and

$H$  = average height of full-size units, in. (mm) (see A2.2.1).

A2.5.4.1 Equivalent thickness shall only be calculated and reported for full-size concrete brick.

A2.5.5 *Percent Solid*—Calculate the percent solid as follows:

$$\text{Percent solid, ft}^3 \% = \left( \frac{V_n \cdot 1728}{L \cdot W \cdot H} \right) \cdot 100 \quad (\text{A2.2})$$

$$\text{Percent solid, mm}^3 \% = \left( \frac{V_n}{L \cdot W \cdot H} \right) \cdot 100$$

where:

$V_n$  = net volume of specimen,  $\text{ft}^3$  ( $\text{mm}^3$ ) (see 9.4),

$L$  = average length of specimen, in. (mm) (see A2.2.1),

$W$  = average width of specimen, in. (mm) (see A2.2.1), and

$H$  = average height of specimen, in. (mm) (see A2.2.1).

NOTE A2.1—This calculation determines the percentage of concrete in the gross volume of the unit. It is a useful reference value, but it is not a requirement of unit specifications. This value is not comparable to the definition of a solid unit in C55 and C1634, which refers to the net cross-sectional area of every plane parallel to the bearing surface relative to the gross cross-sectional area of the same plane.

## A2.6 Report

A2.6.1 Test reports shall include all of the information in Sections 10.2, 10.3, and the following:

A2.6.1.1 For cored units, the minimum distance from the edge of the brick to the nearest core to the nearest 0.1 in. (2.5 mm) separately for each specimen and as the average for the three specimens tested.

A2.6.1.2 The equivalent thickness to the nearest 0.1 in. (2.5 mm) as the average for the three specimens tested.

A2.6.1.3 The percent solid results to the nearest 0.1 % separately for each specimen and as the average for the three specimens tested.

A2.6.1.4 The gross area to the nearest 0.1  $\text{in}^2$  (65  $\text{mm}^2$ ) separately for each specimen and as the average for the three specimens tested.

A2.6.1.5 The gross area compressive strength to the nearest 10 psi (0.1 MPa) separately for each specimen and as the average for the three specimens tested.

A2.6.1.6 The net volume to the nearest 0.01  $\text{ft}^3$  (0.0002  $\text{m}^3$ ) separately for each specimen and as the average for the three specimens tested.

### A3. TEST PROCEDURES FOR SEGMENTAL RETAINING WALL UNITS

#### A3.1 Scope

A3.1.1 This annex includes testing requirements that are particular for segmental retaining wall units that are manufactured for compliance with the following unit specifications: **C1372**.

#### A3.2 Sampling

A3.2.1 A set shall consist of a minimum of three full-size units, unless freeze-thaw durability testing is required. When freeze-thaw durability testing is required, a set shall consist of a minimum of five full-size units.

#### A3.3 Measurement of Dimensions

A3.3.1 For each unit, measure and record the width ( $W$ ) across the top and bottom bearing surfaces at mid-length, height ( $H$ ) at mid-length of each face, and length ( $L$ ) at mid-height of each face to the nearest division required to be reported.

#### A3.4 Compressive Strength Testing

A3.4.1 *Test Specimens*—Specimens shall be a saw-cut coupon with an aspect ratio (height divided by its least lateral dimension,  $h/t$ ) of  $2.0 \pm 0.1$  before capping and length to thickness ratio ( $l/t$ ) of  $4.0 \pm 0.1$ . The coupon width shall be as close to 2 in. as possible, but in no case less than 1.5 in. (37

mm). Coupon dimensions shall not differ by more than  $\frac{1}{8}$  in. (3 mm) from the targeted dimension. The compressive strength of the coupon shall be considered to be the compressive strength of the whole unit. Saw-cutting shall be performed in accordance with **7.2.4** and **7.2.5**.

NOTE A3.1—The compressive strength of coupons saw-cut from segmental retaining wall units can be measurably influenced by the unit configuration and location of the sample. Due to the variety of unit configurations available, it is not possible to specify exact locations for obtaining coupons. In order to compare results within a set or between independently performed tests, coupons should be consistently obtained from the same location for a given unit configuration. Suppliers should be consulted for the recommended coupon sample location for a given unit configuration.

A3.4.2 *Testing*—Cap and test specimens in accordance with **7.3** and **7.4**.

#### A3.5 Absorption Testing

A3.5.1 Perform absorption tests in accordance with **8.3**.

#### A3.6 Calculations

A3.6.1 Calculate absorption, density, net area, and net area compressive strength in accordance with Section **9**.

#### A3.7 Report

A3.7.1 Test reports shall include all of the information in Sections **10.2** and **10.3**.

### A4. TEST PROCEDURES FOR CONCRETE INTERLOCKING PAVING UNITS

#### A4.1 Scope

A4.1.1 This annex includes testing requirements that are particular for concrete interlocking paving units that are manufactured for compliance with the following unit specifications: **C936/C936M**.

A4.1.2 The values stated in either SI units or inch-pound units are to be regarded separately as standard. The values stated in each system may not be exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in non-conformance with the standard.

#### A4.2 Measurement of Dimensions

A4.2.1 For each full-sized unit sampled for compressive strength testing, using a caliper readable and accurate to 0.1 mm [0.004 in.], measure and record the width ( $W$ ) across the top and bottom bearing surfaces at mid-length, thickness ( $T$ ) at mid-length of each face, and length ( $L$ ) at mid-height of each face. For the purposes of this annex, the length shall be considered and recorded as the larger of the two measured lateral dimensions for each specimen, and the width as the smaller of the two measured lateral dimensions.

A4.2.2 Disregard spacer tabs when performing length and width measurements.

A4.2.3 Disregard chamfers when performing thickness measurements.

#### A4.3 Compressive Strength Testing

A4.3.1 *Test Specimens*—Test full size units that comply with all the requirements of **A4.3.1.2**. If full size units do not comply with all of the requirements of **A4.3.1.2**, then cut a rectangular full-height specimen from the units by reducing the width or length or both to meet all of the requirements of **A4.3.1.2**. If the smoothness or the aspect ratio required in **A4.3.1.2** cannot be achieved with a full-height specimen, cut the specimen height to achieve the required smoothness and aspect ratio. If saw-cutting is required to achieve specimen size or configuration requirements in **A4.3.1.2**, follow the procedures in **7.2.4**.

A4.3.1.1 For any cuts that reduce the thickness of the pavers, cut off the top of the paver and verify the accuracy of cut by measuring and recording as  $T_c$  the thickness of the cut specimen at mid-length of each face. Discard any specimen if the difference in  $T_c$  at the two different points is greater than 2.0 mm [0.08 in.].