



Designation: **C170/C170M—09 C170/C170M – 14**

Standard Test Method for Compressive Strength of Dimension Stone¹

This standard is issued under the fixed designation C170/C170M; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ϵ) indicates an editorial change since the last revision or reapproval.

This standard has been approved for use by agencies of the U.S. Department of Defense.

1. Scope

1.1 This test method covers the sampling, preparation of specimens, and determination of the compressive strength of dimension stone.

1.2 *Units*—The values stated in either SI units or inch-pound units are to be regarded separately as standard. The values stated in each system may not be exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in non-conformance with the standard.

1.3 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.*

2. Referenced Documents

2.1 *ASTM Standards:*²

[C39 Test Method for Compressive Strength of Cylindrical Concrete Specimens](#)

[C119 Terminology Relating to Dimension Stone](#)

[E4 Practices for Force Verification of Testing Machines](#)

3. Terminology

3.1 *Definitions*—All definitions are in accordance with Terminology [C119](#).

4. Significance and Use

4.1 This test method is useful in indicating the differences in compressive strength between the various dimension stones. This test method also provides one element in comparing stones of the same type.

5. Apparatus

5.1 ~~Any~~The testing machine conforming to ~~Practices~~used shall conform to the ~~E4~~ and to the requirements of Test Method ~~C39~~speed of testing requirements prescribed in Section, Section 5, including the calibration requirements ~~9~~ of Practices ~~E4~~this test method may be used.

5.2 The testing machine used shall be capable of applying the required load at a uniform rate as prescribed in Section 9 and applying load in a steady manner as to avoid sudden or rapid load changes.

5.3 ~~In vertical testing machines, the spherical bearing block~~The spherical bearing block of the testing machine shall be suspended from the upper head of the machine in such a manner so that the contact plate remains in a central position (spherical surfaces in full contact) when not loaded. The spherical surfaces shall be well lubricated, and the center of curvature shall ~~be in~~ be aligned within the surface of contact with the specimen.

5.4 [Fig. 1](#) illustrates the correct alignment of a specimen and the typical components of a testing machine conforming to these requirements.

¹ This test method is under the jurisdiction of ASTM Committee C18 on Dimension Stone and is the direct responsibility of Subcommittee C18.01 on Test Methods. Current edition approved April 1, 2009; May 1, 2014. Published April 2009; June 2014. Originally approved in 1941. Last previous edition approved in 2006; 2009 as C170/C170M-06-09. DOI: 10.1520/C0170-C0170M-09; 10.1520/C0170-C0170M-14.

² For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

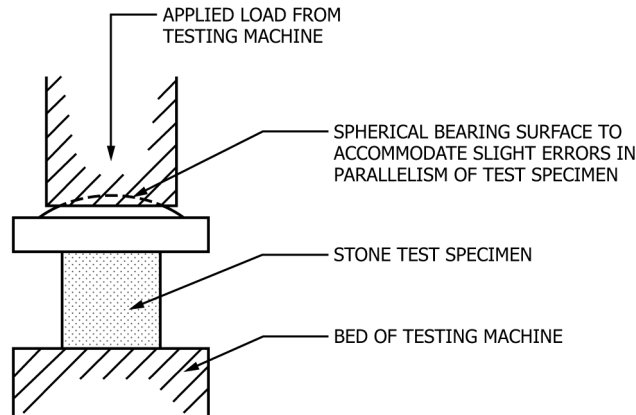


FIG. 1 Diagram of a Specimen Properly Aligned within a Testing Apparatus Suitable for Compressive Strength Testing

6. Sampling

6.1 The sample shall be selected to represent a true average of the type or grade of stone under consideration and shall be of the quality supplied to the market in finished form under the type designation to be tested. The sample may be selected by the purchaser or his authorized representative from quarried stone or taken from the natural ledge and shall be of adequate size to permit the preparation of the desired number of test specimens. When perceptible variations occur, the purchaser may select as many samples as are necessary for determining the variation in compressive strength.

7. Test Specimens


7.1 The test specimens may be cubes or cylinders and shall be cut from the sample with saws or core drills. The diameter or lateral dimension (distance between opposite vertical faces) shall be not less than 2 in. [50 mm] (Explanatory Note 1), and the ratio of height (Explanatory Note 2) to diameter or lateral dimension shall be 1:1. At least five specimens shall be prepared for each condition of the test; that is, when the compressive strength is desired for the wet and dry conditions but in only one direction, such as perpendicular to the bed (or rift) (see Fig. 42(a)), ten specimens will be required. For wet and dry strength tests both perpendicular and parallel to the bed (or rift) (see Fig. 42(a) and (b)), twenty specimens are required (Explanatory Note 3). The load-bearing faces shall be finished by grinding to as nearly true and parallel planes (Explanatory Note 4) as practicable.

7.2 The load-bearing surfaces and the direction of bedding (or rift) shall be marked on each specimen after finishing.

7.3 The load-bearing areas of the specimen shall be calculated from measurements taken midway between the load-bearing surfaces. The dimensions of the specimens shall be measured to the nearest 0.02 in. (0.5 mm) and the load-bearing areas calculated to the nearest 0.04 in.² [0.10 mm²].

8. Conditioning

8.1 Before testing the specimens in a dry condition, dry them for 48 h at 140 ± 4°F [60 ± 2°C]. At the 46th, 47th, and 48th h, weigh the specimens to ensure that the weight is the same. If the weight continues to drop, continue to dry the specimens until there are 3 successive hourly readings with the same weight. After removing the specimens from the oven, cool them to room temperature in a desiccator before testing them.

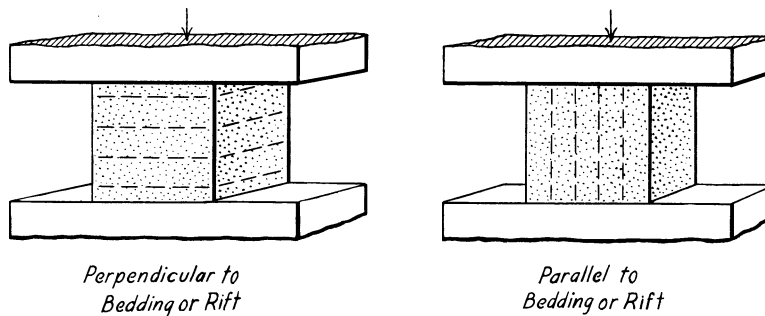

(a) Loading Perpendicular to Bedding or Rift

(b) Loading Parallel to Bedding or Rift

NOTE 1—Dashed lines indicate direction of bedding or rift. Arrows indicate direction of loading.

FIG. 42 Methods of Applying Load with Reference to Bedding or Rift