



Designation: C4 – 04 (Reapproved 2014)

Standard Specification for Clay Drain Tile and Perforated Clay Drain Tile¹

This standard is issued under the fixed designation C4; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ϵ) indicates an editorial change since the last revision or reapproval.

This standard has been approved for use by agencies of the U.S. Department of Defense.

1. Scope

1.1 This specification establishes the criteria for acceptance, prior to installation, of drain tile and perforated drain tile to be used for underdrainage, filter fields, leaching fields, and similar subdrainage installations.

1.2 The values stated in inch-pound units are to be regarded as standard. The values given in parentheses are mathematical conversions to SI units that are provided for information only and are not considered standard.

1.3 The following safety hazards caveat pertains only to the Test Methods portion of this specification: *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.*

NOTE 1—Attention is called to Test Methods C301 and Terminology C896.

2. Referenced Documents

2.1 *ASTM Standards*:²
C301 Test Methods for Vitrified Clay Pipe
C896 Terminology Relating to Clay Products

3. Terminology

3.1 Definitions:

3.1.1 *Clay, fire clay, shale, and surface clay* are as defined in Terminology C896.

3.1.2 Within this specification, the terms *tile, drain tile, and clay drain tile* are synonyms.

¹ This specification is under the jurisdiction of ASTM Committee C04 on Vitrified Clay Pipe and is the direct responsibility of Subcommittee C04.20 on Methods of Test and Specifications.

Current edition approved Sept. 1, 2014. Published September 2014. Originally approved in 1914. Last previous edition approved in 2009 as C4 – 04 (2009). DOI: 10.1520/C0004-04R14.

² For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

4. Classification

4.1 Four classes of clay drain tile are specified:

- 4.1.1 Standard.
- 4.1.2 Extra Quality.
- 4.1.3 Heavy Duty.
- 4.1.4 Extra Strength.

4.2 Drain tile of a higher strength classification than that specified by the purchaser may be furnished by the seller, provided the substituted drain tile meets the physical requirements of the class specified.

5. Materials and Manufacture

5.1 Drain tile shall be manufactured from clay, fire clay, shale, surface clay, or a combination of these materials, that, when formed into tile and fired to suitable temperatures, yields a product that conforms to this specification.

6. Physical Properties

6.1 Drain tile shall meet the physical test requirements for the class, as specified in Table 1.

6.2 The maximum water absorption (5-h boiling) shall be as follows:

	Average, %	Individual, %
Standard	13	16
Extra Quality	11	13
Heavy Duty	11	13
Extra Strength	11	13

6.3 The requirements for water absorption (5-h boiling) shall be waived, provided that test specimens meet the requirements of the freezing and thawing test, Section 13, of this specification

7. Sizes and Perforations

7.1 The size of drain tile shall be designated by inside diameter. Not all sizes and strengths may be available from all manufacturers.

7.2 The minimum length of drain tile smaller than 10 in. (255 mm) diameter shall be approximately 12 in. (305 mm).

7.3 The length of drain tile 10 in. (255 mm) through 30 in. (760 mm) diameter shall be not less than 1½ times their diameter.

TABLE 1 Physical Test Requirements for Clay Drain Tile

Internal Diameter of Tile, in.	Standard		Extra Quality		Heavy Duty		Extra Strength	
	Minimum Crushing Strength, ^A lbf/linear ft (kN/m)		Minimum Crushing Strength, ^A lbf/linear ft (kN/m)		Minimum Crushing Strength, ^A lbf/linear ft (kN/m)		Minimum Crushing Strength, ^A lbf/linear ft (kN/m)	
	Average	Individual	Average	Individual	Average	Individual	Average	Individual
3½	800 (12)	680 (10)	1100 (16)	990 (14)	1400 (20)	1260 (18)	2000 (29)	1800 (26)
4	800 (12)	680 (10)	1100 (16)	990 (14)	1400 (20)	1260 (18)	2000 (29)	1800 (26)
5	800 (12)	680 (10)	1100 (16)	990 (14)	1400 (20)	1260 (18)	2000 (29)	1800 (26)
6	800 (12)	680 (10)	1100 (16)	990 (14)	1400 (20)	1260 (18)	2000 (29)	1800 (26)
8	800 (12)	680 (10)	1100 (16)	990 (14)	1500 (22)	1350 (20)	2140 (31)	1920 (28)
10	800 (12)	680 (10)	1100 (16)	990 (14)	1550 (23)	1400 (20)	2200 (32)	1980 (29)
12	800 (12)	680 (10)	1100 (16)	990 (14)	1700 (25)	1530 (22)	2420 (35)	2170 (32)
14	840 (12)	720 (11)	1100 (16)	990 (14)	1850 (27)	1660 (24)	2640 (39)	2370 (35)
15	870 (13)	740 (11)	1150 (17)	1030 (15)	1980 (29)	1780 (26)	2800 (41)	2620 (38)
16	1200 (18)	1080 (16)	2100 (31)	1890 (28)	3000 (44)	2700 (39)
18	1300 (19)	1170 (17)	2340 (34)	2100 (31)	3300 (48)	2970 (43)
21	1450 (21)	1300 (19)	2680 (39)	2410 (35)
24	1600 (23)	1440 (21)	3000 (44)	2700 (39)
27	1800 (26)	1620 (24)	3330 (49)	3000 (44)
30	2000 (29)	1800 (26)	3590 (52)	3230 (47)

^A Strengths of sizes not listed may be interpolated between tabular values of sizes and strengths of the nearest listed diameters.

7.4 *Perforations*—Perforations shall be circular and cleanly cut through the tile wall. They shall be arranged in rows parallel to the longitudinal axis of the tile. The minimum number of rows of perforations shall be as shown in **Table 2**.

7.4.1 Where two rows of perforations are used, the rows shall be separated by an arc of $90 \pm 15^\circ$.

7.4.2 Where four rows of perforations are used, the rows shall be symmetrical around a vertical centerline. The lowermost rows of perforations shall be separated by an arc of $90 \pm 10^\circ$, and the uppermost rows shall be separated by an arc of not over 160° measured around the lower part of the tile (**Fig. 1**).

7.4.3 If more than four rows of perforations are used, the spacing of rows shall be uniform between the limits in **7.4.2**.

7.4.4 The purchaser shall specify the desired perforation diameter option of: (1) $\frac{1}{4} \pm \frac{1}{16}$ in. (6.4 ± 1.6 mm) or (2) $\frac{1}{2} \pm \frac{1}{8}$ in. (13 ± 3.2 mm), and the number of rows of perforations.

7.4.5 Perforations shall not be spaced more than approximately 3 in. (76 mm) center-to-center along the rows.

8. Workmanship and Finish

8.1 Drain tile shall be free of cracks, checks, or chips that decrease the strength.

8.2 Drain tile shall conform to the permissible dimensional variations in **Table 3**.

8.3 Plain-end tile shall be furnished unless otherwise specified by the purchaser.

8.3.1 The ends of plain-end tile shall be sufficiently square as to make close joints.

9. Sampling and Testing

9.1 Tile shall be sampled and tested in accordance with Sections **11** through **13**.

9.2 For test purposes, full-size drain tile shall be selected by the purchaser or his authorized representative. Tile shall be representative of the lot from which they are selected. The place or places of selection shall be designated when the

purchase order is issued. The manufacturer or seller shall furnish test tile without charge.

9.3 Each tile shall be individually marked so that it is identifiable within the testing period.

10. Basis of Acceptance

10.1 Acceptability of nonperforated drain tile is determined by compliance with the requirements of **Table 1**, **Table 3**, and the inspection requirements of Section **14**.

10.2 Acceptability of perforated drain tile is determined by compliance with the requirements of **Tables 1-3** and the inspection requirements of Section **14**.

TEST METHODS

11. Crushing Strength Test

11.1 Test Samples:

11.1.1 Test tile shall be sound, full size, and selected by the purchaser or his representative.

11.1.2 The number of tile to be tested shall not exceed 0.5 % of the number of tile of each size furnished, except that no less than five tile of each size shall be tested.

11.2 Loading Apparatus (see **Fig. 2**):

11.2.1 Testing Machine:

11.2.1.1 The loading apparatus may consist of any mechanically driven or hand-powered device that is capable of applying the necessary loads, with upper and lower bearings capable of transmitting these loads to the tile. The bearings shall be bearing beams and contact edges.

11.2.1.2 Any device that is capable of applying a load at a uniform rate, from 500 to 2000 lbf/linear ft-min (7.3 to 29 KN/linear m-min) of tile length, may be used for making the test.

11.2.1.3 The testing machine shall be sufficiently rigid so that the load distribution will not be appreciably affected by the deformation or yielding of any part. The machine and bearings shall be constructed to transmit the load in a vertical plane through the longitudinal axes of the bearings and tile. The

TABLE 2 Number of Perforations per Row for Perforated Clay Drain Tile

Tile Size Diameter, in. (mm)	Minimum Number of Rows of Perforations	Nominal Lengths of Tile, ft (m)				
		1 (0.31)	1½ (0.46)	2 (0.61)	2½ (0.76)	3 (0.92)
Minimum Number of Perforations per Row						
3½, 4, 5, 6 (89, 100, 125, 150)	4	3	5	7	9	11
3½, 4, 5, 6 (89, 100, 125, 150)	2	5	8	11	13	15
8, 10, 12 (205, 255, 305)	4	3	5	7	9	11
14 to 18 (355 to 455)	6	...	5	7	9	11

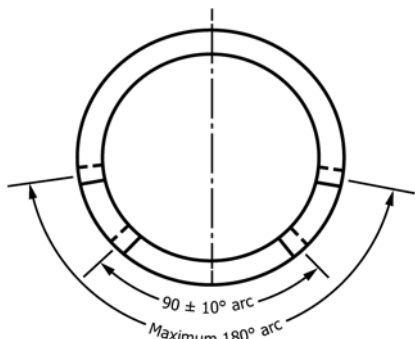


FIG. 1 Spacing of Four Rows of Perforations

bearings shall be attached to the machine so as to receive and uniformly transmit the loads required in the tests, without vibration or shock.

11.2.1.4 The loading apparatus shall provide means for determination of load with an accuracy of at least 98 % and capable of retaining the loading information that results in the crushing strength determination.

11.2.2 *Bearing Beams*—Bearing beams shall be no less than the length of the barrel of the tile. Built-up bearing beams may be used, provided their deflection does not exceed that specified. In order for the bell or socket of the tile, if applicable, to clear the bearing beams, it is recommended that the bearing beams be faced with a metal or hardwood member for affixing the contact edges.

11.2.3 *Three-Edge Bearings:*

11.2.3.1 Three-edge bearings shall consist of an upper member, comprised of a bearing beam on which one contact edge is located so that it lies in the vertical plane passing through the longitudinal axis of the tile, and a lower member comprised of a bearing beam on which two contact edges are symmetrically located parallel to that vertical plane.

11.2.3.2 The contact edges shall consist of rubber strips alone or hardwood strips with plaster of paris fillets. Contact edges shall uniformly contact the outside of the tile.

11.2.3.3 The two contact edges on the lower member shall be spaced apart approximately 1 in./ft (83 mm/m) of tile diameter, but in no case less than 1 in. (25 mm).

11.2.3.4 Positioning strips may be used to align the upper contact edge and to align and space the lower contact edges. In the case of rubber contact edges, positioning strips shall not exceed one half of the thickness of the contact edge and may remain in place.

11.2.3.5 If rubber strips are used as contact edges, they shall be cut or formed from a material having a Shore A, instantaneous, durometer hardness between 45 and 60. The strips shall be of rectangular cross section, having a 2-in. (51-mm) width, and a thickness not less than 1 in. (25 mm) nor more than 1½ in. (38 mm). The contact edges shall be used with the 2-in. (51 mm). dimension in contact with the bearing beam. Rubber contact edges may be attached to the bearing beam by an adhesive, provided the contact edge remains firmly fixed in position.

11.2.3.6 If hardwood strips with plaster of paris fillets are used as contact edges, the strips shall be straight and have a cross section not less than 1 in. (25 mm) in either direction. The bottom contact edges shall have vertical sides, with the interior top corners having a radius of approximately ½ in. (13 mm). The contact edges shall be securely fastened to the beams.

11.2.3.7 Plaster of paris fillets shall be cast on hardwood contact edges to provide uniform bearing contact on the outside of the tile. Fillets shall be cast on the two lower contact edges and on the upper contact edge, along the tile crown. Sufficient excess plaster shall be removed from between the two lower contact edges to eliminate the possibility of a single continuous lower contact. The tile and contact edges shall be joined while the plaster of paris is still workable. Testing shall be performed only after the fillets have set.

11.3 *Procedure:*

11.3.1 Immerse tile, 12-in. (305-mm) diameter and smaller, in water for at least 1 h and not more than 2 h immediately prior to testing. Tile with diameters larger than 12 in. (305 mm) may be tested without wetting, but shall not be dried except as may occur in complying with the provisions of 11.3.2.

11.3.2 No tile specimen shall be exposed to temperatures lower than 40°F (4.4°C) from the start of wetting until tested. Frozen tile shall be completely thawed before testing.

11.3.3 Strength tests are to be made by the three edge bearing method.

11.3.4 Center all bearings and test tile accurately for symmetrical distribution of load.

11.3.5 Apply load as continuously as testing equipment permits until the tile fails.

11.3.6 Record the load at which failure occurs.

11.4 *Calculation and Report*—Calculate and report the results of individual strength tests and the average in pounds-force per linear foot (or newtons per linear metre) of tile.