

SLOVENSKI STANDARD SIST ISO 3511-1:1995

01-junij-1995

Merilne krmilne funkcije in instrumentalna oprema v procesni tehniki - Simboličen prikaz - 1. del: Osnovne zahteve

Process measurement control functions and instrumentation -- Symbolic representation -- Part 1: Basic requirements

iTeh STANDARD PREVIEW

Fonctions et instrumentation pour la mesure et la régulation des processus industriels --Représentation symbolique -- Partie 1: Principes de base

SIST ISO 3511-1:1995

Ta slovenski standard je istoveten z 98021/sist-5511-1-1-1997

ICS:

01.080.30	Grafični simboli za uporabo v risbah, diagramih, načrtih, zemljevidih v strojništvu in gradbeništvu ter v ustrezni tehnični proizvodni dokumentaciji	Graphical symbols for use on mechanical engineering and construction drawings, diagrams, plans, maps and in relevant technical product documentation
25.040.40	Merjenje in krmiljenje industrijskih postopkov	Industrial process measurement and control

SIST ISO 3511-1:1995

en



iTeh STANDARD PREVIEW (standards.iteh.ai)

<u>SIST ISO 3511-1:1995</u> https://standards.iteh.ai/catalog/standards/sist/5fa4c99f-7e72-4abd-8531-641e06198d2f/sist-iso-3511-1-1995



INTERNATIONAL ORGANIZATION FOR STANDARDIZATION MEXCIT HAPOCHAR OPPAHUSALUNE TO CTAHCAPTUSALUNE ORGANISATION INTERNATIONALE DE NORMALISATION

Process measurement control functions and instrumentation – Symbolic representation – Part I : Basic requirements

Fonctions et instrumentation pour la mesure et la régulation des processus industriels A Représentation symbolique – Partie I : Principes de base (standards.iteh.ai)

SIST ISO 3511-1:1995 First edition — 1977 - 1975 - 1955 Standards.iteh.ai/catalog/standards/sist/5fa4c99f-7e72-4abd-8531-641e06198d2f/sist-iso-3511-1-1995

UDC 621-5:003.62/.63:744.4

Ref. No. ISO 3511/I-1977 (E)

Descriptors : measuring instruments, adjusting systems, control devices, control functions, engineering drawings, graphic symbols.

SIST ISO 3511-1:1995

FOREWORD

ISO (the International Organization for Standardization) is a worldwide federation of national standards institutes (ISO member bodies). The work of developing International Standards is carried out through ISO technical committees. Every member body interested in a subject for which a technical committee has been set up has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work.

Draft International Standards adopted by the technical committees are circulated to the member bodies for approval before their acceptance as International Standards by the ISO Council.

International Standard ISO 3511/I was developed by Technical Committee/IEW ISO/TC 10, *Technical drawings*, and was circulated to the member bodies in October 1974.

It has been approved by the member bodies of the following countries :1995

https://standards.iteh.ai/catalog/standards/sist/5fa4c99f-7e72-4abd-				
Australia	Ĥungary	641e06198dRomania 3511-1-1995		
Austria	India	South Africa, Rep. of		
Belgium	Ireland	Spain		
Bulgaria	Mexico	Sweden		
Chile	Netherlands	Switzerland		
Denmark	New Zealand	Turkey		
France	Norway	United Kingdom		
Germany	Poland	Yugoslavia		

The member bodies of the following countries expressed disapproval of the document on technical grounds :

Canada Finland Italy U.S.A.

© International Organization for Standardization, 1977 •

Process measurement control functions and instrumentation – Symbolic representation – Part I : Basic requirements

0 INTRODUCTION

This International Standard has been devised to provide a universal means of communication between the various interests involved in the design manufacture, installation and operation of measurement and control equipment used in the process industries.

Part I : Basic requirements (directed towards the needs of those whose prime interest is in basic measurement and control means).

Part II : Extension of basic requirements.

Part III : Detailed symbols.

The three parts together are intended

a) to meet the requirements of those who, possibly employing more sophisticated measurement and control means, may wish to depict such aspects as the measurement techniques embodied in a particular instrument, or the means – hydraulic, pneumatic, electrical, mechanical – used for its actuation;

b) to provide standard symbolic representation for process measurement control functions and instrumentation. These symbols are not intended to replace graphic symbols for electrical equipment as contained in IEC Publication 117.

1 SCOPE AND FIELD OF APPLICATION

Part I of this International Standard establishes a symbols system for use in depicting the basic functions of measurement and control equipment in relation to the plant with which it is associated. The system has been intentionally limited to the identification of instrument functions and does not provide means of illustrating specific instruments.

2 DEFINITIONS

The following definitions are used solely for the purpose of this International Standard to assist in the application and understanding of the symbol system.

2.1 point of measurement: The point in a process at which a measurement is or may be made.

2.2 instrument : A device or combination of devices used directly or indirectly to measure, display and/or control a variable. This term does not apply to internal components of the instruments, for example resistor or receiver bellows.

2.3 panel-mounted instrument: An instrument that is mounted in a group normally accessible to the operator.

2.4 locally mounted instrument : An instrument that is not panel mounted.

2.5 correcting unit : The unit comprising those elements (actuating and correcting) which adjust the correcting conditions, in response to a signal from the controller.

2.6 actuating element: That part of the correcting unit which adjusts the correcting element, for example a response to a signal from the controller.

2.7 correcting element : That part of the correcting unit which directly adjusts the value of the correcting conditions.

2.8 alarm : A device which is intended to attract attention to a defined abnormal condition by means of a discrete audible and/or visible signal, but which does not itself institute corrective action.

2.9 set value : The value of the controlled condition to which the controller is set.

3 SIZE AND OUTLINE OF BASIC SYMBOLS

The symbol requirements given below have been adopted to provide for legibility and ease of drawing. If diagrams are to be photographically reduced, then these sizes should be correspondingly larger.

3.1 Point of measurement

The symbol is a thin line connected to a flow line or to a plant equipment outline. If not connected to an instrument symbol, an identifying letter shall be placed close to this to designate the measurable property. The letters used shall comply with the table.

The location of the symbol shall be functionally correct and placed in the correct process sequence but need not illustrate the geographical position.

However, where it is desirable, for clarification, to identify the location of the point of measurement within a plant equipment outline, a small circle of approximately 2 mm diameter may be used at this point at the end of the thin line as shown in the figures in 6.1.7 and 6.9.

3.2 Instrument

The symbol comprises :

SIST ISO 3511-1:1995

- a thin line circle of approximately and miniteliar etalog/standards/sist/5fa4c99f-7e72-4abd-8531-

641c06198d2f/sist-iso-3511-1-1995 - a letter code showing the property measured and 3.5.3 Manual actu

function (see clause 4). A number may be included to facilitate identification.

A number may be included to facilitate identification. Where the letter code/identification number cannot be accommodated within the circle, the circle may be broken.

3.3 Panel-mounted instrument

The symbol is a thin line circle of approximately 10 mm diameter with a horizontal thin line across it. The line may be located at any height within the circle.

 \bigcirc


NOTE - For an instrument mounted inside a control panel, the above symbol may include a second horizontal line.

3.4 Correcting element

The symbol for a correcting element of unspecified type is an equilateral triangle with sides of approximately 5 mm length.



When the type of correcting element is known, established symbols depicting particular correcting elements may be used, for example for a valve :



3.5 Actuating element

3.5.1 Automatic actuating element

The basic symbol is a thin line circle of approximately 5 mm diameter, with a thin line to connect it to the correcting element symbol.



3.5.2 Automatic actuating element with integral manual actuating element

and 6.9. The letter H shall be inserted in the circle if there is a Teh STAND Amanual as well as an automatic facility for positioning the correcting unit.

н

(standards.iteh.ai)


3.5.3 Manual actuating element

Where there is only a manual facility for positioning the correcting unit, the symbol consists of a semi-circle of approximately 5 mm diameter beneath a letter H, with a thin line to connect it to the correcting element.



3.6 Correcting unit


The symbol is the combination of the symbols for the actuator and the correcting element, for example :



3.7 Actuating element operation

Response of the actuator to failure of the actuating energy may be indicated by an additional symbol, illustrated here for the particular example of a control valve.

- Control valve opens on failure of actuating energy :



- Control valve closes on failure of actuating energy :

- Control value retains position on failure of actuating energy :

4.1.4 For the use of the letter H to denote HAND (manual) operation, see 3.5.

4.2 Qualifying letters

Where it is required to denote HIGH or LOW, the qualifying letters H or L may be used in association with the instrument symbol (see 6.1.5 and 6.1.8).

5 TYPES OF LINE AND ASSEMBLY OF SYMBOLS

5.1 Types of line (see also ISO/R 128, *Engineering drawing – Principles of presentation*¹⁾.)

The types of lines used in the symbol system shall be as follows, it being conventional for a continuous thick line to represent the flow line of a process or the outline of a plant vessel, etc.

5.1.1 The symbol for an instrument connection to a process is a continuous thin line, thinner than the lines used to delineate the plant.



4 LETTER CODE

4.1 Identifying letters

The purpose of the instrument shall be defined by a letter code contained within the instrument symbol circle; this letter code shall be constructed on the following basis :

4.1.1 The first letter shall denote the measured or initiating variable, and shall be in accordance with column 2 of the table, but should be modified, if necessary, by the addition of a letter in accordance with column 3.

4.1.2 Succeeding letters shall be in accordance with column 4 of the table.


4.1.3 Where there are two or more succeeding letters, they shall be placed one after the other, in the sequence I R C T Q S Z A. (This does not apply to the letters corresponding to the modifiers in column 3 of the table.) The letter I may be omitted in the case of a self-indicating recorder.

5.1.2 The preferred general symbol for an instrument signal line is a continuous thin line, having a stroke repeated along its length. These strokes are inclined at approximately 60° to the line.



Alternatively, a continuous thin line without strokes may be used where there is no risk of confusion.

Instrument signal lines shall be drawn thinner than process lines.



NOTE – No attempt is made in this part of this International Standard to distinguish between types of instrument actuation (for example electrical, pneumatic and hydraulic), such a distinction being unnecessary for an understanding of the function of the instrumentation.

1) At present under revision.

1	2	3	4
	First letter ¹⁾		Succeeding letter ¹⁾
	Measured or initiating variable	Modifier	Display or output function
A			Alarm
В			
С			Controlling
D	Density	Difference	•
E	All electrical variables ²⁾		
F	Flow rate	Ratio	
G	Gauging, position or length		
н	Hand (manually initiated) operated		
1			Indicating
L		Scan	
к	Time or time programme		
L	Level		
м	Moisture or humidity	DARD PREVI	FW
N	Users' choice ³⁾		
0	Users' choice ³⁾	ards.iteh.ai)	
Р	Pressure or vacuum	190 2511 1.1005	
٥	Quality ²⁾ https://standards.iteh.ai/catalo For example Analysis, 641e06198 Concentration, Conductivity	y/standards/sist/5fa4c99f-7e72-4 d_ntegrate or fotalize d_NSIST-ISO-3511-1-1995	abd-8531- Integrating or summating
R	Nuclear radiation		Recording
S	Speed or frequency		Switching
т	Temperature		Transmitting
U	Multivariable ⁴⁾		
V	Viscosity		
w	Weight or force		
x	Unclassified variables ³⁾		
Y	Users' choice ³⁾		
z			Emergency or safety acting

$\mathsf{TABLE}-\mathbf{Letter}\ \mathbf{code}\ \mathbf{for}\ \mathbf{identification}\ \mathbf{of}\ \mathbf{instrument}\ \mathbf{functions}$

1) Upper case letters shall be used for the measured or initiating variable and succeeding letters for display or output function. Upper case letters are preferred for modifiers, but lower case letters may be used if this facilitates understanding.


2) A note shall be added to specify the property measured.

3) Where a user has a requirement for measured or initiating variables to which letters have not been allocated and which are required for repetitive use on a particular contract, the letters allocated to Users' Choice may be used provided that they are identified or defined for a particular measured or initiating variable and reserved for that variable. Where a user has a requirement for a measured or initiating variable that may be used either once or to a limited extent, the letter X may be used provided that it is suitably identified or defined.


4) The letter U may be used instead of a series of first letters where a multiplicity of inputs representing dissimilar variables feed into a single unit.

ISO 3511/I-1977 (E)

5.1.3 Crossings shall be shown thus :

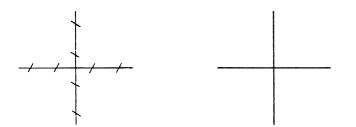

and junctions thus :

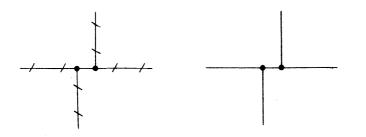

The diameter of the connecting dot shall be approximately

5.5 Position of qualifying letters

Qualifying letters, when used, may be placed inside the symbol circle, or outside the symbol circle and adjacent to it.

6 EXAMPLES OF USE OF THE SYMBOLS

6.1 Indicating, recording and alarm instruments

6.1.1 Flow rate indicator - locally mounted.



6.1.2 Flow rate recorder - locally mounted. five times the width of the associated lines. PRE 'eh STANDARD W 5.1.4 Where it is necessary in illustrating complex systems .iteh.ai) FR to indicate the direction in which information is flowing, arrows shall be added thus :

> SIST ISO 3511-1:1995 https://standards.iteh.ai/catalog/standards/sist/5fa4c99f-7e72-4abd-8531 641e06198d2f/sist-iso-3511-1-1995

5.2 Position of function-identifying letters

These shall always be placed inside the circle and, in the case of panel-mounted instruments, normally above the horizontal line (except as provided in 5.4). They shall be arranged in accordance with the requirements of 4.1.





5.3 Position of identifying number

If required, the identifying number may be shown either inside the circle or outside the circle and adjacent to it.


When shown inside the circle, the number shall normally be below the identifying letters and, in the case of panelmounted instruments, below the horizontal line (except as provided in 5.4).

5.4 Alternative arrangement


An alternative arrangement of identifying letters and numbers within the circle may be used provided that the measured or initiating variable letter is placed at the left side of the upper part of the circle.



6.1.3 Conductivity recorder - panel mounted.



6.1.4 Pressure differential recorder - locally mounted.



6.1.5 High pressure alarm - locally mounted.

