



# FINAL DRAFT International Standard

## ISO/FDIS 22762-3

### Elastomeric seismic-protection isolators —

Part 3:

### Applications for buildings — Specifications

*Appareils d'appuis structuraux en élastomère pour protection  
sismique —*

*Partie 3: Applications pour bâtiments — Spécifications*

[ISO/FDIS 22762-3](https://standards.iteh.ai/standards/iso/ba864327-376a-43ba-87a4-c51184612d18/iso-fdis-22762-3)

<https://standards.iteh.ai/catalog/standards/iso/ba864327-376a-43ba-87a4-c51184612d18/iso-fdis-22762-3>

ISO/TC 45/SC 4

Secretariat: **DSM**

Voting begins on:  
**2024-06-27**

Voting terminates on:  
**2024-08-22**

RECIPIENTS OF THIS DRAFT ARE INVITED TO SUBMIT, WITH THEIR COMMENTS, NOTIFICATION OF ANY RELEVANT PATENT RIGHTS OF WHICH THEY ARE AWARE AND TO PROVIDE SUPPORTING DOCUMENTATION.

IN ADDITION TO THEIR EVALUATION AS BEING ACCEPTABLE FOR INDUSTRIAL, TECHNOLOGICAL, COMMERCIAL AND USER PURPOSES, DRAFT INTERNATIONAL STANDARDS MAY ON OCCASION HAVE TO BE CONSIDERED IN THE LIGHT OF THEIR POTENTIAL TO BECOME STANDARDS TO WHICH REFERENCE MAY BE MADE IN NATIONAL REGULATIONS.

iTeh Standards  
(<https://standards.iteh.ai>)  
Document Preview

[ISO/FDIS 22762-3](https://standards.iteh.ai/catalog/standards/iso/ba864327-376a-43ba-87a4-c51184612d18/iso-fdis-22762-3)

<https://standards.iteh.ai/catalog/standards/iso/ba864327-376a-43ba-87a4-c51184612d18/iso-fdis-22762-3>



**COPYRIGHT PROTECTED DOCUMENT**

© ISO 2024

All rights reserved. Unless otherwise specified, or required in the context of its implementation, no part of this publication may be reproduced or utilized otherwise in any form or by any means, electronic or mechanical, including photocopying, or posting on the internet or an intranet, without prior written permission. Permission can be requested from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office  
CP 401 • Ch. de Blandonnet 8  
CH-1214 Vernier, Geneva  
Phone: +41 22 749 01 11  
Email: [copyright@iso.org](mailto:copyright@iso.org)  
Website: [www.iso.org](http://www.iso.org)

Published in Switzerland

**Contents**

Page

<b>Foreword</b> .....	<b>v</b>
<b>Introduction</b> .....	<b>vi</b>
<b>1 Scope</b> .....	<b>1</b>
<b>2 Normative references</b> .....	<b>1</b>
<b>3 Terms and definitions</b> .....	<b>1</b>
<b>4 Symbols</b> .....	<b>3</b>
<b>5 Classification</b> .....	<b>6</b>
5.1 General.....	6
5.2 Classification by construction.....	7
5.3 Classification by tolerance on shear properties.....	8
<b>6 Requirement</b> .....	<b>8</b>
6.1 General.....	8
6.2 Type tests and routine tests.....	9
6.3 Functional requirements.....	10
6.4 Design compressive force and design shear displacement.....	10
6.5 Performance requirements.....	10
6.5.1 General.....	10
6.5.2 Compressive properties.....	11
6.5.3 Shear properties.....	12
6.5.4 Tensile properties.....	12
6.5.5 Dependences of shear properties.....	13
6.5.6 Dependences of compressive properties.....	14
6.5.7 Shear displacement capacity.....	15
6.5.8 Durability.....	15
6.6 Rubber material requirements.....	16
6.6.1 General.....	16
6.6.2 Tensile properties.....	16
6.6.3 Properties after ageing in air.....	16
6.6.4 Hardness.....	17
6.6.5 Ozone resistance.....	17
6.6.6 Other properties.....	17
6.7 Dimensional requirements.....	18
6.8 Requirements on steel used for flanges and reinforcing plates.....	18
6.9 Requirement on lead material for LRB.....	19
<b>7 Design rules</b> .....	<b>19</b>
7.1 General.....	19
7.2 Shape factor.....	19
7.2.1 First shape factor.....	19
7.2.2 Second shape factor.....	20
7.3 Compression and shear properties.....	20
7.3.1 Compressive stiffness.....	20
7.3.2 Shear stiffness and equivalent damping ratio.....	20
7.4 Ultimate properties.....	21
7.4.1 Stability at zero displacement.....	21
7.4.2 Stability and failure under large shear displacements.....	22
7.4.3 Roll-out properties of elastomeric isolators with recessed or dowelled connections (Type III).....	22
7.4.4 Tensile properties.....	23
7.5 Reinforcing steel plates.....	24
7.6 Connections.....	24
<b>8 Manufacturing tolerances</b> .....	<b>24</b>
8.1 General.....	24

# ISO/FDIS 22762-3:2024(en)

8.2	Measuring instruments.....	25
8.3	Plan dimensions.....	25
	8.3.1 Measurement method.....	25
	8.3.2 Tolerances.....	25
8.4	Product height.....	26
	8.4.1 Measurement method.....	26
	8.4.2 Tolerances.....	27
8.5	Flatness.....	27
	8.5.1 Measurement method.....	27
	8.5.2 Tolerances.....	27
8.6	Horizontal offset.....	27
8.7	Plan dimensions of flanges.....	28
8.8	Flange thickness.....	28
8.9	Tolerances on positions of flange bolt holes.....	29
<b>9</b>	<b>Marking and labelling.....</b>	<b>29</b>
	9.1 General.....	29
	9.2 Information to be provided.....	29
	9.3 Additional requirements.....	30
	9.4 Marking and labelling examples.....	30
<b>10</b>	<b>Test methods.....</b>	<b>30</b>
<b>11</b>	<b>Quality assurance.....</b>	<b>30</b>
<b>Annex A</b> (normative)	<b>Tensile stress in reinforcing steel plate.....</b>	<b>31</b>
<b>Annex B</b> (normative)	<b>Determination of ultimate property diagram based on experimental results.....</b>	<b>33</b>
<b>Annex C</b> (informative)	<b>Minimum recommended physical properties of rubber material.....</b>	<b>36</b>
<b>Annex D</b> (informative)	<b>Effect of inner-hole diameter and second shape factor on shear properties.....</b>	<b>37</b>
<b>Annex E</b> (informative)	<b>Determination of compressive properties of elastomeric isolators.....</b>	<b>40</b>
<b>Annex F</b> (informative)	<b>Determination of shear properties of elastomeric isolators.....</b>	<b>43</b>
<b>Annex G</b> (informative)	<b>Method of predicting buckling limit at large deformations.....</b>	<b>48</b>
<b>Annex H</b> (informative)	<b>Design of fixing bolts and flanges.....</b>	<b>55</b>
<b>Bibliography</b> .....		<b>58</b>

## Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

The procedures used to develop this document and those intended for its further maintenance are described in the ISO/IEC Directives, Part 1. In particular, the different approval criteria needed for the different types of ISO document should be noted. This document was drafted in accordance with the editorial rules of the ISO/IEC Directives, Part 2 (see [www.iso.org/directives](http://www.iso.org/directives)).

ISO draws attention to the possibility that the implementation of this document may involve the use of (a) patent(s). ISO takes no position concerning the evidence, validity or applicability of any claimed patent rights in respect thereof. As of the date of publication of this document, ISO had not received notice of (a) patent(s) which may be required to implement this document. However, implementers are cautioned that this may not represent the latest information, which may be obtained from the patent database available at [www.iso.org/patents](http://www.iso.org/patents). ISO shall not be held responsible for identifying any or all such patent rights.

Any trade name used in this document is information given for the convenience of users and does not constitute an endorsement.

For an explanation of the voluntary nature of standards, the meaning of ISO specific terms and expressions related to conformity assessment, as well as information about ISO's adherence to the World Trade Organization (WTO) principles in the Technical Barriers to Trade (TBT), see [www.iso.org/iso/foreword.html](http://www.iso.org/iso/foreword.html).

This document was prepared by Technical Committee ISO/TC 45, *Rubber and rubber products*, Subcommittee SC 4, *Products (other than hoses)*.

This fourth edition cancels and replaces the third edition (ISO 22762-3:2018), of which it constitutes a minor revision.

The changes are as follows:

- the relation of this document to ISO 22762-5 and ISO 22762-6 have been added in Introduction;
- the use of the terms "elastomeric isolators" and "seismic isolators" have been made consistent throughout the document;
- the term "fracture" has been replaced by "break" throughout the document.
- the definition of some symbols in [Table 1](#) have been changed to make use of terms consistent;
- the information in the [Table 5](#) has been changed to be kept consistent with [Table 4](#);
- reference to [Annex B](#) has been added in [7.1](#);
- information in [B.1](#) has been changed to be kept consistent with [Table 4](#);
- the information in [Table D.1](#) has been updated;
- the information in [E.1](#) has been updated;
- the reference in Bibliography has been updated.

A list of all parts in the ISO 22762 series can be found on the ISO website.

Any feedback or questions on this document should be directed to the user's national standards body. A complete listing of these bodies can be found at [www.iso.org/members.html](http://www.iso.org/members.html).

## Introduction

The ISO 22762 series includes two parts related to specifications for elastomeric isolators, i.e. ISO 22762-2 for bridges and ISO 22762-3 for buildings. This is because the elastomeric isolator requirements for bridges and buildings are quite different, although the basic concept of the two products is similar. Therefore, ISO 22762-2 and the relevant clauses in ISO 22762-1 are used when ISO 22762 (all parts) is applied to the design of bridge isolators whereas ISO 22762-3 and the relevant clauses of ISO 22762-1 are used when it is applied to building isolators.

The main differences to be noted between elastomeric isolators for bridges and elastomeric isolators for buildings are the following.

- a) Elastomeric isolators for bridges are mainly square in shape and those for buildings are circular in shape.
- b) Elastomeric isolators for bridges are designed to be used for both rotation and horizontal displacement, while elastomeric isolators for buildings are designed for horizontal displacement only.
- c) Elastomeric isolators for bridges are designed to perform on a daily basis to accommodate length changes of bridges caused by temperature changes as well as during earthquakes, while elastomeric isolators for buildings are designed to perform only during earthquakes.
- d) Elastomeric isolators for bridges are designed to withstand dynamic loads caused by vehicles on a daily basis as well as earthquakes, while elastomeric isolators for buildings are mainly designed to withstand dynamic loads caused by earthquakes only.

For structures other than buildings and bridges (e.g. tanks), the structural engineer uses either ISO 22762-2 or ISO 22762-3, depending on the requirements of the structure.

ISO/TS 22762-4 is the guidance for use of ISO 22762-3. ISO 22762-5 applies to specifications and test methods for sliding seismic-protection isolators which are not specified as elastomeric isolators. ISO 22762-6 applies to specifications and test methods for high-durability and high-performance elastomeric isolators. Three grades of requirements for each test item are introduced in ISO 22762-6.

[ISO/FDIS 22762-3](https://standards.iteh.ai/catalog/standards/iso/ba864327-376a-43ba-87a4-c51184612d18/iso-fdis-22762-3)

<https://standards.iteh.ai/catalog/standards/iso/ba864327-376a-43ba-87a4-c51184612d18/iso-fdis-22762-3>

# Elastomeric seismic-protection isolators —

## Part 3: Applications for buildings — Specifications

### 1 Scope

This document specifies minimum requirements and test methods for elastomeric seismic elastomeric isolators used for buildings and the rubber material used in the manufacture of such elastomeric isolators.

It is applicable to elastomeric seismic elastomeric isolators used to provide buildings with protection from earthquake damage. The elastomeric isolators covered consist of alternate elastomeric layers and reinforcing steel plates. They are placed between a superstructure and its substructure to provide both flexibility for decoupling structural systems from ground motion, and damping capability to reduce deflection at the isolation interface and the transmission of energy from the ground into the structure at the isolation frequency.

### 2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 630 (all parts), *Structural steels*

ISO 22762-1:2024, *Elastomeric seismic-protection isolators — Part 1: Test methods*

### 3 Terms and definitions

For the purposes of this document, the following terms and definitions apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

— ISO Online browsing platform: available at <https://www.iso.org/obp/>

— IEC Electropedia: available at <https://www.electropedia.org/>

#### 3.1 breaking

rupture of *elastomeric isolator* (3.8) due to compression- (or tension-) shear loading

#### 3.2 buckling

state when *elastomeric isolator* (3.8) lose their stability under compression-shear loading

#### 3.3 compressive properties

$K_v$   
compressive stiffness for all types of elastomeric isolator

### 3.4

#### **cover rubber**

rubber wrapped around the outside of inner rubber and reinforcing steel plates before or after curing of elastomeric isolators for the purposes of protecting the inner rubber from deterioration due to oxygen, ozone and other natural elements and protecting the reinforcing plates from corrosion

### 3.5

#### **design compressive stress**

long-term compressive force on the *elastomeric isolator* (3.8) imposed by the structure

### 3.6

#### **effective loaded area**

area sustaining vertical load in *elastomeric isolator* (3.8), which corresponds to the area of reinforcing steel plates

### 3.7

#### **effective width**

<rectangular elastomeric isolator> the smaller of the two side lengths of inner rubber to which direction shear displacement is not restricted

### 3.8

#### **elastomeric isolator**

rubber bearing, for seismic isolation of buildings, bridges and other structures, which consists of multi-layered vulcanized rubber sheets and reinforcing steel plates

EXAMPLE High-damping rubber bearings, linear natural rubber bearings and lead rubber bearings.

### 3.9

#### **first shape factor**

ratio of effectively loaded area to free deformation area of one inner rubber layer between steel plates

### 3.10

#### **high-damping rubber bearing**

##### **HDR**

elastomeric isolator with relatively high damping properties obtained by special compounding of the rubber and the use of additives

### 3.11

#### **inner rubber**

rubber between multi-layered steel plates inside an *elastomeric isolator* (3.8)

### 3.12

#### **lead rubber bearing**

##### **LRB**

*elastomeric isolator* (3.8) whose *inner rubber* (3.11) with a lead plug or lead plugs press fitted into a hole or holes of the elastomeric isolator body to achieve damping properties

### 3.13

#### **linear natural rubber bearing**

##### **LNR**

*elastomeric isolator* (3.8) with linear shear force-displacement characteristics and relatively low damping properties, fabricated using natural rubber

Note 1 to entry: Any bearing with relatively low damping can be treated as an LNR bearing for the purposes of elastomeric isolator testing.

### 3.14

#### **maximum compressive stress**

peak stress acting briefly on *elastomeric isolator* (3.8) in compressive direction during an earthquake



### 3.15

#### **nominal compressive stress**

long-term stress acting on *elastomeric isolators* (3.8) in compressive direction as recommended by the manufacturer for the elastomeric isolator, including the safety margin

### 3.16

#### **roll-out**

instability of an elastomeric isolator with either dowelled or recessed connection under shear deflection

### 3.17

#### **routine test**

test for quality control of the production elastomeric isolators during and after manufacturing

### 3.18

#### **second shape factor**

<circular elastomeric isolator> ratio of the diameter of the *inner rubber* (3.11) to the total thickness of the inner rubber

### 3.19

#### **second shape factor**

<rectangular or square elastomeric isolator> ratio of the effective width of the *inner rubber* (3.11) to the total thickness of the inner rubber

### 3.20

#### **shear properties**

comprehensive term that covers characteristics determined from elastomeric isolator tests:

- shear stiffness,  $K_h$ , for LNR;
- shear stiffness,  $K_h$ , and equivalent damping ratio,  $h_{eq}$ , for HDR and LRB;
- post-yield stiffness,  $K_d$ , and characteristic strength,  $Q_d$ , for LRB

### 3.21

#### **standard value**

value of elastomeric isolator property defined by manufacturer based on the results of type test

<https://standards.iteh.ai/catalog/standards/iso/ba864327-376a-43ba-87a4-c51184612d18/iso-fdis-22762-3>

### 3.22

**structural engineer**  
engineer who is in charge of designing the structure for seismically isolated buildings and is responsible for specifying the requirements for *elastomeric isolator* (3.8)

### 3.23

#### **type test**

test for verification either of material properties and elastomeric isolator performances during development of the product or that project design parameters are achieved

### 3.24

#### **ultimate properties**

properties at either buckling, breaking, or roll-out of an elastomeric isolator under compression-shear loading

### 3.25

#### **ultimate property diagram**

#### **UPD**

diagram giving the interaction curve of compressive stress and buckling strain or breaking strain of an elastomeric isolator

## 4 Symbols

For the purposes of this document, the symbols given in [Table 1](#) apply.

Table 1 — Symbols and descriptions

Symbol	Description
$A$	effective plan area; plan area of elastomeric isolator, excluding cover rubber portion
$A_b$	effective area of bolt
$A_e$	overlap area between the top and bottom elastomer area of elastomeric isolator
$A_{free}$	load-free area of elastomeric isolator
$A_{load}$	loaded area of elastomeric isolator
$A_p$	area of the lead plug for a lead rubber bearing
$a$	side length of square elastomeric isolator, excluding cover rubber thickness, or length in longitudinal direction of rectangular elastomeric isolator, excluding cover rubber thickness
$a_e$	length of the shorter side of the rectangular elastomeric isolator, including cover rubber thickness
$a'$	length in longitudinal direction of the rectangular elastomeric isolator, including cover rubber thickness
$B$	effective width for bending of flange
$b$	length in transverse direction of the rectangular elastomeric isolator, excluding cover rubber thickness
$b'$	length in transverse direction of the rectangular elastomeric isolator, including cover rubber thickness
$c$	distance from centre of bolt hole to effective flange section
$D'$	outer diameter of circular elastomeric isolator, including cover rubber
$D_f$	diameter of flange
$d_i$	inner diameter of reinforcing steel plate
$d_k$	diameter of bolt hole
$d_0$	outer diameter of reinforcing steel plate
$E_{ap}$	apparent Young's modulus of bonded rubber layer
$E_c$	apparent Young's modulus corrected, if necessary, by allowing for compressibility
$E_c^s$	apparent Young's modulus corrected for bulk compressibility depending on its shape factor ( $S_1$ )
$E_\infty$	bulk modulus of rubber
$E_0$	Young's modulus of rubber
$F_u$	tensile force on elastomeric isolator by uplift
$G$	shear modulus
$G_{eq}(\gamma)$	equivalent linear shear modulus as a function of shear strain
$H$	height of elastomeric isolator, including mounting flange
$H_n$	height of elastomeric isolator, excluding mounting flange
$h_{eq}$	equivalent damping ratio
$h_{eq}(\gamma)$	equivalent damping ratio as a function of shear strain
$K_d$	post-yield stiffness (tangential stiffness after yielding of lead plug) of lead rubber bearing
$K_h$	shear stiffness
$K_i$	initial shear stiffness
$K_p$	shear stiffness of lead plug inserted in lead rubber bearing
$K_r$	shear stiffness of lead rubber bearing before inserting lead plug
$K_t$	tangential shear stiffness
$K_v$	compressive stiffness
$L_f$	length of one side of a rectangular flange
$M$	resistance to rotation
$M_f$	moment acting on bolt
$M_r$	moment acting on elastomeric isolator
$n$	number of rubber layers
$n_b$	number of fixing bolts

Table 1 (continued)

Symbol	Description
$P$	compressive force
$P_0$	design compressive force in absence of seismic action effects
$P_{\max}$	maximum compressive force including seismic action effects
$P_{\min}$	minimum compressive force including seismic actions effects
$P_{Tb}$	tensile force at breaking of elastomeric isolator
$Q$	shear force
$Q_b$	shear force at breaking
$Q_{buk}$	shear force at buckling
$Q_d$	characteristic strength
$Q_{r0}$	shear force at roll-out
$S_1$	first shape factor
$S_2$	second shape factor
$T$	temperature
$T_0$	standard temperature, 23 °C or 27 °C; where specified tolerance is $\pm 2$ °C, $T_0$ is standard laboratory temperature
$T_r$	total rubber thickness, given by $T_r = n \times t_r$
$t_r$	thickness of one rubber layer
$t_{r1}, t_{r2}$	thickness of rubber layer laminated on each side of plate
$t_s$	thickness of one reinforcing steel plate
$t_0$	thickness of outside cover rubber
$U(\gamma)$	function giving ratio of characteristic strength to maximum shear force of a loop
$v$	loading velocity
$W_d$	energy dissipated per cycle
$X$	shear displacement
$X_0$	design shear displacement
$X_b$	shear displacement at breaking
$X_{buk}$	shear displacement at buckling
$X_{r0}$	shear displacement at roll-out
$X_s$	shear displacement due to quasi-static shear movement
$X_{\max}$	maximum shear displacement
$X_d$	shear displacement due to dynamic shear movement
$Y$	compressive displacement
$Z$	section modulus of flange
$\alpha$	coefficient of linear thermal expansion
$\gamma$	shear strain
$\gamma_0$	design shear strain
$\gamma_a$	upper limit of the total of design strains on elastomeric isolators
$\gamma_b$	shear strain at breaking
$\gamma_c$	local shear strain due to compressive force
$\gamma_d$	shear strain due to dynamic shear movement
$\gamma_{\max}$	maximum design shear strain during earthquake
$\gamma_r$	local shear strain due to rotation
$\gamma_s$	shear strain due to quasi-static shear movement
$\gamma_u$	ultimate shear strain

Table 1 (continued)

Symbol	Description
$\delta_H$	horizontal offset of elastomeric isolator
$\delta_V$	difference in elastomeric isolator height measured between two points at opposite extremes of the elastomeric isolator
$\varepsilon$	compressive strain of rubber
$\varepsilon_{cr}$	compressive creep strain
$\varepsilon_T$	tensile strain of elastomeric isolator
$\varepsilon_{Tb}$	tensile-breaking strain of elastomeric isolator
$\varepsilon_{Ty}$	tensile-yield strain of elastomeric isolator
$\zeta$	ratio of total height of rubber and steel layers to total rubber height
$\theta$	rotation angle of elastomeric isolator about the diameter of a circular bearing or about an axis through a rectangular bearing
$\theta_a$	rotation angle of elastomeric isolator in the longitudinal direction (a)
$\theta_b$	rotation angle of elastomeric isolator in the transverse direction (b)
$\lambda$	correction factor for calculation of stress in reinforcing steel plates
$\eta$	correction factor for calculation of critical stress
$\kappa$	correction factor for apparent Young's modulus according to hardness
$\Sigma\gamma$	total local shear strain
$\rho_R$	safety factor for roll-out
$\rho_T$	safety factor for tensile force
$\sigma$	compressive stress in elastomeric isolator
$\sigma_0$	design compressive stress
$\sigma_B$	tensile stress in bolt
$\sigma_b$	bending stress in flange
$\sigma_{bf}$	allowable bending stress in steel
$\sigma_{cr}$	critical compressive stress in elastomeric isolator
$\sigma_f$	allowable tensile stress in steel
$\sigma_{max}$	maximum compressive stress
$\sigma_{min}$	minimum compressive stress
$\sigma_{nom}$	for building: nominal long-term compressive stress recommended by manufacturer
$\sigma_s$	tensile stress in reinforcing steel plate
$\sigma_{sa}$	allowable tensile stress in steel plate
$\sigma_{sy}$	yield stress of steel for flanges and reinforcing steel plates
$\sigma_{su}$	tensile strength of steel for flanges and reinforcing steel plates
$\sigma_t$	tensile stress
$\sigma_{te}$	allowable tensile stress in elastomeric isolator
$\tau_B$	shear stress in bolt
$\tau_f$	allowable shear stress in steel
$\phi$	factor for computation of buckling stability
$\xi$	factor for computation of critical stress

## 5 Classification

### 5.1 General

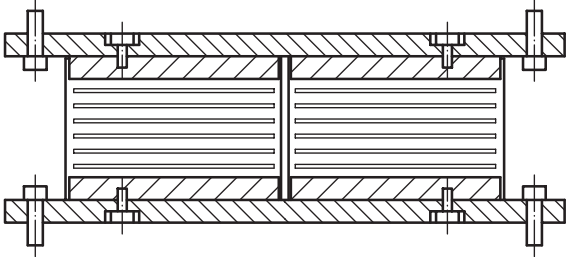
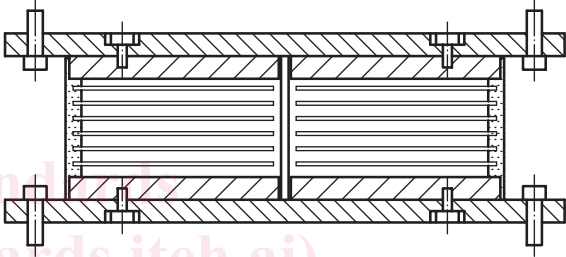
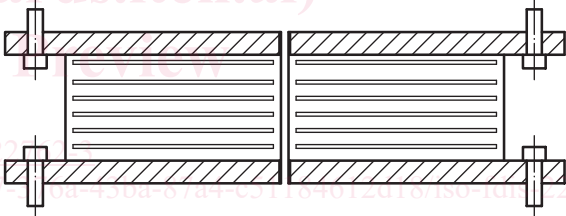
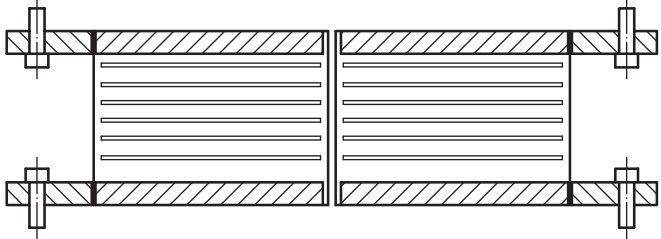
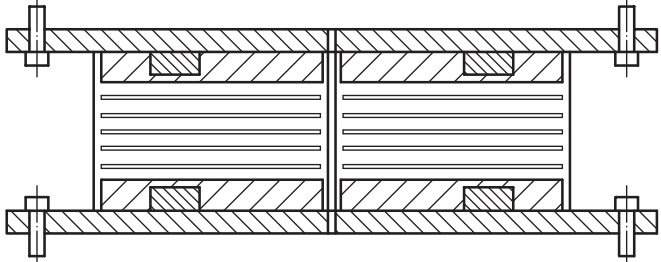
Elastomeric isolators are classified by construction, their ultimate properties and tolerances on their performance.

5.2 Classification by construction

Elastomeric isolators are classified by construction, as shown in Table 2.

Other methods not listed in Table 2 may be used to fix flanges to the laminated rubber, if the resulting construction has adequate strength to resist the shear forces and bending moments due to shear deflection. Furthermore, such constructions shall be capable of resisting tension if the elastomeric isolator is designed for uplift.

Table 2 — Classification by construction

Type	Construction	Illustration
<p><b>Type I</b></p>	<p>Mounting flanges are bolted to connecting flange plate, which are bonded to the laminated rubber. Cover rubber is added before curing of elastomeric isolator.</p>	
	<p>Mounting flanges are bolted to connecting flange plate, which are bonded to the laminated rubber. Cover rubber is added after curing of elastomeric isolator.</p>	
<p><b>Type II</b></p>	<p>Mounting flanges are directly bonded to the laminated rubber.</p>	
<p><b>Type III</b></p>	<p>Elastomeric isolators without mounting flanges, connected to base by either recess rings or dowell pins.</p>	<p style="text-align: center;"><b>Recess connection</b></p> 
		<p style="text-align: center;"><b>Dowell connection</b></p> 

### 5.3 Classification by tolerance on shear properties

Elastomeric isolators are classified by tolerance on shear properties, as shown in [Table 3](#).

**Table 3 — Classification by tolerance of shear properties**

Class	Individual	Global
S-A	±15 %	±10 %
S-B	±25 %	±20 %

## 6 Requirement

### 6.1 General

Elastomeric isolators for buildings and the materials used in manufacture shall meet the requirements specified in this clause. For test items (see [Table 4](#)) that have no specific required values, the manufacturer shall define the values and inform the purchaser prior to production.

The standard temperature for determining the properties of elastomeric isolators is 23 °C or 27 °C in accordance with prevailing International Standards. However, it is advisable to establish a range of working temperatures taking into consideration actual environmental temperatures and possible changes in temperatures at the work site where the elastomeric isolators are installed.

**Table 4 — Test pieces for type test**

Properties	Test item	Test piece	
		Scale	Minimum number
Compressive properties	Compressive stiffness	Full-scale only	3
Shear properties <sup>a</sup>	Shear stiffness	Full-scale only	3
	Equivalent damping ratio		
	Post-yield stiffness (for LRB)		
	Characteristic strength (for LRB)		
Tensile properties	Tensile breaking strength	Scale B	3
	Tensile yield strength		
Dependence of shear properties	Shear strain dependence <sup>a</sup>	Full-scale only	3
	Compressive stress dependence <sup>a</sup>	Full-scale only	3
	Frequency dependence	Scale A, STD, SBS	3
	Repeated loading dependence <sup>a</sup>	Scale B	3
	Temperature dependence	Scale A, STD, SBS	3
Dependence of compressive properties	Shear strain dependence	Scale B	3
	Compressive stress dependence		3

Scale A: Scaling such that, for a circular elastomeric isolator, diameter ≥150 mm, for a rectangular elastomeric isolator, side length ≥100 mm and, for both types, rubber layer thickness ≥1,5 mm and thickness of reinforcing steel plates ≥0,5 mm.

Scale B: Scaling such that, for a circular elastomeric isolator, diameter ≥500 mm, for a rectangular elastomeric isolator, side length ≥500 mm and, for both types, rubber layer thickness ≥1,5 mm and thickness of reinforcing steel plates ≥0,5 mm. Minimum scale factor 0,5.

STD: Standard test piece [see ISO 22762-1:2024, Tables 10 and 11].

SBS: Shear-block test piece specified in ISO 22762-1:2024, 5.8.3 With LRB, SBS shall only be used for ageing tests.

<sup>a</sup> If double-shear test configuration used, 3 tests involving 3 test-pieces shall be performed. The test pieces shall be paired such that the properties of individual test-pieces can be obtained.

<sup>b</sup> If double-shear test configuration used, 2 tests shall be performed.