



Designation: ~~D2167~~—~~08~~ **D2167** – 15

Standard Test Method for Density and Unit Weight of Soil in Place by the Rubber Balloon Method¹

This standard is issued under the fixed designation D2167; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ϵ) indicates an editorial change since the last revision or reapproval.

This standard has been approved for use by agencies of the U.S. Department of Defense.

1. Scope*

1.1 This test method covers the determination of the in-place density and unit weight of compacted or firmly bonded soil using a rubber balloon apparatus.

1.2 This test method is suitable for use as a means of acceptance for compacted fill or embankments constructed of fine-grained soils or granular soils without appreciable amounts of rock or coarse material.

1.3 This test method also may be used for the determination of the in-place density and unit weight of undisturbed or in situ soils, provided the soil will not deform under the pressures imposed during the test.

1.4 This test method is not suitable for use in organic, saturated, or highly plastic soils that would deform under the pressures applied during this test. This test method may require special care for use on (1) soils consisting of unbonded granular materials that will not maintain stable sides in a small hole, (2) soils containing appreciable amounts of coarse material in excess of 37.5 mm (1½ in.), (3) granular soils having high void ratios, or (4) fill materials containing particles with sharp edges. For soils containing appreciable amounts of particles in excess of 37.5 mm (1½ in.), Test Methods **D4914** or **D5030** should be used.

1.5 The values stated in SI units are to be regarded as the standard. The values given in parentheses are for information only.

1.5.1 In the engineering profession it is customary to use units representing both mass and force interchangeably, unless dynamic calculations are involved. This implicitly combines two separate systems of units; that is, the absolute system and the gravitational system. It is scientifically undesirable to combine the use of two separate sets of inch-pound units within a single standard. This standard has been written using the gravitational system of units when dealing with the inch-pound system. In this system the pound (lbf) represents a unit of force (weight). However, conversions are given in the SI system. The use of balances or scales recording pounds of mass ~~lbm/ft³~~ should not be regarded as nonconforming with this test method.

1.6 All observed and calculated values shall conform to the guidelines for significant digits and rounding established in Practice **D6026** unless superseded by this standard.

1.6.1 The procedures used to specify how data are collected, recorded or calculated in this standard are regarded as the industry standard. In addition they are representative of the significant digits that generally should be retained. The procedures used do not consider material variation, purpose for obtaining the data, special purpose studies, or any considerations for the user's objectives; it is common practice to increase or reduce significant digits of reported data to be commensurate with these considerations. It is beyond the scope of this standard to consider significant digits used in analytical methods for engineering design.

1.7 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.*

2. Referenced Documents

2.1 *ASTM Standards:*²

D653 Terminology Relating to Soil, Rock, and Contained Fluids

D698 Test Methods for Laboratory Compaction Characteristics of Soil Using Standard Effort (12 400 ft-lbf/ft³ (600 kN-m/m³))

¹ This test method is under the jurisdiction of ASTM Committee **D18** on Soil and Rock and is the direct responsibility of Subcommittee **D18.08** on Special and Construction Control Tests.

Current edition approved ~~April 1, 2008~~ July 1, 2015. Published ~~May 2008~~ July 2015. Originally approved in 1963. Last previous edition approved in ~~2004~~ 2008 as ~~D2167—94~~ **D2167—08**. (2001)—DOI: ~~10.1520/D2167-08~~ 10.1520/D2167-15.

² For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

*A Summary of Changes section appears at the end of this standard

- [D1557 Test Methods for Laboratory Compaction Characteristics of Soil Using Modified Effort \(56,000 ft-lbf/ft³ \(2,700 kN-m/m³\)\)](#)
- [D2216 Test Methods for Laboratory Determination of Water \(Moisture\) Content of Soil and Rock by Mass](#)
- [D3740 Practice for Minimum Requirements for Agencies Engaged in Testing and/or Inspection of Soil and Rock as Used in Engineering Design and Construction](#)
- [D4253 Test Methods for Maximum Index Density and Unit Weight of Soils Using a Vibratory Table](#)
- [D4643 Test Method for Determination of Water \(Moisture\) Content of Soil by Microwave Oven Heating](#)
- [D4718 Practice for Correction of Unit Weight and Water Content for Soils Containing Oversize Particles](#)
- [D4753 Guide for Evaluating, Selecting, and Specifying Balances and Standard Masses for Use in Soil, Rock, and Construction Materials Testing](#)
- [D4914 Test Methods for Density and Unit Weight of Soil and Rock in Place by the Sand Replacement Method in a Test Pit](#)
- [D4944 Test Method for Field Determination of Water \(Moisture\) Content of Soil by the Calcium Carbide Gas Pressure Tester](#)
- [D4959 Test Method for Determination of Water \(Moisture\) Content of Soil By Direct Heating](#)
- [D5030 Test Method for Density of Soil and Rock in Place by the Water Replacement Method in a Test Pit](#)
- [D6026 Practice for Using Significant Digits in Geotechnical Data](#)

3. Terminology

- 3.1 *Definitions*—For definitions of common technical terms in this standard refer to Terminology [D653](#).
- 3.2 *Definitions of Terms Specific to This Standard:*
- 3.2.1 *compacted lift, n*—a layer of compacted soil.

4. Summary of Test Method

4.1 The volume of an excavated hole in a given soil is determined using a liquid-filled calibrated vessel for filling a thin flexible rubber membrane; this membrane is displaced to fill the hole. The in-place wet density is determined by dividing the wet mass of the soil removed by the volume of the hole. The water (moisture) content and the in-place wet density are used to calculate the dry in-place density and dry unit weight.

5. Significance and Use

5.1 This test method can be used to determine the in-place density and unit weight of natural inorganic soil deposits, soil-aggregate mixtures, or other similar firm materials. It is often used as a basis of acceptance for earthen material compacted to a specified density or percentage of a maximum density determined by a test method, such as Test Methods [D698](#), [D1557](#) or [D4253](#).

5.1.1 Test Methods [D698](#) and [D1557](#) require that mass measurements of laboratory compacted test specimens be determined to the nearest 1 g so that computed water contents and densities can be reported to three and four significant digits, respectively. This standard is a field procedure requiring mass measurements to the nearest 5 g. As such, water content calculations should only be reported to two significant digits and density to three significant digits.

5.2 This test method may be used to determine the density and unit weight of compacted soils used in construction of earth embankments, road fill, and structural backfill. This test method often is used as a basis of acceptance for soils compacted to a specified density or a percentage of maximum density or unit weight, as determined by a standard test method.

5.3 The use of this test method is generally limited to soil in an unsaturated condition and is not recommended for soils that are soft or that deform easily. Such soils may undergo a volume change during the application of pressure during testing. This test method may not be suitable for soils containing crushed rock fragments or sharp edge materials, which may puncture the rubber membrane.

NOTE 1—~~Notwithstanding the statements on precision and bias contained in this test method, the precision of this test method~~ The quality of the result produced by this standard is dependent on the competence of the personnel performing it and the suitability of the equipment and the facilities used. Agencies that meet the criteria of Practice [D3740](#) are generally considered capable of competent and objective testing. Users of this test method standard are cautioned that compliance with Practice [D3740](#) does not in itself ensure reliable ~~testing results~~. Reliable ~~testing depends~~ results depend on many factors; Practice [D3740](#) provides a means of evaluating some of those factors.

6. Apparatus

6.1 *Balloon Apparatus*—This is a calibrated vessel containing a liquid within a relatively thin, flexible, elastic membrane (rubber balloon) designed for measuring the volume of the test hole under the conditions of this test method. An example of the essential elements for this apparatus is shown in [Fig. 1](#). The apparatus shall be equipped so that an externally controlled pressure or partial vacuum can be applied to the contained liquid. It shall be of such weight and size that will not cause distortion of the excavated test hole and adjacent test area during the performance of the test. The apparatus shall provide for the use of an integral pressure ~~gage~~ gauge or other means for controlling the applied pressure during calibration and testing. Provision shall be made for placing loads (surcharge) on the apparatus. There shall be an indicator for determining the volume of the test hole to the nearest

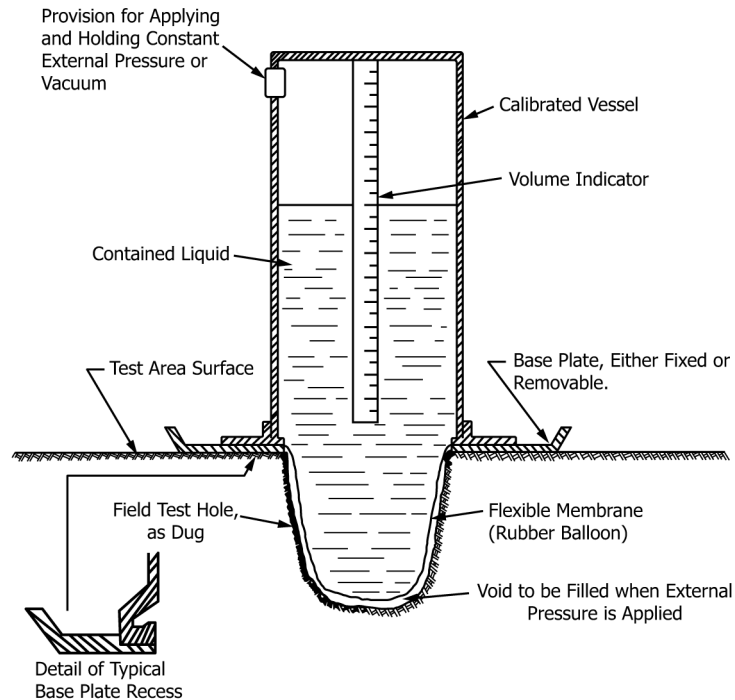


FIG. 1 Schematic Drawing of Calibrated Vessel Indicating Principle (Not to Scale)

1 %. The flexible membrane shall be of such size and shape as to fill the test hole completely without wrinkles or folds when inflated within the test hole, and the membrane strength shall be sufficient to withstand such pressure as is necessary to ensure complete filling of the test hole without loss of liquid. Withdrawal of the membrane from the test hole shall be accomplished by the application of a partial vacuum to the liquid or by other means.

6.1.1 The description and requirements given are intended to be nonrestrictive. Any apparatus using a flexible (rubber) membrane and liquid that can be used to measure within an accuracy of 1 % the volume of a test hole in soil under the conditions of this test method is satisfactory. Larger apparatus and test hole volumes are required when particles over 37.5 mm (1½ in.) are prevalent in the material being tested.

6.2 *Base Plate*—A rigid metal plate machined to fit the base of the balloon apparatus. The base plate shall have a minimum dimension of at least twice the test hole diameter to prevent deformation of the test hole while supporting the apparatus and surcharge loads (if used).

6.3 *Balances or Scales*—A balance or scale having a minimum capacity of 20 kg meeting the requirements of Specification D4753 for a balance of 5.0 g readability. Balances or scales required for moisture determination or oversize correction are contained in those standards.

6.4 *Drying Apparatus*—Equipment or ovens, or both, for the determination of moisture content in accordance with Test Methods D2216, D4643, D4959, or D4944.

6.5 *Miscellaneous Equipment*—Equipment including: small picks, chisels, spoons, brushes, and screwdrivers for digging test holes; plastic bags, buckets with lids, or other suitable moisture proof containers with snug fitting lids for retaining the soil taken from the test hole; shovels or spades and a straight edge for leveling and preparing test location; calculator or slide rule for calculations; and surcharge weights, if required, for apparatus.

7. Calibration

7.1 Prior to the first use, verify the procedure to be used and the accuracy of the volume indicator by using the apparatus to measure containers or molds of known volume in accordance with Annex A1.

TABLE 1 Minimum Test Hole Volumes Based on Maximum Size of Included Particles

Maximum Particle Size		Minimum Test Hole Volumes	
mm	(in.)	cm ³	ft ³
12.5	(0.5)	1420	0.05
25.0	(1)	2120	0.075
37.5	(1.5)	2840	0.1

7.2 Apparatus calibration checks should be periodically performed. These should be performed annually, as a minimum, and whenever damage, repair, or change of membrane that may affect the pressure or volume indicating portions of the apparatus occurs.

8. Procedure

8.1 Prepare the surface at the test location so that it is reasonably plane and level. Dependent on the water (moisture) content and texture of the soil, the surface may be leveled using a bulldozer or other heavy equipment blades, provided the test area is not deformed, compressed, torn, or otherwise disturbed.

8.2 Assemble the base plate and rubber balloon apparatus on the test location. Using the same pressure and surcharge determined during the calibration of the apparatus, take an initial reading on the volume indicator and record. The base plate shall remain in place through completion of the test.

8.3 Remove the apparatus from the test hole location. Using spoons, trowels, and other tools necessary, dig a hole within the base plate. Exercise care in digging the test hole so that soil around the top edge of the hole is not disturbed. The test hole shall be of the minimum volume shown in **Table 1** based on the maximum particle size in the soil being tested. When material being tested contains a small amount of oversize or isolated large particles are encountered, the test can be moved to a new location or changed to another test method, such as Test Method **D4914** or **D5030**. When particles larger than 37.5 mm (1½ in.) are prevalent, larger test apparatus and test volumes are required. Larger test-hole volumes will provide improved accuracy and shall be used where practical. The optimum dimensions of the test hole are related to the design of the apparatus and the pressure used. In general, the dimensions shall approximate those used in the calibration check procedure. The test hole shall be kept as free of pockets and sharp obtrusions as possible, since they may affect accuracy or may puncture the rubber membrane. Place all soil removed from the test hole in a moisture tight container for later mass and water (moisture) content determination.

8.4 After the test hole has been dug, place the apparatus over the base plate in the same position as used for the initial reading. Applying the same pressure and surcharge load as used in the calibration check, take and record the reading on the volume indicator. The difference between the initial and final readings is the volume of the test hole, V_h .

8.5 Determine the mass of all the moist soil removed from the test hole to the nearest 5 g. Mix all the soil thoroughly and select a representative water (moisture) content sample and determine the water (moisture) content in accordance with Test Methods **D2216**, **D4643**, **D4959**, or **D4944**. If oversize particles are present in the material removed from the test hole, perform field corrections in accordance with Test Method **D4718**.

9. Calculation

9.1 Calculate the in-place wet density, ρ_{wet} , of the soil removed from the test hole as follows:

$$\rho_{wet} = \frac{M_{wet}}{V_h (1 \times 10^3)} \quad (1)$$

where:

ρ_{wet} = in-place wet density, Mg/m³,
 M_{wet} = mass of the moist soil removed from the test hole, kg, and
 V_h = volume of the test hole, m³.

NOTE 2—1 cubic foot = 0.02832 cubic metres.

NOTE 2—Calculations shown are for using units in grams/kilograms and cubic metres. Other units are permissible provided the appropriate conversion factors are used to maintain consistency of units throughout the calculations.

9.2 Calculate the in-place dry density, ρ_d , of the soil as follows:

$$\rho_d = \frac{\rho_{wet}}{\left(1 + \frac{w}{100}\right)} \quad (2)$$

where:

ρ_d = in-place dry density, Mg/m³,
 ρ_{wet} = in-place wet density, Mg/m³, and
 w = water (moisture) content of the soil removed from the test hole, expressed as a percentage of the dry mass of the soil to the nearest 1 %.

9.3 Calculate the in-place dry unit weight, γ_d , as follows:

$$\gamma_d = \rho_d \times 62.43 \quad (3)$$

where:

γ_d = in-place dry unit weight, lbf/ft³, and
 γ_d = in-place dry unit weight, kN/m³, and