



Designation: F 1043 – 00

Standard Specification for Strength and Protective Coatings on Metal Industrial Chain Link Fence Framework¹

This standard is issued under the fixed designation F 1043; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ϵ) indicates an editorial change since the last revision or reapproval.

1. Scope

1.1 This specification covers the strength and protective coating requirements for industrial metal chain link fence framework up to 12 ft (3.66 m) maximum height with a post spacing not to exceed 10 ft (3 m).

1.1.1 *Caution Regarding Windscreens*—If wind screens are to be installed at the time of fence erection or at a later time, it is advisable to use stronger framework and parts and closer spacing of posts or back bracing depending upon the type of screening material to be used, area of fence to be covered and local wind conditions.

1.2 Posts and rails may have any cross-sectional shape meeting the outlined requirements within. The shapes may be formed and welded, cold formed, hot rolled, or extruded.

1.3 The values in inch-pound units are to be regarded as the standard. The values stated in SI units are for information purposes only.

2. Referenced Documents

2.1 ASTM Standards:

A 90/A 90M Test Method for Weight [Mass] of Coating on Iron or Steel Articles with Zinc or Zinc Alloy Coatings²

A 123/A 123M Specification for Zinc (Hot-Dip Galvanized) Coatings on Iron or Steel Products²

A 653/A 653M Specification for General Requirements for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process²

A 875/A 875M Specification for Steel Sheet, Zinc-5 % Aluminum Alloy Metallic-Coated by the Hot-Dip Process²

B 6 Specification for Zinc (Slab Zinc)³

B 308/B 308M Specification for Aluminum Alloy 6061 T6 Standard Structural Steel⁴

B 429 Specification for Aluminum-Alloy Extruded Structural Pipe and Tube³

B 750 Specification for Zinc-5 % Aluminum-Mischmetal;

Alloy in Ingot Form for Hot-Dip Coatings⁵

D 1499 Practice for Filtered Open-Flame Carbon-Arc Exposures of Plastics⁶

D 3359 Test Methods for Measuring Adhesion by Tape Tests⁷

E 8 Test Methods for Tension Testing of Metallic Materials⁸

E 376 Practice for Measuring Coating Thickness by Magnetic-Field or Eddy-Current (Electromagnetic) Test Methods⁹

F 552 Terminology Relating to Chain Link Fencing²

F 934 Specification for Standard Colors for Polymer Coated Chain Link Fence²

F 1083 Specification for Pipe, Steel, Hot-Dipped Zinc Coated (Galvanized), Welded, for Fence Structures²

G 23 Practice for Operating Light-Exposure Apparatus (Carbon-Arc Type) With and Without Water for Exposure of Nonmetallic Materials¹⁰

G 26 Practice for Operating Light-Exposure Apparatus (Xenon-Arc Type) With and Without Water for Exposure of Nonmetallic Materials¹¹

3. Terminology

3.1 *Definitions:*

3.1.1 *posts*—vertical members of the fence.

3.1.1.1 *Discussion*—End, corner, and pull posts are posts at which chain link fabric terminates. Gateposts are posts to which gates are either attached or latched. Line posts are posts that occur in a line of fence in which the chain link fabric passes and to which it is tied.

3.1.2 *rails*—horizontal members of the fence.

3.1.2.1 *Discussion*—May be top, bottom, intermediate or brace rails.

3.1.3 The dimensional terminology is shown in Fig. 1.

3.1.4 The relationship of measured dimension (used throughout) to trade and industry usage is shown in Table 1.

¹ This specification is under the jurisdiction of ASTM Committee F14 on Fences and is the direct responsibility of Subcommittee F14.40 on Chain Link Fence and Wire Accessories.

Current edition approved July 10, 2000. Published October 2000. Originally published as F 1043-95. Last previous edition F 1043-99.

² *Annual Book of ASTM Standards*, Vol 01.06.

³ *Annual Book of ASTM Standards*, Vol 02.03.

⁴ *Annual Book of ASTM Standards*, Vol 02.02.

⁵ *Annual Book of ASTM Standards*, Vol 02.04.

⁶ *Annual Book of ASTM Standards*, Vol 08.01.

⁷ *Annual Book of ASTM Standards*, Vol 06.01.

⁸ *Annual Book of ASTM Standards*, Vol 03.01.

⁹ *Annual Book of ASTM Standards*, Vol 03.03.

¹⁰ Discontinued. See 1997 *Annual Book of ASTM Standards*, Vol 14.02. Replaced by Practices G 152 and G 153.

¹¹ Discontinued. See 1997 *Annual Book of ASTM Standards*, Vol 14.02. Replaced by Practice G 155.

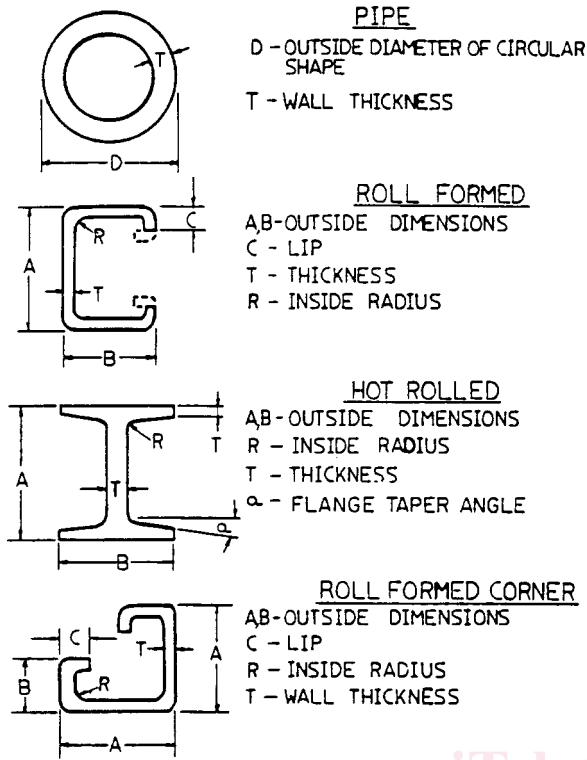


FIG. 1 Definitions of Dimensional Terms

TABLE 1 Size Terminology

Trade Size, in. (mm)	Designator, NPS (Metric)	Actual Outside Diameter	
		in.	mm
1 3/8 (34.9)	1 (25)	1.315	33.4
1 1/2 (41.3)	1 1/4 (32)	1.660	42.2
2 (50.8)	1 1/2 (40)	1.900	48.3
2 1/2 (63.5)	2 (50)	2.375	60.3
3 (76.2)	2 1/2 (65)	2.875	73.0
3 1/2 (88.9)	3 (80)	3.500	88.9
4 (101.6)	3 1/2 (90)	4.000	101.6

3.1.5 *open sections*—non-tubular framework sections (such as H-posts, C-posts, roll-formed top rail, and terminal posts).

3.1.6 *polymer coatings*—examples of some polymer coatings are acrylic urethane, polyurethane, polyvinyl chloride (PVC), polyester, and polyolefin elastomer.

3.1.7 See Terminology F 552 for other definitions of terms.

4. Ordering Information

4.1 Orders for steel fence framework purchased to this specification shall include the following information:

- 4.1.1 Number of posts and rails by size and length,
- 4.1.2 Type of outside and inside coating (Section 7) and class of material,
- 4.1.3 Color, if applicable, in accordance with Specification F 934,
- 4.1.4 Material group (round, C, or H) (Table 2),
- 4.1.5 Certification, if required, and
- 4.1.6 Exception(s) to this specification, or special requirements, if any.

NOTE 1—These details may be covered in whole or in any part by

TABLE 2 Definitions of Fence Framework Materials Design

Material	Description of Material
Group IA Round Steel Pipe	Steel pipe shall be produced to conform to Specification F 1083, standard weight (Schedule 40).
Group IB Aluminum Pipe	Aluminum pipe shall be produced of alloy Aluminum Pipe 6063 and shall conform to Specification B 429.
Group IC Round Steel Pipe (Electric Resistance Welded Pipe)	Steel pipe shall be produced in accordance with commercial standards. Minimum yield strength shall be 50 000 psi (344 MPa). Such products shall include, without seeking to limit to, cold-formed and welded pipe. The minimum weight shall be not less than 90 % of the nominal weight.
Group IIA Roll-Formed Steel Shapes (C-Sections)	Roll formed steel shapes shall be produced to commercial standards. Minimum yield strength shall be 45 000 psi (310 MPa). The minimum weight shall be not less than 90 % of the nominal weight. The formed lip shall be of the same thickness as the flat elements and shall project no less than 1/3 the width of the flat element being stiffened. Group II products shall be designated such that the strong axis is perpendicular to the line of fence.
Group IIB Aluminum Shapes	Aluminum shapes shall be produced of alloy 6061-T6 and shall conform to Specification B 308/B 308M.
Group III Hot-Rolled Shapes (H Beams)	Hot-rolled shapes shall meet the criteria and exhibit a minimum yield strength of 45 000 psi (310 MPa). The minimum weight shall be not less than 90 % of the nominal weight.
Group IV Alternate Design	Any suitable design can be delivered, provided it meets the strength and stiffness criteria of Fig. 2 (Industrial) or Fig. 3 (Light Industrial/Commercial) and the producer has supplied, in a form acceptable to the purchaser, data that demonstrates conformance with the specification. At the producer's option the methods in either Section 6 or 6.4 may be used.

accompanying the orders with design drawings and notations thereon.

5. Strength Requirements

5.1 It is the intent of this specification to permit the continuance of historically proved practice in the installation of chain link fence systems, and to provide strength requirements for alternative shapes and materials. Two categories are described. Industrial fence represents the most rigid and mechanically durable of the commonly installed framework. Light industrial/commercial fence, as provided herein, exhibits approximately 80 % of the load bearing capability of industrial fence. The summary requirements and options for industrial fence are given in Fig. 2 and those of light industrial/commercial fence in Fig. 3.

5.2 *Historical Practice*—Considerable past experience has shown that galvanized steel and 6063 T6 aluminum alloy perform satisfactorily as fence posts and rails if furnished to the standard weight (Schedule 40) and nominal sizes listed in Specifications F 1083 and B 429 respectively. Therefore, fence posts and rails consisting of standard weight (Schedule 40) galvanized steel and 6063 T6 aluminum alloy pipe in the nominal sizes and weight per foot listed in Specifications F 1083 and B 429 shall be considered in compliance with this specification.

Description	Pipe			Roll-Formed				Hot-Formed				Performance Criteria for Future Products IV			
	IA	IB	IC	II				III				Bending Strength Z x Y	Stiffness E x I		
Material	Steel	Aluminum	Steel	Steel				Steel							
Reference Specification	F 1083	B 429	A 653, A924, A 569	A 570 Grade 45, Others											
Minimum Yield Strength psi (Mpa)	30,000 (205)	25,000 (170)	50,000 (344)	45,000 (310)				45,000 (310)							
	Structural														
Top Rail	D = 1.660 in. (42 mm) t = 0.140 in. (3.6 mm) 2.27 lb/ft (3.38 kg/m)	D = 1.660 in. (42 mm) t = 0.140 in. (3.6 mm) 0.786 lb/ft (1.17 kg/m)	D = 1.660 in. (42 mm) t = 0.111 in. (2.8 mm) 1.82 lb/ft (2.71 kg/m)	1 1/4	1 1/8	3/8	3/16							7100 lbf-in (802 N-m) t _{min} = 0.075in. (1.9 mm)	3 x 10 ⁶ lbf-in. ² (8.6 kPa-m ⁴)
Line post	D = 2.375in. (60 mm) t = 0.154 in. (3.9 mm) 3.65 lb/ft (5.43 kg/m)	D = 2.375in. (60 mm) t = 0.154 in. (3.9 mm) 1.264 lb/ft (1.88 kg/m)	D = 2.375in. (60 mm) t = 0.130 in. (3.3 mm) 3.12 lb/ft (4.64 kg/m)	2 1/4	1 1/8	3/8	1/4	2 1/4	1 1/8	1/4	10			19600 lbf-in (2200 N-m) t _{min} = 0.115in. (2.9 mm)	16 x 10 ⁶ lbf-in. ² (46 kPa-m ⁴)
End corner and pull post	D = 2.875 in. (73 mm) t = 0.203 in. (5.2 mm) 5.79 lb/ft (8.62 kg/m)	D = 2.875 in. (73 mm) t = 0.203 in. (5.2 mm) 2.004 lb/ft (2.98 kg/m)	D = 2.875 in. (73 mm) t = 0.160 in. (4.1 mm) 4.64 lb/ft (6.9 kg/m)	3 1/2	1 1/2	1	3/16							37200 lbf-in (4200 N-m) t _{min} = 0.125in. (3.2 mm)	35 x 10 ⁶ lbf-in. ² (100 kPa-m ⁴)

A = outside dimension
B = outside dimension
C = lip

D = outside diameter
R = radius at surface (max)
a = flange taper angle
t = thickness (wall)

See Fig. 1 for drawings of shapes

Y = yield strength, min
Z = section modulus
I = moment of inertia
E = modulus of elasticity

NOTE—Engineering calculations should be used to determine post requirements for fences based on load and installation requirements.

FIG. 2 Summary of Requirements for Industrial Fence

Description	Pipe	Roll-Formed	Hot-Formed	Performance Criteria for Future Products IV	
	IC	II	III	Bending Strength Z x Y	Stiffness E x I
Material	Steel	Steel	Steel		
Reference Specification	A 653, A924, A 569	A 570 Grade 45, Others			
Minimum yield strength, psi (Mpa)	50,000 (344)	45,000 (310)	45,000 (310)		
		A B C R	A B R a		
Top Rail	D = 1.660 in. (42 mm) t = 0.085 in. (2.1 mm) 1.43 lb/ft (2.12 kg/m)	1 1/4 1 1/8 3/8 3/16 t = 0.080 in (2.0 mm) 1.35 lb/ft (2.01 kg/m)		7100 lbf-in (802 N-m) t _{min} = 0.075in. (1.9 mm)	3 x 10 ⁶ lbf-in. ² (8.6 kPa-m ⁴)
Line post	D = 2.375 in. (60 mm) t = 0.095 in. (2.4 mm) 2.31 lb/ft (3.44 kg/m)	1 7/8 1 1/8 3/16 1/4 t = 0.121 in (3.1 mm) 2.40 lb/ft (3.57 kg/m)	2 1/4 1 1/8 1/4 10 t = 0.125 in (3.2 mm) 3.26 lb/ft (4.85 kg/m)	19600 lbf-in (2200 N-m) t _{min} = 0.115in. (2.9 mm)	16 x 10 ⁶ lbf-in. ² (46 kPa-m ⁴)
End corner and pull post:	D = 2.875 in. (73 mm) t = 0.110 in. (2.8 mm) 3.25 lb/ft (4.84 kg/m)	3 1/2 1 1/2 1 3/16 t = 0.135 in (3.5 mm) 5.10 lb/ft (7.6 kg/m)		37200 lbf-in (4200 N-m) t _{min} = 0.125in. (3.2 mm)	35 x 10 ⁶ lbf-in. ² (100 kPa-m ⁴)

A = outside dimension
B = outside dimension
C = lip

D = outside diameter
R = radius at surface (max)
a = flange taper angle
t = thickness (wall)

See Fig. 1 for drawings of shapes

Y = yield strength, min
Z = section modulus
I = moment of inertia
E = modulus of elasticity

NOTE—Engineering calculations should be used to determine post requirements for fences based on load and installation requirements.

FIG. 3 Summary of Requirements for Light Industrial/Commercial Fence

5.2.1 Past experience has shown that several additional products also performed satisfactorily provided certain addi-

tional requirements are met. The nominal dimensions, minimum yield strength (Y), and nominal weight/ft are also listed