



Designation: **C947 – 03 (Reapproved 2009) C947 – 03 (Reapproved 2016)**

Standard Test Method for Flexural Properties of Thin-Section Glass-Fiber-Reinforced Concrete (Using Simple Beam With Third-Point Loading)¹

This standard is issued under the fixed designation C947; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ϵ) indicates an editorial change since the last revision or reapproval.

1. Scope

1.1 This test method covers determination of the flexural ultimate strength in bending and the yield strength of glass-fiber reinforced concrete sections by the use of a simple beam of 1.0 in. (25.4 mm) or less in depth using third-point loading.

1.2 The values stated in inch-pound units are to be regarded as the standard. The values given in parentheses are for information only.

1.3 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.*

2. Referenced Documents

2.1 *ASTM Standards:*²

[C1228 Practice for Preparing Coupons for Flexural and Washout Tests on Glass Fiber Reinforced Concrete](#)

[D76 Specification for Tensile Testing Machines for Textiles](#)

[E4 Practices for Force Verification of Testing Machines](#)

3. Significance and Use

3.1 Flexural properties determined by this test method are useful for quality control of glass-fiber reinforced concrete products, ascertaining compliance with the governing specifications, research and development, and generating data for use in product design.

4. Apparatus

4.1 *Testing Machine*—A properly calibrated testing machine that can be operated at constant rates of crosshead motion and in which the error in the force measuring system shall not exceed $\pm 1.0\%$ of the maximum force expected to be measured shall be used. The testing machine shall be equipped with a deflection measuring and recording device. The stiffness of the testing machine shall be such that the total elastic deformation of the system does not exceed 1.0% of the total deflection of the test specimen during the test, or appropriate corrections shall be made. The force-indicating mechanism shall be essentially free of inertial lag at the crosshead rate used. The accuracy of the testing machine shall be verified in accordance with Practices [E4](#) and Specification [D76](#).

4.2 *Loading Noses and Supports*—*Supports*—The loading noses and supports shall have cylindrical surfaces. In order to avoid excessive indentation or failure due to stress concentration directly under the loading noses or supports, the radius of the noses and supports shall be at least 0.25 in. (6.35 mm). See [Fig. 1](#) for loading configuration. The arc of the loading noses and supports, in contact with the specimen, shall be sufficiently large to prevent contact of the specimen with the sides of the noses. Neoprene pads, approximately $\frac{1}{16}$ in. (1.6 mm) thick, may be placed between the loading noses and the test specimen for uniform load distribution across the width of the specimen. However, neoprene pads should not be used if deflection measurements are to be made, as the compression of the neoprene will distort the measurements.

¹ This test method is under the jurisdiction of ASTM Committee [C27](#) on Precast Concrete Products and is the direct responsibility of Subcommittee [C27.40](#) on Glass Fiber Reinforced Concrete.

Current edition approved ~~May 1, 2009~~ April 1, 2016. Published ~~May 2009~~ May 2016. Originally approved in 1981. Last previous edition approved in ~~2003~~ 2009 as [C947 – 03](#); [C947 – 03\(2009\)](#). DOI: [10.1520/C0947-03R09](#); [10.1520/C0947-03R16](#).

² For referenced ASTM standards, visit the ASTM website, [www.astm.org](#), or contact ASTM Customer Service at [service@astm.org](#). For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

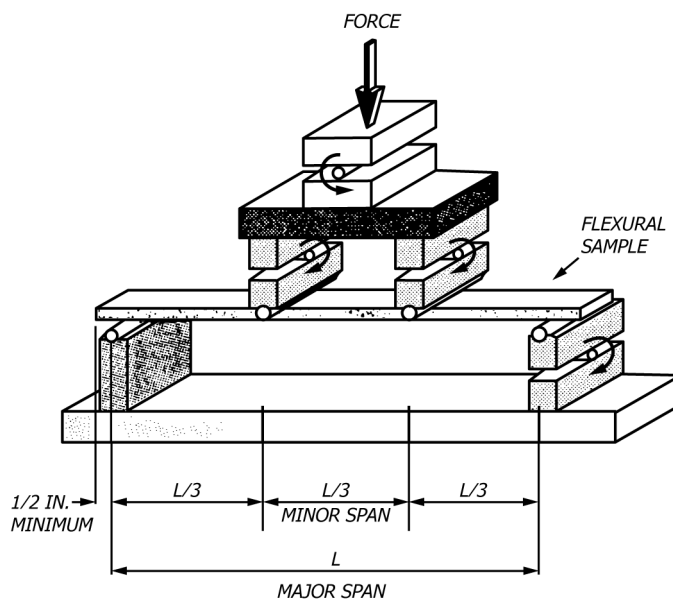


FIG. 1 Loading Configuration for Flexural Testing

4.3 *Loading Head and Support Apparatus—Apparatus*—Loading noses, supports, and their respective holding devices shall be designed to allow rotation to occur about axes that lie in horizontal planes of the loading apparatus as shown in Fig. 1. This configuration of loading head and support apparatus will ensure that forces applied to the specimen will be initially perpendicular to the surfaces of the specimen and applied without eccentricity.

4.4 *Specimen Depth and Width Measuring Device*—A caliper or micrometer or other suitable device that is able to measure sample depth accurate to 0.005 in. (0.13 mm) and width accurate to 0.01 in. (0.25 mm).

5. Sampling

5.1 Test boards shall be manufactured in accordance with governing specifications.

6. Test Specimen

6.1 Six test specimens shall be prepared in accordance with Practice C1228.

6.2 The test specimen shall have a ratio of the specimen major span length to the specimen depth between 16 to 1 and 30 to 1. The total specimen length shall be a minimum of 1 in. (25 mm) longer than the specimen's major span. Nominal specimen width shall be 2 in. (50 mm).

7. Conditioning

7.1 The sample or specimens shall be transported to the testing laboratory packaged so that no damage will take place.

7.2 Condition the samples or specimens in water at $73 \pm 5^\circ\text{F}$ ($23 \pm 3^\circ\text{C}$) for a period of minimum 24 h and maximum 72 h to ensure complete saturation and test immediately upon removal. Remove specimens from water bath individually and test. Do not allow specimen surfaces to dry out either prior to or during the test. Specimen surfaces may be sprayed with water during testing if indications of surface drying are present.

7.3 Samples or specimens shall be tested in a temperature controlled environment at $73 \pm 5^\circ\text{F}$ ($23 \pm 3^\circ\text{C}$).

8. Procedure

8.1 Set the major span of the test apparatus to correspond with 6.2.

8.2 Set the minor span to correspond with one third of the major span.

8.3 Align the loading noses and supports so that the axes of the cylindrical surfaces are parallel.

NOTE 1—The parallelism of the loading noses and supports may be checked by means of a plate containing parallel grooves into which the loading noses and supports will fit when properly aligned.

8.4 Center the specimen on the supports with equal lengths of specimen projecting outside of the supports with the long axis of the specimen perpendicular to the loading noses and supports.

8.5 Test three specimens with the mold face in tension and three specimens with the opposite face (or trowelled face) in tension.