



Designation: C1764 – 12 (Reapproved 2016)

Standard Test Methods for Non Metallic Plaster Bases (Lath) Used with Portland Cement Based Plaster in Vertical Wall Applications¹

This standard is issued under the fixed designation C1764; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ϵ) indicates an editorial change since the last revision or reapproval.

1. Scope

1.1 These test methods evaluate the performance of vertical wall applications of non metallic plaster bases used with Portland Cement Based Plaster under a variety of test exposures.

1.2 *Units*—The values stated in either SI units or inch-pound units are to be regarded separately as standard. The values stated in each system may not be exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in non-conformance with the standard.

1.3 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.*

2. Referenced Documents

2.1 ASTM Standards:²

C926 Specification for Application of Portland Cement-Based Plaster

E330 Test Method for Structural Performance of Exterior Windows, Doors, Skylights and Curtain Walls by Uniform Static Air Pressure Difference

E631 Terminology of Building Constructions

E2098 Test Method for Determining Tensile Breaking Strength of Glass Fiber Reinforcing Mesh for Use in Class PB Exterior Insulation and Finish Systems (EIFS), after Exposure to a Sodium Hydroxide Solution

2.2 ICC-ES Acceptance Criteria:

AC 191 Acceptance Criteria for Metal Plaster Bases (Lath)

¹ These test methods are under the jurisdiction of ASTM Committee C11 on Gypsum and Related Building Materials and Systems and is the direct responsibility of Subcommittee C11.02 on Specifications and Test Methods for Accessories and Related Products.

Current edition approved Sept. 1, 2016. Published September 2016. Originally approved in 2012. Last previous edition approved in 2012 as C1764 – 12. DOI: 10.1520/C1764-12R16.

² For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

3. Terminology

3.1 *Definitions*—For definitions of terms used in these test methods, refer to Terminology E631.

3.2 Definitions of Terms Specific to This Standard:

3.2.1 *non metallic, plaster base (lath)*—material used as a base for Portland Cement Based Plaster that is flat or self furred.

4. Significance and Use

4.1 General:

4.1.1 Non metallic reinforced Portland Cement Based Plaster are vertically applied exterior wall claddings that may be subject to variety of conditions over the claddings service life. The series of tests described in this standard evaluates performance under a variety of test conditions and exposures. Any given project may not be subject to all of the test conditions described herein and all of the test methods may not evaluate all exposures for a given project.

4.2 Transverse Load:

4.2.1 This test determines the ultimate wind load resistance of the wall assembly including influence of the framing, sheathing, and means of attachment.

4.3 Vertical Load:

4.3.1 The weight and attachment mechanism of Portland Cement Based Plaster results in a vertical load transfer to the plaster base. This test method determines the ultimate vertical load capacity of the cladding assembly based on taking the specimen to failure.

4.4 Embedment:

4.4.1 Plaster bases serve as a key, reinforcement and attachment mechanism for Portland Cement Based Plaster. The thickness, profile, and material properties of the plaster bases must be such that it is adequately embedded in the Portland Cement Based Plaster. This can be accomplished through use of a self furred non metallic plaster base or other means such as furring strips. This test procedure determines the effectiveness of the furring mechanism to ensure that the minimum embedment is obtained.

4.5 Fastener Pull Through Resistance:

4.5.1 The non metallic lath is secured to the building frame or substrate with fasteners. This test evaluates the fastener attachment effectiveness.

4.6 Alkali Resistance (Glass Fiber Lath Only):

4.6.1 Per E2098.

5. Sampling, Test Specimens, and Test Units

5.1 The number, size and configuration of the test specimens shall be as per each test procedure with the exception of Transverse Load tests which shall incorporate wood or steel framing as determined by the user. Samples shall be representative of standard products and construction methods.

6. Test Specimens

6.1 Transverse Load:

6.1.1 Construct three test specimens. Test specimen size shall be minimum 4 ft (1.2 m) by 8 ft (2.4 m) and constructed representative of end use conditions. Framing members shall be wood or steel as determined by the user. C926 Portland

Cement Based Plaster shall be mixed and applied in the configuration of the test specimen.

6.2 Vertical Load:

6.2.1 Construct three test frames measuring 12 inch (305 mm) by 20 inch (508 mm) using nominal 2 inch (50 mm) by 4 inch (100 mm) wood lumber with specific gravity of 0.42. The test frame shall have one intermediate stud with top and bottom plates and sheathed one side with 1/2 inch (13 mm) thick gypsum sheathing. Attach studs to plates using 2 16d (3 1/2 inch (89 mm) length) nails and sheathing to framing using 6d (2 inch length) common nails or equal fastened 8 inches (200 mm) on center. A test panel shall be prepared measuring 6 inches (152 mm) high by 16 inches (406 mm) wide and consisting of a water-resistive barrier (provided to prevent adhesion of the test panel to the test frame); non metallic plaster base, which is attached through the water-resistive barrier to the intermediate framing member with one fastener; and apply Portland Cement Based Plaster per C926. The samples shall be cured a minimum of 28 days. Refer to Fig. 1

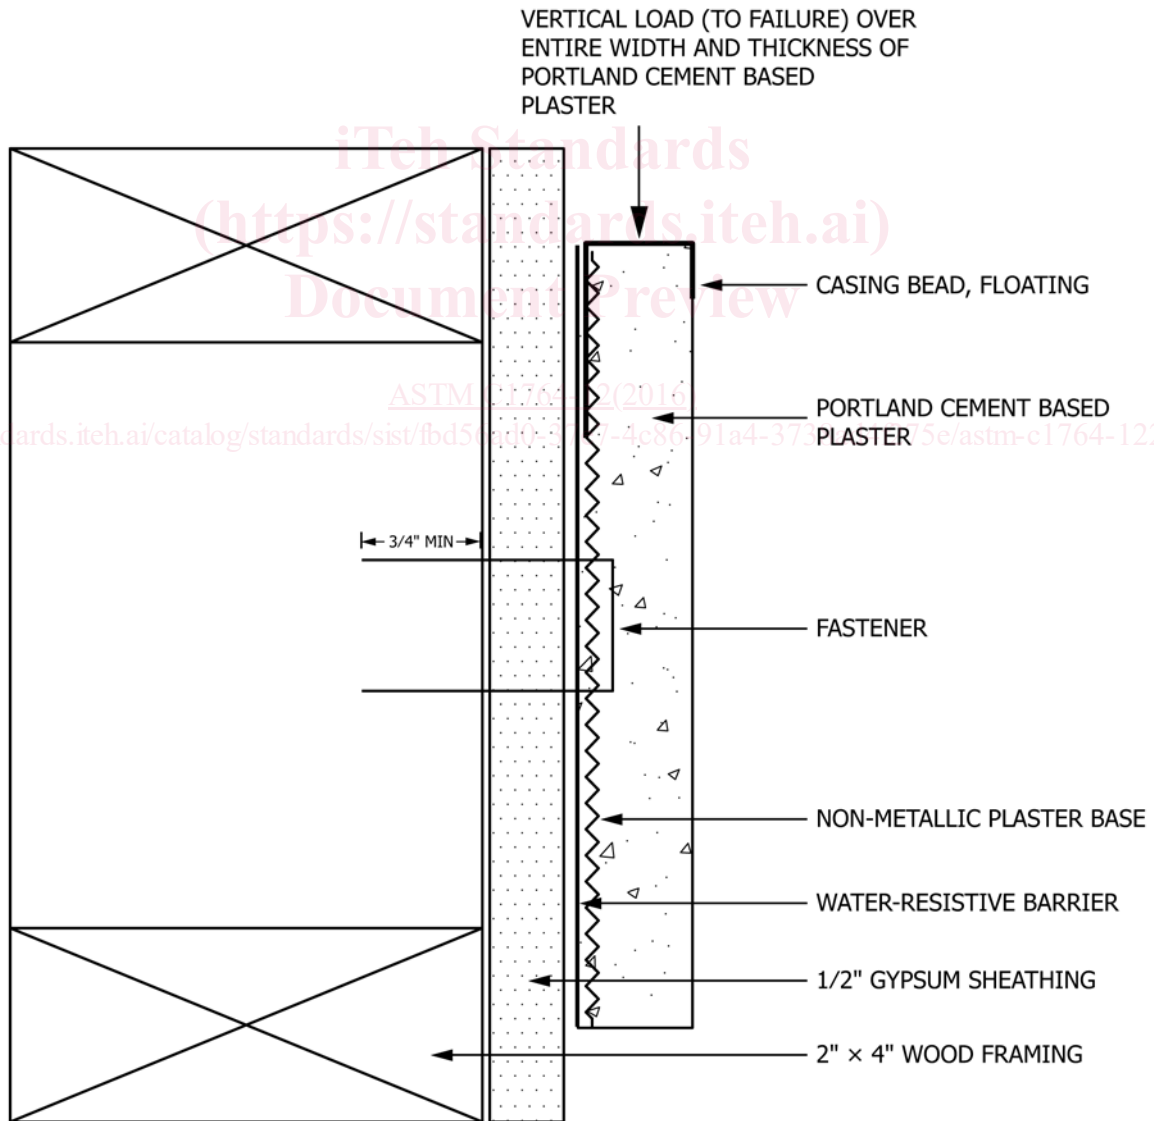


FIG. 1 Test Assembly