



Designation: D1782 – 17

Standard Test Methods for Operating Performance of Particulate Cation-Exchange Materials¹

This standard is issued under the fixed designation D1782; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reappraisal. A superscript epsilon (ϵ) indicates an editorial change since the last revision or reappraisal.

1. Scope

1.1 These test methods cover the determination of the operating capacity of particulate cation-exchange materials when used for the removal of calcium, magnesium, and sodium ions from water. It is intended for use in testing both new and used materials. The following two test methods are included:

| | |
|------------------------------|---------------------|
| Test Method A—Sodium Cycle | Sections 8 to 14 |
| Test Method B—Hydrogen Cycle | 15 to 21 |

1.2 The values stated in SI units are to be regarded as standard. The values given in parentheses are mathematical conversions to inch-pound units that are provided for information only and are not considered standard.

1.3 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety, health and environmental practices and determine the applicability of regulatory limitations prior to use.*

1.4 *This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.*

2. Referenced Documents

2.1 ASTM Standards:²

- D1067 Test Methods for Acidity or Alkalinity of Water
- D1126 Test Method for Hardness in Water
- D1129 Terminology Relating to Water
- D1193 Specification for Reagent Water
- D2687 Practices for Sampling Particulate Ion-Exchange Materials

¹ These test methods are under the jurisdiction of ASTM Committee D19 on Water and are the direct responsibility of Subcommittee D19.08 on Membranes and Ion Exchange Materials.

Current edition approved Aug. 1, 2017. Published August 2017. Originally approved in 1960. Last previous edition approved in 2009 as D1782 – 95 (2009). DOI: 10.1520/D1782-17.

² For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

3. Terminology

3.1 Definitions:

3.1.1 For definitions of terms used in these standards, refer to Terminology D1129.

3.2 Definitions of Terms Specific to This Standard:

3.2.1 Certain terms in these standards that relate specifically to ion exchange are defined as follows:

3.2.2 *free mineral acidity*—the quantitative capacity of aqueous media to react with hydroxyl ions to pH 4.3.

3.2.3 *hydrogen cycle*—the operation of a cation-exchange cycle wherein the removal of specified cations from influent water is accomplished by exchange with an equivalent amount of hydrogen ion from the exchange material.

3.2.4 *theoretical free mineral acidity*—the free mineral acidity that would result from the conversion of the anions of strong acids in solution to their respective free acids.

4. Summary of Test Methods

4.1 Test Method A consists of repeated cycles of backwash, brine regeneration, rinse, and exhaustion of the sample in the form of a bed in a transparent column. The exhausting medium used is an ion-exchange test water.

4.2 Test Method B consists of repeated cycles of backwash, acid regeneration, rinse, and exhaustion of the sample in the form of a bed in a transparent column. The exhausting medium used is an ion-exchange test water.

5. Apparatus

5.1 *Test Assemble* (see Fig. 1), consisting of the following:

5.1.1 *Column*, transparent, vertically supported, 25.4 ± 2.5 mm (1.0 ± 0.1 in.) in inside diameter and approximately 1500 mm (60 in.) long. The bottom of the column shall be closed and provided with an outlet of approximately 6-mm inside diameter. Connections shall be provided at top and bottom for admission and removal of solutions as described in Section 10. Adequate means for measuring and regulating flow shall be provided. Calibrate the column in such a manner that the volume readings required by the test method can be made. Make all measurements at $25 \pm 5^\circ\text{C}$.

5.1.2 *Support*, for the sample, so designed that the distance from the sample to the column outlet is at least 50 mm. A

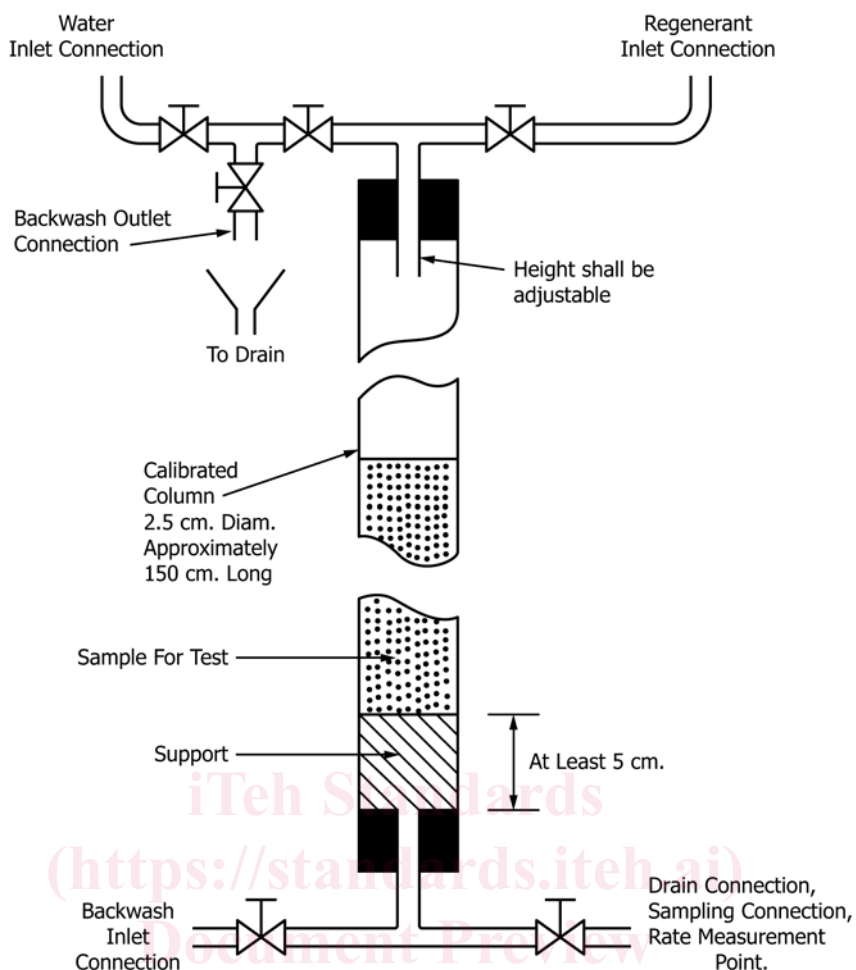


FIG. 1 Typical Arrangement of Apparatus for Performance Testing of Ion-Exchange Materials

suggested supporting bed utilizes quartz, glass beads, or other material 1.5 to 3.5 mm in diameter, insoluble in the reagents used, and retained on a corrosion-resistant screen. However, other supports such as fritted glass or polyester screens may be used at the discretion of the interested parties.

6. Reagents

6.1 *Purity of Reagents*—Reagent grade chemicals shall be used in all tests. Unless otherwise indicated, it is intended that all reagents shall conform to the specifications of the Committee on Analytical Reagents of the American Chemical Society, where such specifications are available.³ Other grades may be used, provided it is first ascertained that the reagent is of sufficiently high purity to permit its use without lessening the accuracy of the determination.

6.2 *Purity of Water*—Unless otherwise indicated, references to water shall be understood to mean reagent water, Type IV, conforming to Specification D1193.

³ *Reagent Chemicals, American Chemical Society Specifications*, American Chemical Society, Washington, DC. For suggestions on the testing of reagents not listed by the American Chemical Society, see *Analar Standards for Laboratory Chemicals*, BDH Ltd., Poole, Dorset, U.K., and the *United States Pharmacopeia and National Formulary*, U.S. Pharmaceutical Convention, Inc. (USPC), Rockville, MD.

7. Sampling

7.1 To obtain a representative sample of particulate ion-exchange material, either from a shipment of new product in the manufacturer's original packages or from a bed of used material, refer to Practices D2687.

7.2 Transfer the laboratory sample to a 2-L beaker and add enough water to bring the water level up to that of the ion-exchange material and soak for 1 h (see Note 1). Mix the sample thoroughly and transfer a sufficient representative portion to fill a 400-mL beaker. Use this portion of sample in the procedure.

NOTE 1—Where new materials are shipped dry, follow the manufacturer's instructions for preconditioning.

TEST METHOD A—SODIUM CYCLE

8. Scope

8.1 This test method is designed to simulate operating conditions on a sodium cycle used for the removal of calcium and magnesium and other divalent ions from water.

9. Significance and Use

9.1 Cation exchange materials are frequently used in the sodium form to exchange divalent and trivalent ions in the

influent water for sodium ions on the resin sites. This process is commonly referred to as *softening* water since it removes those ions that form a “hard” curd of insoluble salts with the fatty acids used in some soaps and that also precipitate when water is boiled. In such a process, sodium chloride is used as the regenerant to return the cation-exchanging groups to the sodium form.

9.2 This test method is intended to simulate the performance of such materials in actual usage. It may be used either to compare the performance of new materials or to compare the performance of a material that has been used with its original performance.

9.3 Regenerant concentrations and dosages used herein are typical for the types of materials used in this application. If different concentrations or amounts of regenerant are agreed upon by parties using this test method, this fact should be stated when the results are reported. Similarly, the test water specified is the agreed upon standard. Where other test waters or the water to be treated are used in the test, the analysis of the water in terms of total solids, sodium, calcium, magnesium, other di- or trivalent metals as well as the major anions present should be reported with the test results.

10. Reagents and Materials

10.1 Brine Regenerants:

10.1.1 For synthetic organic ion-exchange materials:

10.1.1.1 *Sodium Chloride* (100 g/L)—Dissolve enough sodium chloride (NaCl) in water to make a solution containing in each litre 100.0 g of NaCl.

10.1.2 For all other ion-exchange materials:

10.1.2.1 *Sodium Chloride* (50 g/L)—Dissolve enough NaCl in water to make a solution containing in each litre 50.0 g of NaCl.

10.2 *Cation-Exchange Test Water A* (10 meq/L)—Dissolve enough calcium chloride ($\text{CaCl}_2 \cdot 2\text{H}_2\text{O}$) and magnesium sulfate ($\text{MgSO}_4 \cdot 7\text{H}_2\text{O}$) in water to make a solution containing, in each litre, 0.49 g of $\text{CaCl}_2 \cdot 2\text{H}_2\text{O}$ and 0.415 g of $\text{MgSO}_4 \cdot 7\text{H}_2\text{O}$. Adjust the pH to 7.5 by the addition of Na_2CO_3 (30 g/L) and determine the hardness of the solution in accordance with Test Method **D1126**. The hardness of the test water will be 10.0 ± 0.5 meq/L. Use the determined hardness in calculating operating capacity as indicated in **12.1**. This test water shall be used for all tests.

10.3 *Hardness Test Reagents*—For reagents used in determining hardness, refer to Test Method **D1126**. This reagent is used only in preparation of test water (see **10.2**).

10.4 *Sodium Carbonate Solution* (30 g/L)—Dissolve 30 g of sodium carbonate (Na_2CO_3) in water and dilute to 1 L.

11. Procedure

11.1 Adjust the temperature of the water and all solutions to be used in this procedure to $25 \pm 5^\circ\text{C}$ and maintain this temperature throughout the test.

11.2 Fill the column approximately half full of water and add sufficient sample to give a bed height of 750 ± 75 mm above the top of the support. To avoid drying out of the ion-exchange material, maintain a layer of liquid at least 20 to 30 mm deep above the top of the bed at all times during the procedure.

11.3 Backwash with water for 10 min using a flow rate that will maintain a 50 % expansion of the bed. If the supernatant liquid is clear at this point, proceed to **11.4**. If the liquid is cloudy (indicating the presence of light, insoluble, extraneous material), adjust the backwash outlet tube to a height above the bed equal to 75 % of the bed height. Continue backwashing at the same rate until the effluent is clear.

11.4 Allow the bed to settle and then drain at a rate of approximately 100 mL/min until the water level is 20 to 30 mm above the top of the bed. Do not jar. Record the volume, in millilitres, of ion-exchange material. Repeat the 10-min backwash until two successive readings of volume agree within 5 mL. The average of these two readings shall be the sample volume for new materials shipped in the sodium form.

11.5 Exhaust the ion exchanger with cation-exchange test water A at a flow rate of 0.33 mL/min/mL of exchanger, as measured in **11.4**. Maintain a head of liquid not less than 50 mm above the top of the bed. Continue the run until the effluent shows 0.2 meq/L (or other agreed-upon hardness level) when tested in accordance with Test Method **D1126**. Record the volume of test water used.

11.6 Repeat the 10-min backwash and drain as described in **11.3** and **11.4**. When testing new material shipped in the sodium form, only one backwash is necessary at this point because a determination of volume has already been made. However, used material other than in the sodium form must have a volume determination made here as described in **11.4**. Use this sample volume determined on the exhausted material in calculating the capacity of used ion-exchange materials.

11.7 Determine the amount of brine regenerant and rate required, from **Table 1**. For use with **Table 1**, the volume sample for new material shall be that determined in accordance with **11.4** and for used material shall be that determined in accordance with **11.6**.

11.8 Pass the specified volume of brine regenerant through the bed at the specified rate until only a 20 to 30-mm layer of liquid remains above the bed. Rinse the bed with water, using

TABLE 1 Amount of Brine Regenerant Required for Use in Test Method A

| Type of Exchange Material | Brine Regenerant, g/L | Rate of Flow, mL brine/min/mL of Exchanger | Contact Time, min | Regeneration Level | |
|---------------------------|-----------------------|--|-------------------|--------------------|------|
| | | | | lb/ft ³ | g/L |
| Synthetic organic | 100 | 0.032 | 30 | 6.00 | 96.1 |
| Greensand | 50 | 0.027 | 15 | 1.25 | 20.0 |
| Synthetic siliceous | 50 | 0.080 | 20 | 3.00 | 80.1 |
| Carbonaceous | 50 | 0.067 | 15 | 3.15 | 50.5 |