



Designation: **E736/E736M – 00 (Reapproved 2015)^{ε1} E736/E736M – 17**

Standard Test Method for Cohesion/Adhesion of Sprayed Fire-Resistive Materials Applied to Structural Members¹

This standard is issued under the fixed designation E736/E736M; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ϵ) indicates an editorial change since the last revision or reapproval.

This standard has been approved for use by agencies of the U.S. Department of Defense.

^{ε1} NOTE—Designation was changed to dual and units information was corrected editorially in September 2015.

1. Scope

1.1 This test method covers a procedure for measuring the cohesion/adhesion or bond strength (tensile) perpendicular to the surface of sprayed fire-resistive material (SFRM) applied to rigid backing. These fire-resistive materials include sprayed fibrous and cementitious materials. The test method is applicable to both laboratory and field procedures as indicated in Section 7.

1.2 The values stated in either SI units or inch-pound units are to be regarded separately as standard. The values stated in each system may not be exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in non-conformance with the standard.

1.3 *This standard does not purport to address all of the safety problems, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety, health, and environmental practices and determine the applicability of regulatory limitations prior to use.*

1.4 *This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.*

2. Referenced Documents

2.1 *ASTM Standards:*²

[E84 Test Method for Surface Burning Characteristics of Building Materials](#)

[E119 Test Methods for Fire Tests of Building Construction and Materials](#)

[E605/E605M Test Methods for Thickness and Density of Sprayed Fire-Resistive Material \(SFRM\) Applied to Structural Members](#)

[E1494 Practice for Encapsulation Testing of Friable Asbestos-Containing Surfacing Materials](#)

3. Summary of Test Method

3.1 The cohesion/adhesion is determined using a metal or plastic cap with a hook attached. The cap is attached to the SFRM with a suitable adhesive. An increasing load, measured by a scale, is applied manually until failure occurs.

4. Significance and Use

4.1 The intent of this test method is to determine a property of SFRM that may be used to provide an indication of its in-place serviceability. Satisfactory performance of SFRM applied to structural members and assemblies depends upon its ability to withstand the various influences that may occur during construction and during the life of the structure, as well as upon its satisfactory performance under fire conditions.

4.2 For cohesion/adhesion testing of installed asbestos-containing sprayed fire-resistive materials, refer to Practice [E1494](#).

¹ This test method is under the jurisdiction of ASTM Committee E06 on Performance of Buildings and is the direct responsibility of Subcommittee E06.21 on Serviceability.

Current edition approved Sept. 1, 2015/Sept. 1, 2017. Published September 2015/October 2017. Originally approved in 1980. Last previous edition approved in 2014/2015 as E736 – 00 (2011)/E736/E736M – 00 (2015)^{ε1}. DOI: 10.1520/E0736_E0736M-00R15E01-10.1520/E0736_E0736M-17.

² For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For *Annual Book of ASTM Standards* volume information, refer to the [standard's Document Summary](#) page on the ASTM website.

5. Apparatus

5.1 Fig. 1 illustrates a suitable apparatus.

5.2 *Bottle Screw Cap*,³ metal or rigid plastic 51 mm to 83 mm [2 in. to 3¼ in.] in diameter and 12 mm [½ in.] in nominal depth. A hook shall be attached at the center. Where deck profile does not allow the use of an 83-mm [3¼-in.] diameter cap due to area restriction, a minimum 51-mm [2-in.] diameter cap shall be used.

5.3 *Adhesive*, single or two component, suitable for adhering cap to SFRM.⁴

5.4 *Weighing Scale*, spring type (fish hook), with a capacity suitable for the SFRM being tested (typically 12 kg to 30 kg [26 to 66 lb] capacity). The accuracy shall be within 0.1 kg [¼-lb].

5.5 *Galvanized Steel Sheet*, 1.5 mm [0.060 in. (16 ga)] thick, 300 mm [12 in.] square, cleaned with solvent to remove any oil from surface to be sprayed.

5.6 *Drying Oven*, capable of maintaining temperature and humidity conditions during the specimen curing cycle, in accordance with the SFRM manufacturers' published requirements.

6. Sampling

6.1 This test method requires the application of SFRM in accordance with manufacturers' published instructions. The apparatus, materials, and procedures used to spray apply the SFRM for this test shall be representative of application in the field.

6.2 The density of the prepared specimens shall be similar to the density tested and reported during the Test Methods E84 and E119 fire exposure tests of the same material, or as required by the sponsor of the test.

6.3 Determine and report in accordance with Test Methods E605/E605M the density and thickness of each sample, or of a randomly selected specimen from the sample lot when a number of identical samples are being tested for the laboratory-prepared samples. For the field specimens, determine the density from material adjacent to the test specimen.

7. Test Specimen

7.1 *Laboratory Tests:*

7.1.1 The SFRM shall be applied at a thickness of 12 mm to 25 mm [½ in. to 1 in.] to the 300 by 300 mm [12 by 12 in.] galvanized steel sheet.

7.1.2 Condition the specimen at room temperature (20 ± 10°C [68 ± 18°F]). After 72 h, samples may be force dried in a drying oven at 43 ± 6°C [110 ± 10°F], and a relative humidity not greater than 60 % until successive weight⁵ readings, taken at 8 h intervals, differ by less than one percent.

7.1.3 Testing may be performed after it has been determined that all samples have reached constant weight as defined in 7.1.2.

7.2 *Field Tests:*

7.2.1 The test specimen shall be the in-place SFRM as applied to any field condition surface. Where a 300 by 300-mm [12 by 12-in.] area is not available, such as on beams and fluted deck, use the width of the beam or the width of a flute by 300 mm [12 in.] length. The area shall be at least 100 by 300 mm [4 by 12 in.]. See 5.2 for exceptions.

7.2.2 Condition the specimen at atmospheric conditions or in accordance with the manufacturers' recommendations for a period sufficient to be considered dry.

7.2.3 Mechanical ventilation may be employed on the manufacturers' recommendation to expedite drying.

³ Refer to Appendix X1.2 for a list of bottle screw cap supply houses that have been found satisfactory for this purpose. Many local suppliers are also available.

⁴ Suitable adhesives are commercially available. Refer to Appendix X1.1 for a list of adhesive supply houses that have been found satisfactory for this purpose.

⁵ Although mass is being determined, the term weight is used in the test method as an accepted substitute.

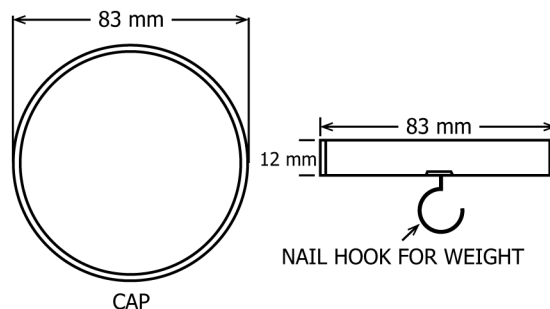


FIG. 1 Typical Cohesion/Adhesion Testing Apparatus